



DENDRO Bevelback Technical Manual

CONTENTS

Technical Info

Product Warranty	3
Profiles	4-5
Storing Product	6
Building Code	7
Scope and Limitations of Use	7
Health & Safety	7
Fixing Detail	8-9
Terms & Conditions	10

Architectural Drawings

Architectural Drawing Notes	13
Architectural Drawings	16-65

PRODUCT WARRANTY

DENDRO is Southern Pine's premium product range of H3.2 treated, solid, clear weatherboards. Manufactured from high quality, pruned New Zealand Radiata Pine. This product is warranted for 25 years if used in accordance with the enclosed terms and conditions.



Southern Pine Products Ltd (SPP) warrants to replace and / or compensate for defective or substantial product failure subject to the claimant providing;

- proof that the product has been made or supplied by SPP and has failed or is substantially unfit for purpose
- timely written notification of the failure of the product (within 30 days of becoming apparent)
- reasonable evidence to indicate the product has been stored, installed and maintained in keeping with normal best practises and consistent with SPP instructions (as per SPP website and brochures)

Warranty is limited to replacement of product or cost value of product at SPP sole discretion and does not extend to any labour or consequential damage caused to other product. Such replacement will be considered full and final compensation.

Cladding and exterior products must be installed by a qualified builder (LBP).

H3.2 Treated DENDRO 25 Year Limited Product Warranty

Inclusions:

- Southern Pine DENDRO products
- Product delamination, splitting or breaking not for reasons excluded below
- Product decay or rot
- Gross manufacturing defects
- Incorrect profiling other than minor variations


Exclusions:

- Evidence that the product has not been correctly stored, installed or maintained. For example, product wet due to incorrect storage, incorrect fixing of weatherboards, failing to properly seal cut ends or punch nails, not applying paint in a timely manner etc.
- Extreme climate areas where regular maintenance has not been carried out such as coastal zones which may require regular washing, or high UV zones which may require more frequent re-painting
- Inappropriate product use that is not consistent with best practise. For example, H3.2 treated product placed in contact with the ground
- Product impacted by natural disasters
- Damage after purchase or delivery
- Fair wear and tear with regard to product's age and conditions of use

PROFILES


All SPP Bevelback weatherboard profiles have been machined to be compliant with NZS 3617 and BRANZ BU411.

Scale 1:2 at A4

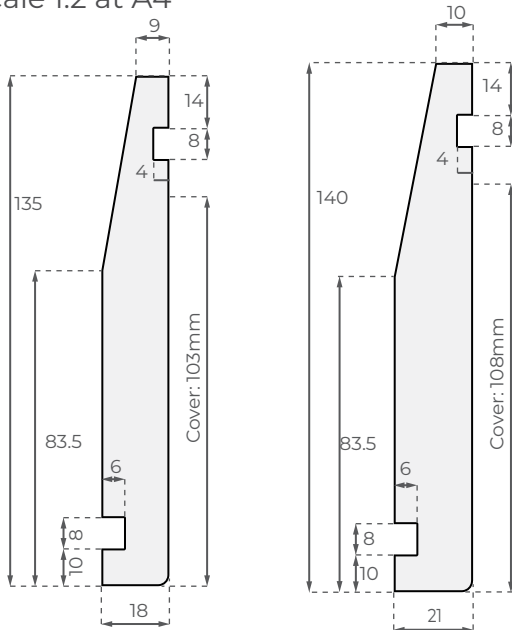


Bevelback 135x18
Dressed Face

Bevelback 140x21
Dressed Face

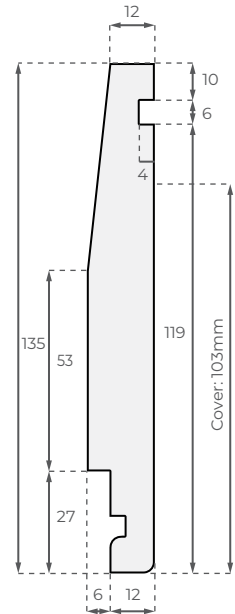


Rebated
Bevelback 135x18
Dressed Face

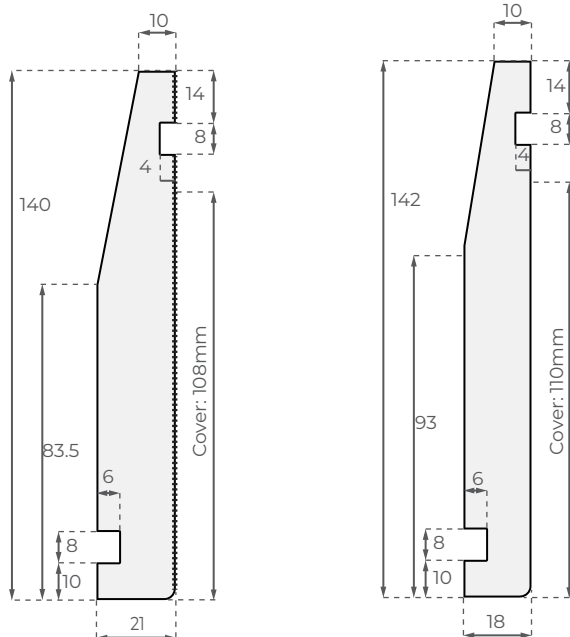


Bevelback 140x21
Band Sawn Face


Bevelback 142x18
Dressed Face

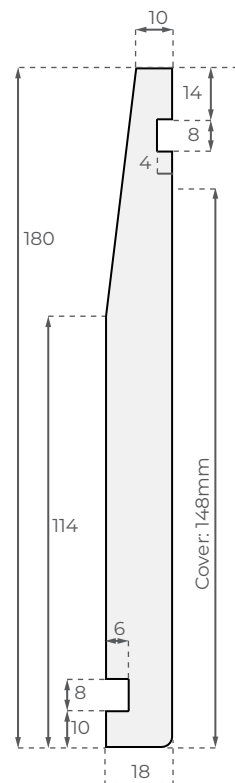


Bevelback 180x18
Dressed Face

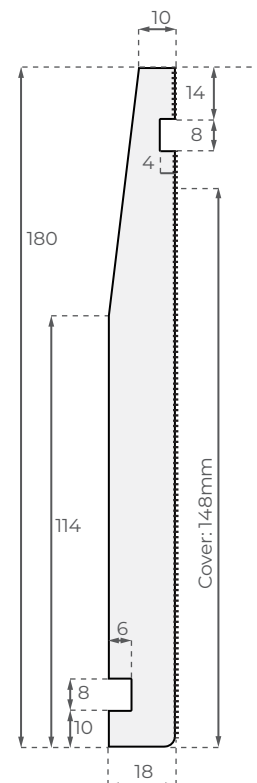


Bevelback 180x18
Band Sawn Face

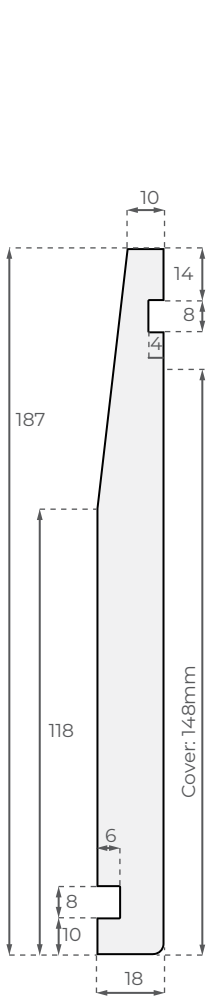


Bevelback 187x18
Dressed Face

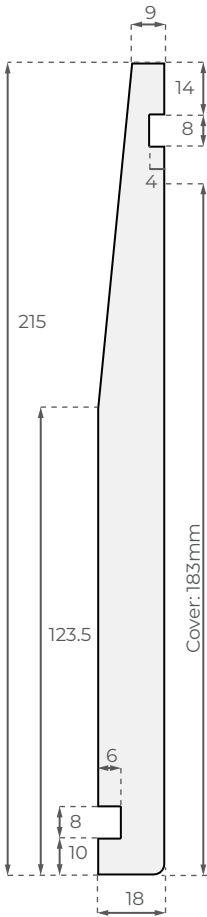

Bevelback 215x18
Dressed Face

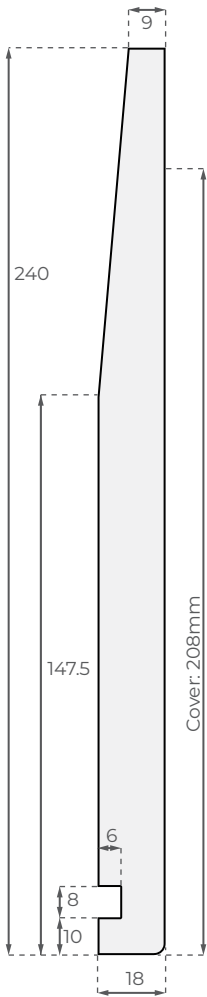

Bevelback 240x18
Dressed Face

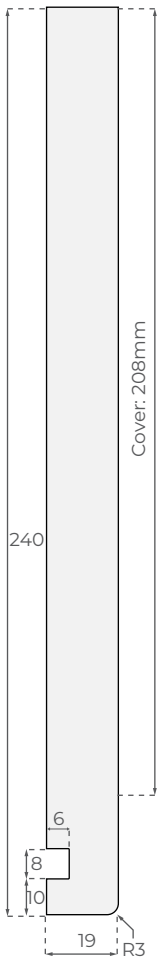

Auckland Square
240x19
Dressed Face

Weatherboard Conversion Chart

Table with 5 columns: Profile, Nominal/Ex Size (mm), Finished Size (mm), Effective Cover (mm), L/M per m². Rows include Bevelback (150x25 to 250x25), Rebated Bevelback (150x25), and Auckland (250x25).



Dressed Face



Bandsawn Face

KEEP WEATHERBOARDS & FASCIA FLAT, DRY AND PROTECTED



PROTECT



PREPARE



INSTALL



PAINT

Protect, prepare, install & paint weatherboards
as per the Instructions sticker on every length

BUILDING CODE

The SPP Bevelback Weatherboard System, if designed and installed as per this literature, will meet the following provisions of the New Zealand Building Code (NZBC):

- Clause B1 Structure: Performance B1.3.1, B1.3.2, B1.3.4 (a), (b), (c), (d) and (e) for the relevant physical conditions of B1.3.3 (a), (e), (f), (h), (j), and (q)
- Clause B2 Durability: Performance B2.3.1(b) and B2.3.2(b)
- Clause E2 External Moisture: Performance E2.3.2, E2.3.3, E2.3.5, E2.3.7(b) and (c)
- Clause F2 Hazardous Building Materials: Performance F2.3.1

SCOPE & LIMITATIONS OF USE

The SPP Bevelback Weatherboard System must be installed by a suitably qualified and experienced trade person. Where Restricted Building Work (RBW) applies, the installer shall be a Licensed Building Practitioner (LBP) or supervised by an LBP. It is the specifier's responsibility to ensure that the details in this specification are appropriate for the intended application and that additional detailing is obtained for a specific design or any areas that fall outside the scope of the SPP E2/AS1 Acceptable solution.

HEALTH & SAFETY

This product should be handled in accordance with safe work practices.

As with all wood and timber products, exposure to dust from this product may cause irritation to the eyes, respiratory system and skin via inhalation or skin contact.

Work areas should be kept clean. Sawing, sanding, and routing equipment should be fitted with dust extractors so that dust levels are kept within standards laid down by WorkSafe New Zealand. Wearing a dust mask conforming to AS/NZS 1715 and AS/NZS 1716 and eye protection conforming to AS/NZS 1337 is highly recommended. Repeated inhalation of wood dust over many years may increase the risk of cancer.

When handling SPP products or using tools use appropriate PPE including, but not limited to, eye, ear and breathing protection for yourself and others who could be affected. Offcuts and sawdust of treated and/or coated timber are to be disposed of in accordance with local council requirements. Follow other manufacturer's advice on the use, handling and disposal of other products such as coatings and adhesives.

TYPICAL FIXING DETAIL

Dressed Face

Bevelback Weatherboard

Weatherboards to be single fixed, 40mm from bottom edge with a minimum 30mm penetration into framing. Drive screw or nail 4mm into board.

Bevelback Weatherboard


WB 135x18
WB 140x21
WB 142x18
WB 180x18
WB 187x18
WB 215x18
WB 240x18

Jolt Head Nail (Hand Driven)

- 75x3.15 for direct fix
- 90x3.15 for cavity fix

ECKO T-REX17 Weatherboard Jolt Screw

- 8G x 75 on direct fix
- 8G x 90 on cavity fix

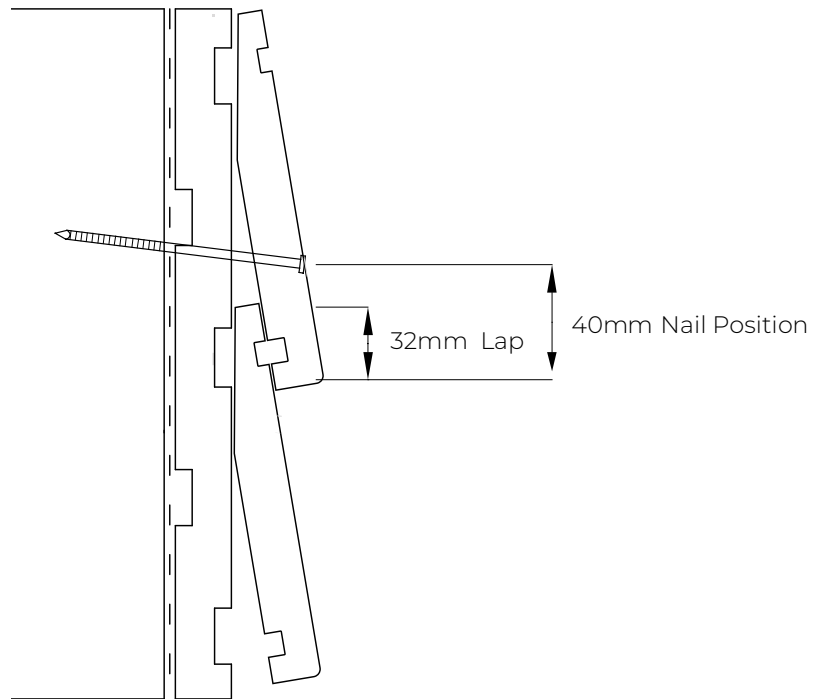

Rebated Bevelback Weatherboard

Weatherboards to be nailed angled upwards at 10 and 35mm min. penetration into stud framing.

Punched, painted, primed and filled.

Rebated Bevelback Weatherboard


RWB 135x18

Jolt Head Nail (Hand Driven)

75x3.15 for direct fix
90x3.15 for cavity fix

ECKO T-REX17 Weatherboard Jolt Screw

8G x 75 on direct fix
8G x 90 on cavity fix

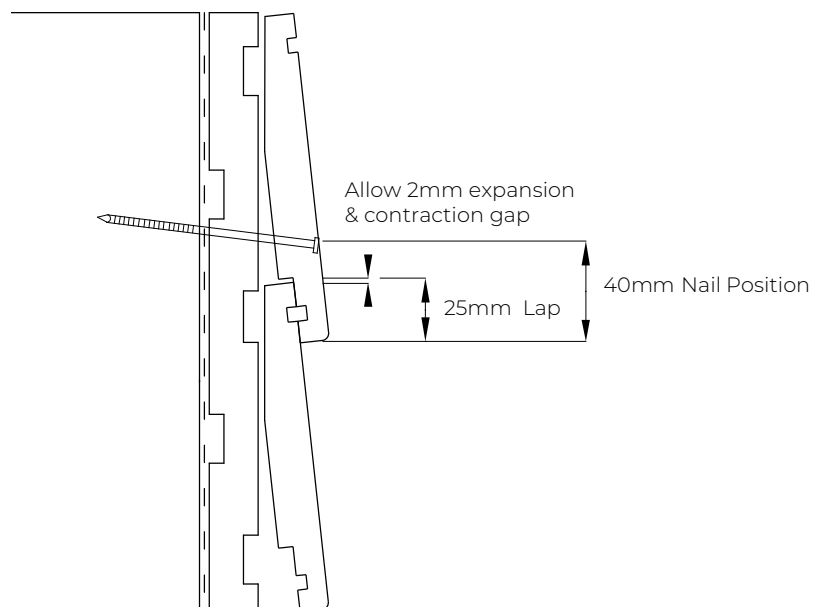

TYPICAL FIXING DETAIL

Bandsawn Face


Bevelback Weatherboard

Weatherboards to be single fixed, 10mm from side lap (40mm from edge of board), with a minimum 30mm penetration into framing timber as per E2/As1 Table 24.

Bevelback Weatherboard
WBBS 140x21
WBBS 180x18

Band Sawn Fixing (Optional)

Nail Stainless Steel T317 Rose Head with Annular Grooved 75 x 3.15mm (or equivalent annular grooved RH nail). The head of the fixing must sit flush with the face of the board.

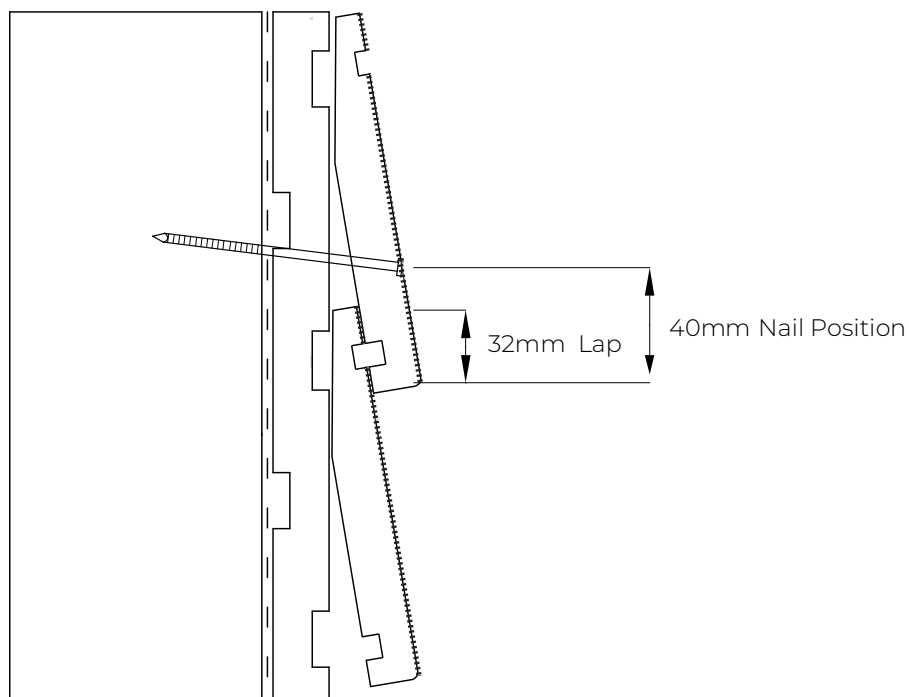

SPP DENDRO is a range of H3.2 treated, solid timber products which are supplied in either pre-primed and un-primed states. Timber products treated to H3.2 may be used in external applications and in accordance with NZ 3602:2003 sections 110 and 111.

Pre-primed DENDRO weatherboard have factory applied alkyd oil-based primer. To ensure the best protection ensure that at least one additional alkyd primer/undercoat is applied on site followed by at least two quality acrylic finishing coatings to complete weather proofing.

Note: H3.2 has a green (copper) tinge which fades over time. Product requiring staining may be affected by the H3.2 solution.

1. GRADE AND FINISH

- SPP DENDRO solid weatherboards are available in Premium Clear 2 and better.
- Sourced from a pruned log, clear on three faces as per No.1 Clears, but the reverse face is allowed some natural defects (small knot, resin pocket, or other tight defect).
- Profiles are available in both dressed finish and bandsawn finish.

2. HANDLING

SPP weatherboards and other products should be unloaded by hand, or with a Hiab forklift. Do not tip these products from a truck. Avoid scratching the face of the board, and always carry individual boards with their long sections upright to avoid excessive bending.

3. STORAGE

SPP weatherboards must remain dry at all times prior to installation. Product should be stored indoors on a flat surface, with gluts at 1m centres and at least 150mm off the ground.

Avoid direct sunlight and protect from both rain and ground moisture uptake. If storing outside use a secondary waterproof cover and groundsheet whilst allowing for good air circulation.

4. ACCLIMATISATION

At the time of installation, the cladding moisture content must be near the average moisture content which can be expected at site (typically 10% – 16% depending on the location and the time of year). Please allow approximately 3-5 days for the cladding to acclimatise before installation.

5. DIMENSIONAL CHANGE

Timber is hygroscopic (absorbs moisture from the

atmosphere) and will take up and release moisture until it reaches the equilibrium moisture content (EMC) with the surrounding environment. During this process, which is ongoing, the timber expands and contracts and thus some dimensional change will occur. This will be minimised by the application of a quality paint system.

6. WEATHERBOARD MOVEMENT

Timber weatherboards are designed to accommodate moisture, thermal and seismic movement in the board laps. **DO NOT USE ANY SEALANTS OR GLUES** between the boards or board laps, as this may inhibit the natural expansion and contraction of the cladding.

7. PAINT AND COATINGS (PRIOR TO INSTALL)

To avoid lap lines which may occur, pre-paint/stain the overlap of the profiles in the same colour as the intended topcoat finish.

Seal all cut ends with two coats of oil-based exterior primer.

8. WEATHERBOARD INSTALLATION

Weatherboard must be installed as per the current building code and BRANZ recommended good building practices.

Single fix all weatherboard profiles. Refer to E2/AS1 Table 24 for limitations. (Please note: This is profile specific refer to SPP technical drawings for nail position.)

When fixing to H3.2 CCA treated timber in either cavity or frame the use of 304/316 Stainless Steel fixings (or durable equivalents, such as silicon bronze) is a requirement of the NZ Building Code.

Ensure weatherboards, once installed, are at least 150mm from the ground and 100mm from decks and terraces as per the NZ Building Code.

Fixing with Paint Finish

When fixing to H3.2 CCA treated timber, in either cavity or frame, the use of 304/316 Stainless Steel fixings (or durable equivalents, such as silicon bronze) is a requirement of the NZ Building Code.

As per E2/AS1 Table 24. When fixing DENDRO cladding for the intention of painting a joint head fixing with a minimum framing penetration of 35mm is required.

SPP recommend the use of 304/316 Stainless Steel for all DENDRO cladding.

Punch nails/screws, putty over and spot prime immediately to avoid moisture penetration.

Fixing with Stain Finish

Galvanised fixings cannot be used with stain for exterior purposes when installed as part of a cladding system.

As per E2/AS1 Table 24. When fixing DENDRO cladding for the intention of staining a Rose Head Nail or equivalent with a minimum framing penetration of 30mm is required. The head of the fixing must sit flush with the face of the board. SPP recommend the use of 304/316 Stainless Steel fixings for all DENDRO cladding as per the NZBC standards outlined below.

NZ Building Code Standard 3602 105.4 states "Preservative treated timber may affect the durability of metal fixings and components... To satisfy the durability provisions of Clause B2 of the NZBC and those acceptable solutions set out in NZS 3604 the correct protective system or grade of stainless steel shall be used." Further, C105.4 states "Timber treatments may affect the life of fasteners... Hot dipped galvanized nails, wire dogs, bolts and sheet fixings in contact with copper chrome arsenate (CCA) treated timber in damp conditions can have an expected life of less than 15 years."

9. RESIN BLEED

Resin Bleed is when resin comes to the surface of a painted weatherboard. Whilst unsightly, the occurrence of resin bleed does not affect the durability or long-term performance of the weatherboard. The choice of a light top colour and a correctly applied quality paint system will help to minimise this occurrence.

SPP makes every effort to source non-resinous lumber and identify resin pockets during the manufacturing process, however we do not warrant against this natural feature.

10. COLOUR CHOICE

Dark colours absorb heat from the sun and may cause excessive movement, distortion and possibly resin bleed. Light colours reflect the sun's heat. Therefore, only light colours with a light reflectance value (LRV) of greater than or equal to 45% may be used. Refer paint colour charts for details.

11. FINISHING AND PAINTING

- Painting should take place as soon as possible

after installation. If boards have been exposed for longer than 4 weeks, some sanding and re-priming may be required.

- Check the moisture content of the boards before painting. Equilibrium Moisture Content (EMC) should be at 16% or less. Use a correctly calibrated moisture meter to check.
- Once installed, remove all loose material such as dirt from the surface. Spot prime any exposed timber with two coats of oil-based exterior primer. Spot prime the filled nail holes.
- Once prepared, apply a minimum of one coat of oil-based primer/under coat followed by two full coats of 100% premium acrylic low gloss house paint to the manufacturer's specification, at a rate of 12-14m²/L.
- Once applied, the two topcoats should have a combined thickness of no less than 50 microns.
- The onus is on the painter to ensure that the primed surface remains well adhered to the timber substrate and is a suitable base for the subsequent topcoats. This is particularly important where the boards have been exposed for longer than 4 weeks before top coating.
- Refer to the AS/NZ 2311 guide to painting buildings.

It is the responsibility of the homeowner to ensure that annual maintenance is carried out. In some cases, this may be required more regularly e.g. sea spray.

12. MAINTENANCE AND CARE OF PAINTED TIMBER PRODUCTS

Wash all exterior surfaces using a low pressure wash system to remove dust, dirt and other contaminants.

Do not use a high pressure washing system. If the washing does not remove stubborn areas of mould or dirt, use a soft brush or broom and an appropriate cleaning agent to remove these deposits. Check with the paint manufacturer and read the directions on the product to apply the cleaning agent.

Once the building is clean and the surfaces have been inspected for damage, wear and tear and paint coating degrade then repairs must be undertaken immediately.

If the paint surface has been damaged, then:

- Remove all damaged paint, sand back if required
- Apply primer on any bare timber
- Once the primer has dried apply two top coats of a quality top coat paint

Timber weatherboard homes should be repainted every 5-7 years as per paint manufacturer's specifications. Repainting may be required earlier depending on condition and exposure to harsher elements.

13. MAINTENANCE AND CARE OF STAINED TIMBER PRODUCTS ON H3.2 TREATED RADIATA PINE

As per GOOD PRACTICE GUIDE TIMBER CLADDING:

9.3.1 Clear finishes and stains are applied where the natural colour or grain of the timber is to be retained but a degree of weather protection is required. Clear finishes and stains will only slow but not stop the weathering process. The rate of weathering will depend on the transparency or amount of UV-blocking pigment contained in the finish. Generally, the more pigment, the less the transparency and the greater the protection.

9.3.2 Stains and clear finishes include:

- penetrating wood oil, which soaks into the timber
- penetrating stain, which soaks into the timber
- film-forming stain, which adheres to the timber surface (similar to paint)
- film-forming clear finish.

9.3.3 When selecting an oil or a stain:

- rough-sawn timber is better coated with a low-build penetrating oil or a stain
- a film-forming stain is more durable and will last longer on a smooth surface - if used on a rough-sawn surface, the timber fibres may protrude through the coating providing a potential route for water entry into the timber
- a pigmented finish provides better and longer-lasting protection to the timber than a clear finish
- a film-forming stain must only be applied to dry timber and is likely to blister if applied to timber where the moisture content is too high – check the manufacturer's instructions before application.

As with paint, do not use dark colours as these tend to absorb more heat and accelerate damage to the stain or paint.

Always follow the manufacturer's instructions including coating the stain on all sides and exposed edges on the first coat. This includes staining the ends of boards, which are susceptible to absorbing moisture. Follow up with at least three further coatings once the product is installed. The harsher

the environment, the more coatings needed.

Check the condition of the stain every few months (more if in harsh environments). If in, or near, salt spray zone, regularly wash the exterior timber with clean water to dilute the salt. Other air pollutants can be harsh on paint/stain systems including vehicle fumes, geothermal and dust/grit. Do not use high pressure systems such as water blasters as they can damage existing coatings and the timber.

Edges and corners of timber are more susceptible as less stain protection is often applied. Make sure such areas are liberally coated.

A regular program of washing the timber and re-coating is best. Re-coat before the stain breaks down (flaking or cracking) as this will expose the raw timber to the weather and the likelihood of absorbing excess moisture.

ARCHITECTURAL DRAWINGS GENERAL NOTES

This document has been specifically designed to help Architects, Designers and Builders.

A4 SITE DRAWINGS

The details in this section are full scale 1:2 at A4. You can easily read these drawings and are intended for the builder.

ARCHITECTS AND DESIGNERS RESPONSIBILITY

We have made the drawings as accurate as possible. We have specified extra flashing's in some areas that are over and above the NZ Building Code E2/AS1 External Moisture. But it is the Architects/Designers responsibility to confirm the suitability of these details for his particular projects and his client. The Architect/Designer will need to determine the "RISK MATRIX" that is project-specific, which then determines the details required. Builders that have questions about these details, will need to contact their project-specific Architect or Designer.

Legal Information

Southern Pine Products Ltd and its agent AIPdesignNZ Ltd have no reason to believe the information in the details are inaccurate. Southern Pine Products Ltd and its agent AIPdesignNZ Ltd does not warrant the accuracy, adequacy or completeness of such information and we do not undertake the information in the details updated.

Southern Pine Products Ltd and its agent AIPdesignNZ Ltd does not:

- a) Give any assurances that the details and information will be suitable for your purposes and you agree that you will not rely on the information and you will make your own independent assessments (with the aid of qualified independent advice).
- b) Accept responsibility for any loss, damage (including indirect, special or consequential loss or damage), however caused (including through negligence) that you may directly or indirectly suffer in connection with your use of or reliance on the Southern Pine Products Ltd details, including the accuracy or currency of the Southern Pine Products Ltd and AIPdesign NZ Ltd details. Any condition, warranty right or liability which would otherwise be implied excluded.

Technical Information

- a) The AutoCAD drawings have all the Xref,s embedded as blocks.
Erase the title block and Xref in your title block.
- b) These drawings have been KEY NOTED
This makes the details more readable, people then focus on the actual important notes on the drawing. This also allows for easier revisions. You only need to change one keynote reference. You will need to personalise these notes to make them specific to your project.
- c) The Drawings are coloured and have pen assignments to the colours, a PGP file will be supplied in the Zip file. All the drawing output sheets are default set to print a PDF drawing. It is recommended that you print these detail in PDF then print your paper copies from the PDF file.

- d) The AutoCAD drawings are made up of multiple details. The A1/A3 drawings also link into the A4 details drawings. These A4 drawings have special scaled down notes and blocks. (annotative Scale) But it is the exact same information.
- e) These drawings are Copyrighted to “Southern Pine Products Limited” (All Rights Asserted) and their Approved Clients. The Drawings have two methods of electronic protection. You will receive your own personal password to open the drawings.

Disclaimer


This information is supplied in good faith, and we recommend the installer and painters familiarise themselves with all relevant building and painting codes. Builders using weatherboards should purchase the BRANZ Good Practice Guide for Timber Cladding, a comprehensive detailing and installation guide.

Southern Pine Products will not be liable for any losses incurred resulting from the failure to adhere to good building and painting practices. Although every effort has been made to ensure the information in this data sheet compiles with existing building standards and recognised codes of practice, no responsibility is accepted for any errors and omissions nor for any specifications or work based on this information.

A3/A1 ARCHITECTURAL DETAILS - INDEX

Page	Sheet Number	Sheet Title
16	SPP CF20 BB10	WINDOW HEAD DETAIL
17	SPP CF20 BB11	WINDOW SILL DETAIL
18	SPP CF20 BB12	WINDOW JAMB DETAIL
19	SPP CF20 BB13	WINDOW FLASHING DETAILS
20	SPP CF20 BB20	DOOR HEAD DETAIL
21	SPP CF20 BB21	DOOR SILL DETAIL
22	SPP CF20 BB22	DOOR JAMB DETAIL
23	SPP CF20 BB23	DOOR FLASHING DETAILS
24	SPP CF20 BB30	METER BOX HEAD DETAIL
25	SPP CF20 BB31	METER BOX SILL DETAIL
26	SPP CF20 BB32	METER BOX JAMB DETAIL
27	SPP CF20 BB33	METER BOX FLASHING DETAILS
28	SPP CF20 BB40	EXTERNAL CORNER
29	SPP CF20 BB41	3D EXTERNAL CORNER
30	SPP CF20 BB42	INTERNAL CORNER
31	SPP CF20 BB43	3D INTERNAL CORNER
32	SPP CF20 BB44	WEATHERBOARD FIXING
33	SPP CF20 BB45	DRAINED INTER-STOREY JOINT
34	SPP CF20 BB50	EXTERNAL CORNER
35	SPP CF20 BB51	3D EXTERNAL CORNER
36	SPP CF20 BB52	INTERNAL CORNER
37	SPP CF20 BB53	3D INTERNAL CORNER


38	SPP CF20 BB54	PIPE PENETRATION
39	SPP CF20 BB55	3D PIPE PENETRATION
40	SPP CF20 BB60	BASE OF WALL - TIMBER
41	SPP CF20 BB61	BASE OF WALL - CONCRETE
42	SPP CF20 BB62	SOFFIT DETAIL AT WALL
43	SPP CF20 BB63	SOFFIT DETAIL AT FASCIA
44	SPP CF20 BB64	APRON FLASHING - ROOF TO WALL JUNCTION
45	SPP CF20 BB65	TYPICAL PARAPET CAPPING JOINT DETAILS
46	SPP CF20 BB70	BASE OF WALL, MEMBRANE ROOF
47	SPP CF20 BB71	DECK TO ROOF MEMBRANE - SADDLE FLASHING - STAGE ONE
48	SPP CF20 BB72	DECK TO ROOF MEMBRANE - SADDLE FLASHING - STAGE TWO
49	SPP CF20 BB73	DECK TO ROOF MEMBRANE - SADDLE FLASHING - STAGE THREE
50	SPP CF20 BB74	TYPICAL PARAPET CAPPING JOINT DETAILS
51	SPP CF20 BB75	PARAPET SECTION TO MEMBRANE ROOF
52	SPP CF20 BB90	HALF WALL SILL - WEATHERBOARD TO BRICK
53	SPP CF20 BB91	CANTILEVER FLOOR - BRICK TO WEATHERBOARD
54	SPP CF20 BB92	IN-LINE JUNCTION - WEATHERBOARD TO BRICK
55	SPP CF20 BB93	INTERNAL CORNER - WEATHERBOARD TO BRICK
56	SPP CF20 BB94	EXTERIOR JUNCTION - WEATHERBOARD TO BRICK
57	SPP CF20 BB95	FLASHINGS - WEATHERBOARD TO BRICK
58	SPP CF20 BB100	HALF WALL - SILL - PLASTER PANEL TO WEATHERBOARD
59	SPP CF20 BB101	CANTILEVER FLOOR - PLASTER PANEL TO WEATHERBOARD
60	SPP CF20 BB102	IN-LINE JUNCTION - PLASTER PANEL TO WEATHERBOARD
61	SPP CF20 BB103	INTERNAL CORNER - PLASTER PANEL TO WEATHERBOARD
62	SPP CF20 BB104	EXTERIOR JUNCTION - PLASTER PANEL TO WEATHERBOARD
63	SPP CF20 BB105	FLASHINGS - PLASTER PANEL TO WEATHERBOARD

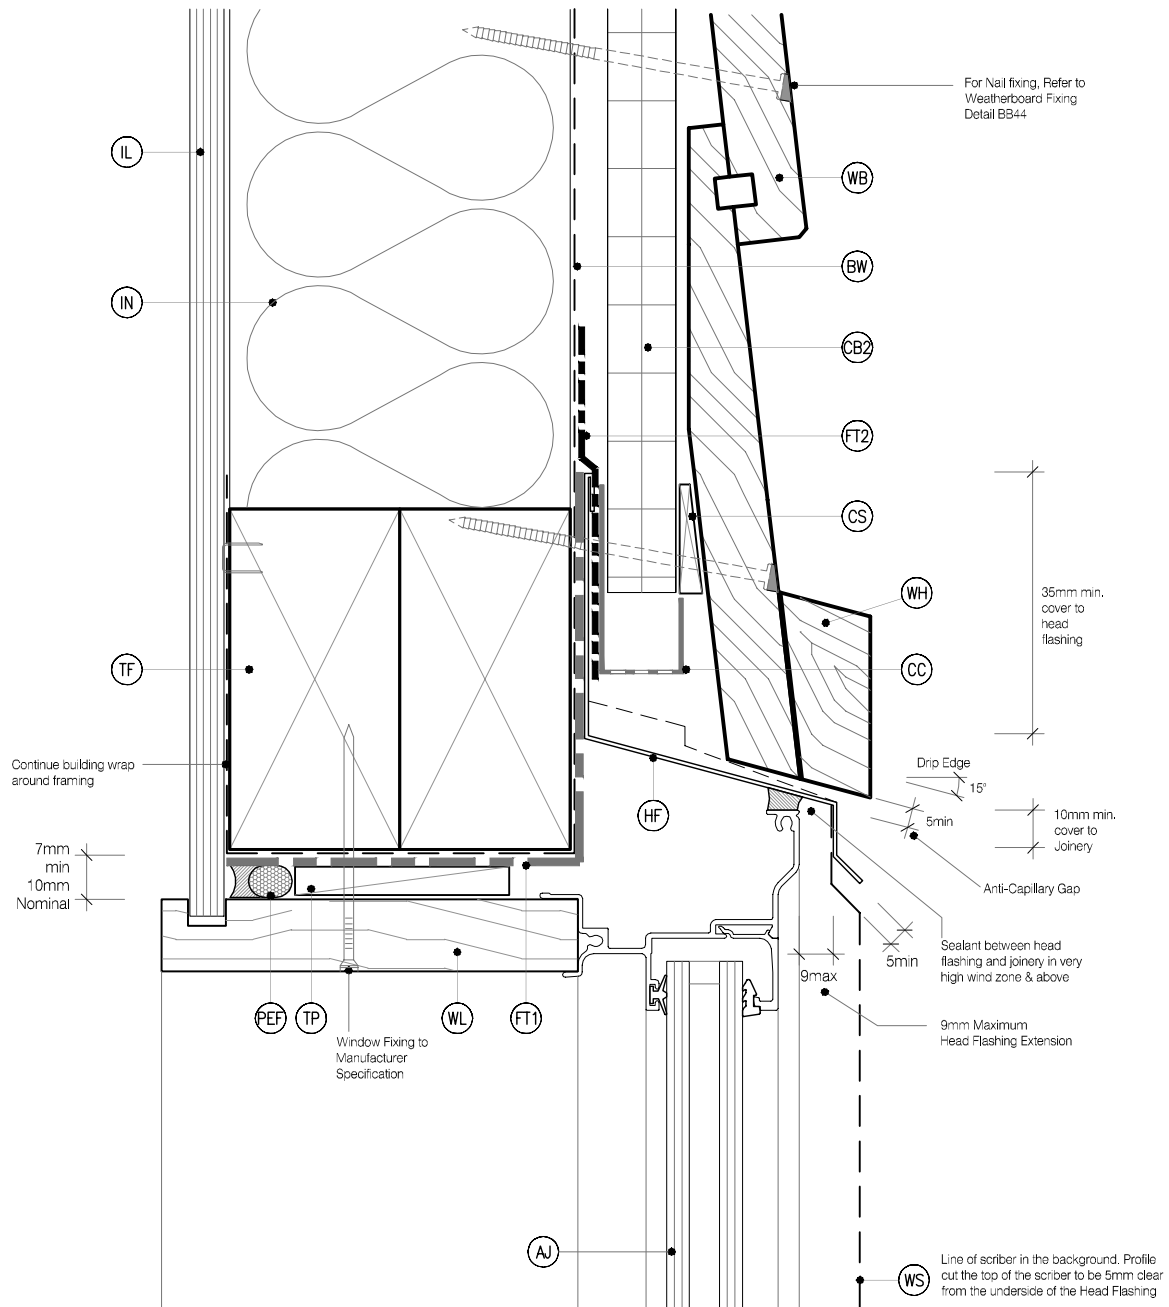

LEGEND:

- | | | |
|--|---|--|
| <p>(AJ) ALUMINIUM JOINERY: Selected double glazed aluminium joinery. To E2/AS1 9.1.10</p> <p>(BW) BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Ridgid Underlay required (9.1.7.2 E2/AS1)</p> <p>(CB2) CAVITY BATTEN, VERTICAL: 20mm x 45mm H3.1. To form a 20mm cavity.</p> <p>(CB3) CAVITY BATTEN, VERTICAL - STRUCTURALLY FIXED : 45mm x 45mm SPP Radiata Pine, H3.2 70mm x 45mm SPP Radiata Pine, H3.2 To form a 45mm cavity</p> <p>(CS) CANT STRIP: Southern Pine H3.1 Cant Strip 25mm x 9 mm</p> <p>(SS) SILL SCRIBER: Southern Pine H3.2, Horizontal batten under window as necessary to suit profile, sealant to back of sill scribe</p> | <p>(CC) CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm Min drip edge to cladding</p> <p>(FT1) FLASHING TAPE: Flashing tape over wrap 70mm (50 min) turn-down required in corners only. Refer to Fig. 72 of NZBC E2/AS1</p> <p>(FT2) FLEXIBLE FLASHING TAPE: Flexible flashing tape lapped over aluminium head flashing or 2nd layer of Building Wrap, taped joint to top of timber frame</p> <p>(HF) HEAD FLASHING: Aluminium head flashing with minimum 15 degree fall, optional hemmed edges as per table 7 E2/AS1</p> <p>(IL) INTERNAL LINING: Selected Internal Lining</p> <p>(PEF) PEF ROD BACKING: Foam backing rod with sealant to cavity in Window perimeter that forms a waterproof air-seal. (Sealant 2:1 Ratio)</p> <p>(TP) TIMBER PACKER: Tan H3.2 Treated Packer</p> | <p>(TF) TIMBER FRAME: H1.2 min treated timber framing</p> <p>(WB) WEATHER BOARD: Southern Pine Bevel Back Weatherboard. Profile to NZS 3617</p> <p>(IN) INSULATION: Selected Insulation</p> <p>(WH) WEATHERHEAD: (OPTIONAL) Southern Pine H3.2, Horizontal batten above window as necessary to suit profile, shaped to shed water, sealant to back of head scribe</p> <p>(WL) WINDOW LINER: As Specified</p> <p>(WS) WINDOW SCRIBER: Southern Pine H3.1, profile cut to fit weatherboard, sealant to back of scribe and 75 x 3.15mm 316 Stainless Steel nail in 3mm predrilled hole. 40x18 or 60x18 depending on weatherboard size</p> <p>(WZ) WANZ SUPPORT: Provide window support as required by joinery manufacturer</p> |
|--|---|--|


NOTE : Where 75x3.15 jolt head nails are referenced, these may be substituted for 75mm jolt head weatherboard screws

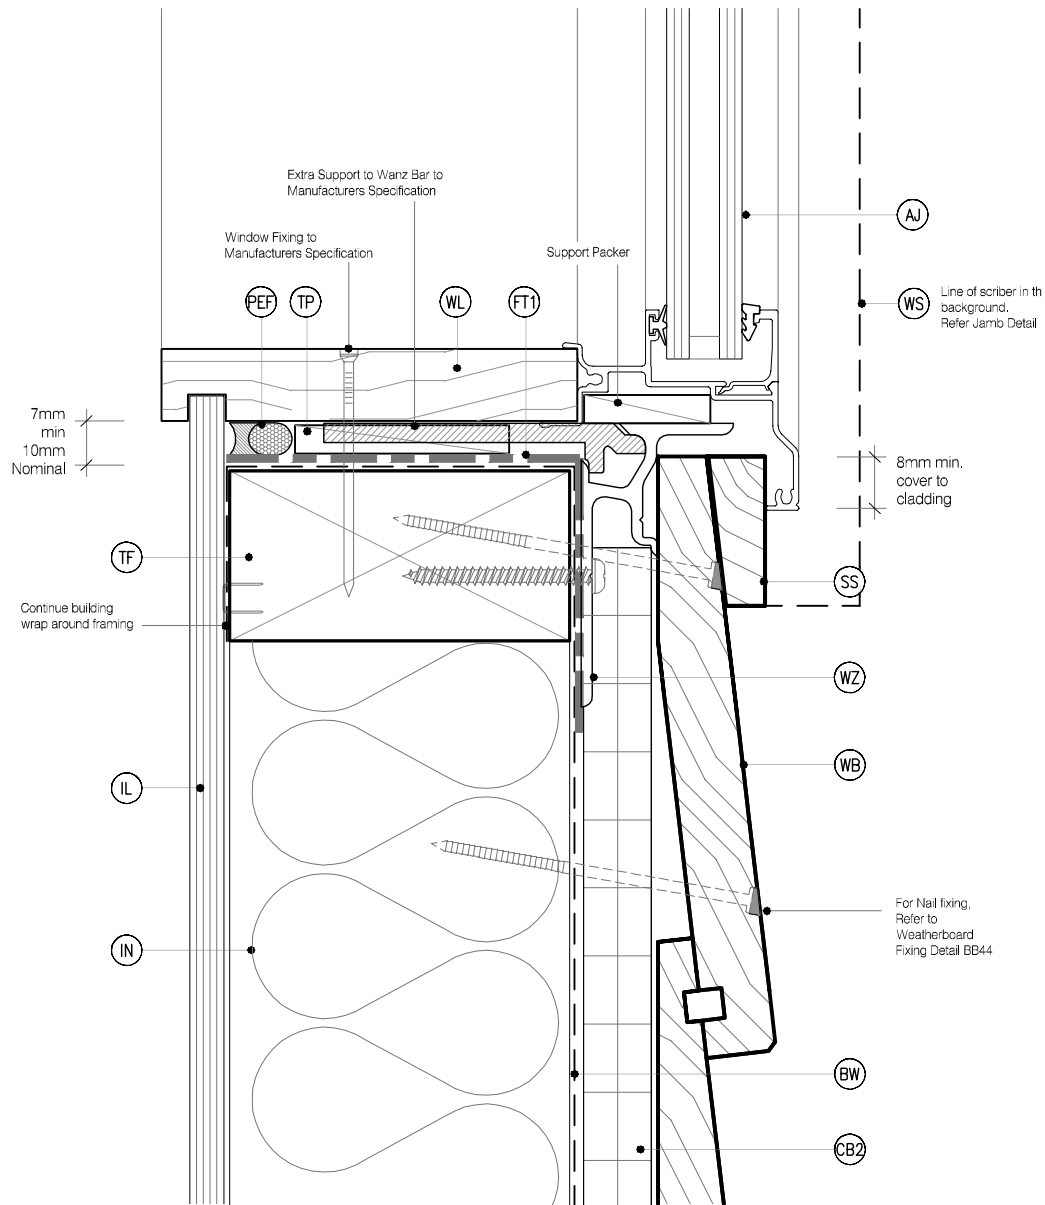

LEGEND:

- | | | |
|--|---|--|
| <p>(AJ) ALUMINIUM JOINERY: Selected double glazed aluminium joinery. To E2/AS1 9.1.10</p> <p>(BW) BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)</p> <p>(CB2) CAVITY BATTEN, VERTICAL: 20mm x 45mm H3.1. To form a 20mm cavity.</p> <p>(CB3) CAVITY BATTEN, VERTICAL - STRUCTURALLY FIXED : 45mm x 45mm SPP Radiata Pine, H3.2 70mm x 45mm SPP Radiata Pine, H3.2 To form a 45mm cavity</p> <p>(CS) CANT STRIP: Southern Pine H3.1 Cant Strip 25mm x 9 mm</p> <p>(SS) SILL SCRIBER: Southern Pine H3.2, Horizontal batten under window as necessary to suit profile, sealant to back of sill scriber</p> | <p>(CC) CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm Min drip edge to cladding</p> <p>(FT1) FLASHING TAPE: Flashing tape over wrap 70mm (50 min) turn-down required in corners only. Refer to Fig. 72 of NZBC E2/AS1</p> <p>(FT2) FLEXIBLE FLASHING TAPE: Flexible flashing tape lapped over aluminium head flashing or 2nd layer of Building Wrap, taped joint to top of timber frame</p> <p>(HF) HEAD FLASHING: Aluminium head flashing with minimum 15 degree fall, optional hemmed edges as per table 7 E2/AS1</p> <p>(IL) INTERNAL LINING: Selected Internal Lining</p> <p>(PEF) PEF ROD BACKING: Foam backing rod with sealant to cavity in window perimeter that forms a waterproof air-seal. (Sealant 2:1 Ratio)</p> <p>(TP) TIMBER PACKER: Tan H3.2 Treated Packer</p> | <p>(TF) TIMBER FRAME: H1.2 min treated timber framing</p> <p>(WB) WEATHER BOARD: Southern Pine Bevel Back Weatherboard. Profile to NZS 3617</p> <p>(IN) INSULATION: Selected Insulation</p> <p>(WH) WEATHERHEAD: (OPTIONAL) Southern Pine H3.2, Horizontal batten above window as necessary to suit profile, shaped to shed water, sealant to back of head scriber</p> <p>(WL) WINDOW LINER: As Specified</p> <p>(WS) WINDOW SCRIBER: Southern Pine H3.1, profile cut to fit weatherboard, sealant to back of scriber and 75 x 3.15mm 316 Stainless Steel nail in 3mm predrilled hole. 40x18 or 60x18 depending on weatherboard size</p> <p>(WZ) WANZ SUPPORT: Provide window support as required by joinery manufacturer</p> |
|--|---|--|


NOTE : Where 75x3.15 jolt head nails are referenced, these may be substituted for 75mm jolt head weatherboard screws

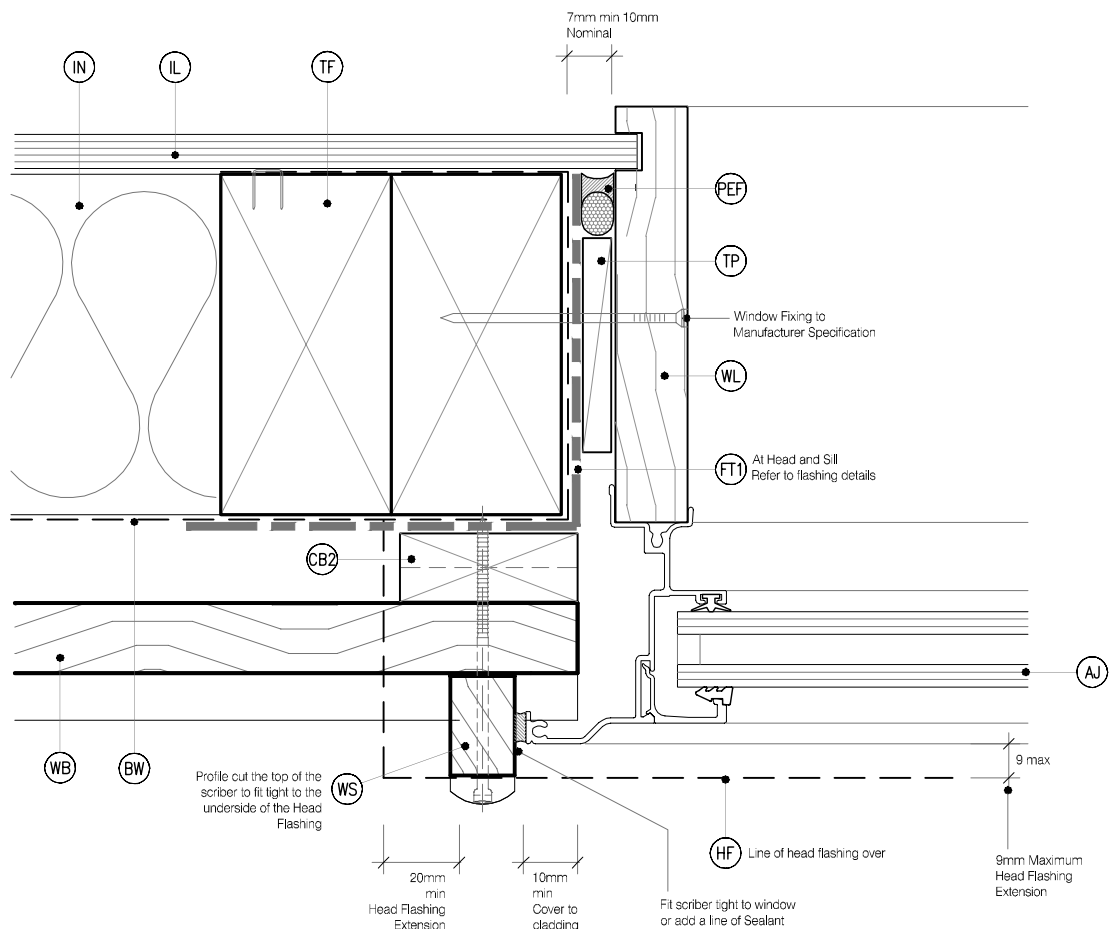


LEGEND:

(AJ) ALUMINIUM JOINERY: Selected double glazed aluminium joinery. To E2/AS1 9.1.10	(CC) CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm Min drip edge to cladding	(TF) TIMBER FRAME: H1.2 min treated timber framing
(BW) BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)	(FT1) FLASHING TAPE: Flashing tape over wrap 70mm (50 min) turn-down required in corners only. Refer to Fig. 72 of NZBC E2/AS1	(WB) WEATHER BOARD: Southern Pine Bevel Back Weatherboard. Profile to NZS 3617
(CB2) CAVITY BATTEN, VERTICAL: 20mm x 45mm H3.1. To form a 20mm cavity.	(FT2) FLEXIBLE FLASHING TAPE: Flexible flashing tape lapped over aluminium head flashing or 2nd layer of Building Wrap, taped joint to top of timber frame	(IN) INSULATION: Selected Insulation
(CB3) CAVITY BATTEN, VERTICAL - STRUCTURALLY FIXED: 45mm x 45mm SPP Radiata Pine, H3.2 70mm x 45mm SPP Radiata Pine, H3.2 To form a 45mm cavity	(HF) HEAD FLASHING: Aluminium head flashing with minimum 15 degree fall, optional hemmed edges as per table 7 E2/AS1	(WH) WEATHERHEAD: (OPTIONAL) Southern Pine H3.2, Horizontal batten above window as necessary to suit profile, shaped to shed water, sealant to back of head scriber
(CS) CANT STRIP: Southern Pine H3.1 Cant Strip 25mm x 9 mm	(IL) INTERNAL LINING: Selected Internal Lining	(WL) WINDOW LINER: As Specified
(SS) SILL SCRIBER: Southern Pine H3.2, Horizontal batten under window as necessary to suit profile, sealant to back of sill scriber	(PEF) PEF ROD BACKING: Foam backing rod with sealant to cavity in Window perimeter that forms a waterproof air-seal. (Sealant 2:1 Ratio)	(WS) WINDOW SCRIBER: Southern Pine H3.1, profile cut to fit weatherboard, sealant to back of scriber and 75 x 3.15mm 316 Stainless Steel nail in 3mm predrilled hole. 40x18 or 60x18 depending on weatherboard size
	(TP) TIMBER PACKER: Tan H3.2 Treated Packer	(WZ) WANZ SUPPORT: Provide window support as required by joinery manufacturer

NOTE : Where 75x3.15 jolt head nails are referenced, these may be substituted for 75mm jolt head weatherboard screws

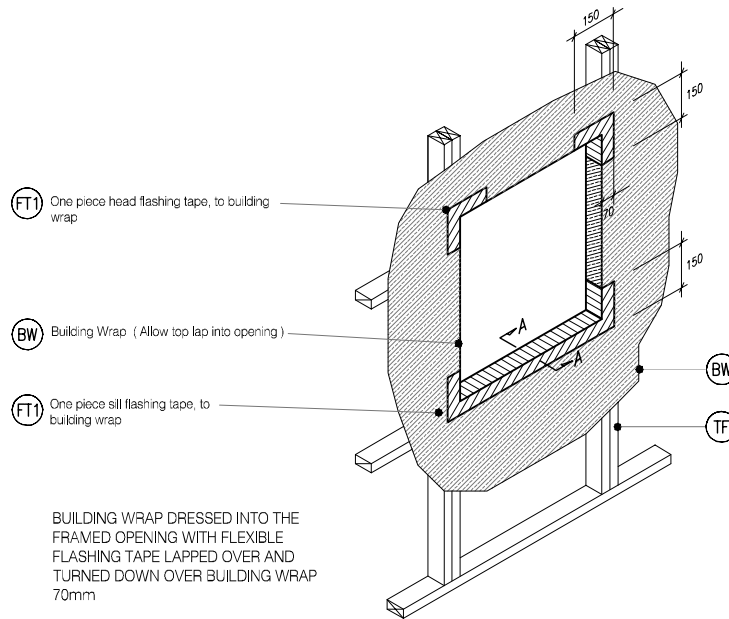

W4 TYPICAL WINDOW OPENING (FLASHING TAPE)
BB13 SCALE : N.T.S

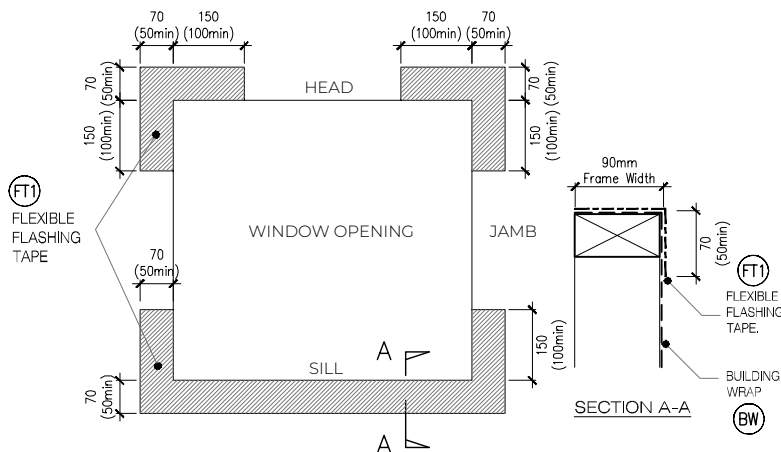


W5 FLEXIBLE BUILDING WRAP AT OPENING
BB13 SCALE : 1 / 5 @ A1, 1 / 10 @ A3

1. DENDRO® is Southern Pine's premium product range of H3.2 treated, solid, clear weatherboards. Manufactured from, high quality, pruned NZ Radiata Pine. Product warranty, 25 years if used in accordance with the Installation & Maintenance Guide.
2. All Southern Pine Weatherboard profiles have been machined to be compliant with NZS 3617 and BRANZ BU411
3. The Southern Pine Weatherboard System, if designed and installed as per the Installation & Maintenance Guide, will meet

the following provisions of the New Zealand Building Code (NZBC):


- Clause B1 Structure: Performance B1.3.1, B1.3.2, B1.3.4 (a), (b), (c), (d) and (e) for the
- Clause B2 Durability: Performance B2.3.1(b) and B2.3.2(b)
- Clause E2 External Moisture: Performance E2.3.2, E2.3.3, E2.3.5, E2.3.7(b) and (c)
- Clause F2 Hazardous Building Materials: Performance F2.3.1

4. This Weatherboard System must be installed by a qualified trade person. Restricted Building Work (RBW) requires a Licensed Building Practitioner (LBP) or supervised by an LBP. It is the specifier's responsibility to ensure that the details are appropriate for the intended application and that additional detailing is obtained for a specific design or any areas that fall outside the scope of the Southern Pine Products & E2/AS1 Acceptable solution.

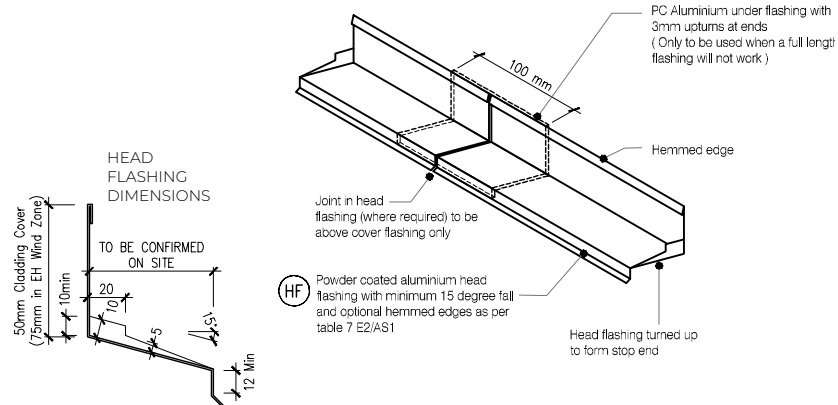

ONE PIECE PC ALUMINIUM HEAD FLASHING 15° SLOPE WITH 10mm min COVER TO JOINERY EXTEND 30mm min EITHER SIDE OF JOINERY WITH STOP ENDS


W6 TYPICAL HEAD & FLASHING JOINT
BB13 SCALE : 1 / 2 @ A1, 1 / 4 @ A3

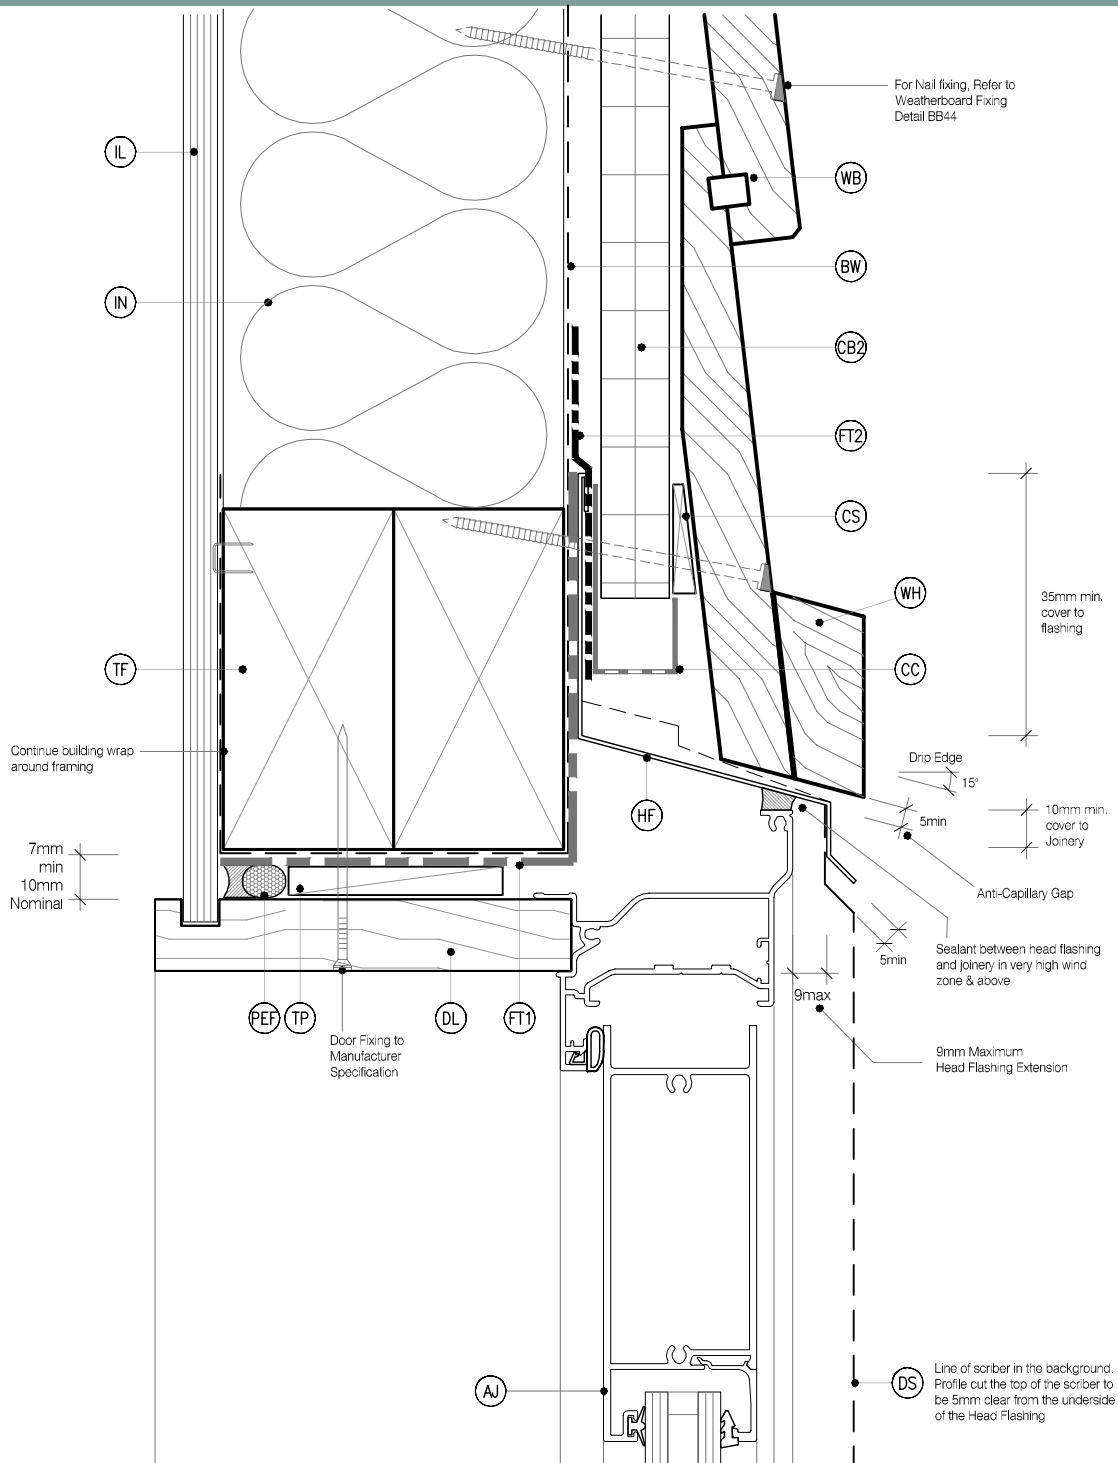

LEGEND:

- | | | |
|--|---|---|
| (AJ) ALUMINIUM JOINERY: Selected double glazed aluminium joinery. To E2/AS1 9.1.10 | (CC) CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm Min drip edge to cladding | (TF) TIMBER FRAME: H1.2 min treated timber framing |
| (BW) BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1) | (FT1) FLASHING TAPE: Flashing tape over wrap 70mm (50 min) turn-down required in corners only. Refer to Fig. 72 of NZBC E2/AS1 | (WB) WEATHER BOARD: Southern Pine Bevel Back Weatherboard. Profile to NZS 3617 |
| (CB2) CAVITY BATTEN, VERTICAL: 20mm x 45mm H3.1. To form a 20mm cavity. | (FT2) FLEXIBLE FLASHING TAPE: Flexible flashing tape lapped over aluminium head flashing or 2nd layer of Building Wrap, taped joint to top of timber frame | (IN) INSULATION: Selected Insulation |
| (CB3) CAVITY BATTEN, VERTICAL - STRUCTURALLY FIXED: 45mm x 45mm SPP Radiata Pine, H3.2 70mm x 45mm SPP Radiata Pine, H3.2 To form a 45mm cavity | (HF) HEAD FLASHING: Aluminium head flashing with minimum 15 degree fall, optional hemmed edges as per table 7 E2/AS1 | (WH) WEATHERHEAD: (OPTIONAL) Southern Pine H3.2, Horizontal batten above window as necessary to suit profile, shaped to shed water, sealant to back of head scribe |
| (CS) CANT STRIP: Southern Pine H3.1 Cant Strip 25mm x 9 mm | (IL) INTERNAL LINING: Selected Internal Lining | (WL) WINDOW LINER: As Specified |
| (SS) SILL SCRIBER: Southern Pine H3.2, Horizontal batten under window as necessary to suit profile, sealant to back of sill scribe | (PEF) PEF ROD BACKING: Foam backing rod with sealant to cavity in Window perimeter that forms a waterproof air-seal. (Sealant 2:1 Ratio) | (WS) WINDOW SCRIBER: Southern Pine H3.1, profile cut to fit weatherboard, sealant to back of scribe and 75 x 3.15mm 316 Stainless Steel nail in 3mm predrilled hole, 40x18 or 60x18 depending on weatherboard size |
| | (TP) TIMBER PACKER: Tan H3.2 Treated Packer | (WZ) WANZ SUPPORT: Provide window support as required by joinery manufacturer |


NOTE : Where 75x3.15 jolt head nails are referenced, these may be substituted for 75mm jolt head weatherboard screws

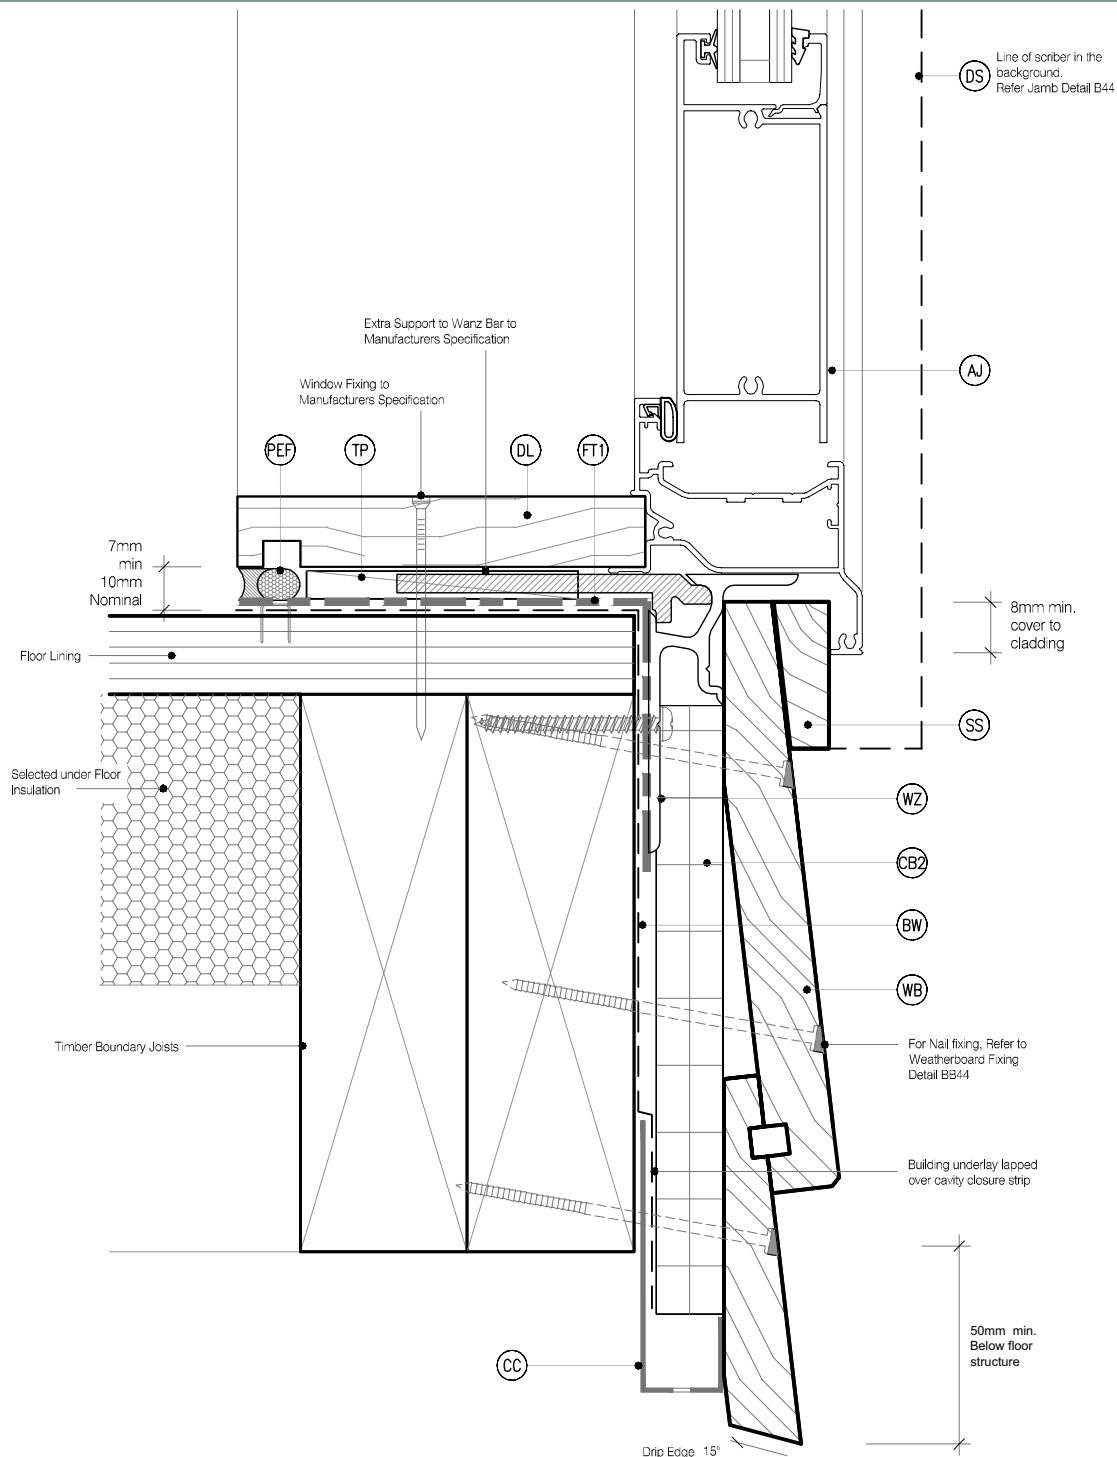

LEGEND:

- | | | |
|--|---|--|
| <p>(AJ) ALUMINIUM JOINERY: Selected double glazed aluminium joinery. To E2/AS1 9.1.10</p> <p>(BW) BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)</p> <p>(CB2) CAVITY BATTEN, VERTICAL: 20mm x 45mm H3.1. To form a 20mm cavity.</p> <p>(CB3) CAVITY BATTEN, VERTICAL - STRUCTURALLY FIXED : 45mm x 45mm SPP Radiata Pine, H3.2 70mm x 45mm SPP Radiata Pine, H3.2 To form a 45mm cavity</p> <p>(CS) CANT STRIP: Southern Pine H3.1 Cant Strip 25mm x 9 mm</p> <p>(SS) SILL SCRAPER: Southern Pine H3.2, Horizontal batten under window as necessary to suit profile, sealant to back of sill scraper</p> | <p>(CC) CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm Min drip edge to cladding</p> <p>(FT1) FLASHING TAPE: Flashing tape over wrap 70mm (50 min) turn-down required in corners only. Refer to Fig. 72 of NZBC E2/AS1</p> <p>(FT2) FLEXIBLE FLASHING TAPE: Flexible flashing tape lapped over aluminium head flashing or 2nd layer of Building Wrap, taped joint to top of timber frame</p> <p>(HF) HEAD FLASHING: Aluminium head flashing with minimum 15 degree fall, optional hemmed edges as per table 7 E2/AS1</p> <p>(IL) INTERNAL LINING: Selected Internal Lining</p> <p>(PEF) PEF ROD BACKING: Foam backing rod with sealant to cavity in Window perimeter that forms a waterproof air-seal. (Sealant 2:1 Ratio)</p> <p>(TP) TIMBER PACKER: Tan H3.2 Treated Packer</p> | <p>(TF) TIMBER FRAME: H1.2 min treated timber framing</p> <p>(WB) WEATHER BOARD: Southern Pine Bevel Back Weatherboard. Profile to NZS 3617</p> <p>(IN) INSULATION: Selected Insulation</p> <p>(WH) WEATHERHEAD: (OPTIONAL) Southern Pine H3.2, Horizontal batten above window as necessary to suit profile, shaped to shed water, sealant to back of head scribe</p> <p>(WL) WINDOW LINER: As Specified</p> <p>(WS) WINDOW SCRAPER: Southern Pine H3.1, profile cut to fit weatherboard, sealant to back of scribe and 75 x 3.15mm 316 Stainless Steel nail in 3mm predrilled hole. 40x18 or 60x18 depending on weatherboard size</p> <p>(WZ) WANZ SUPPORT: Provide window support as required by joinery manufacturer</p> |
|--|---|--|



NOTE : Where 75x3.15 jolt head nails are referenced, these may be substituted for 75mm jolt head weatherboard screws

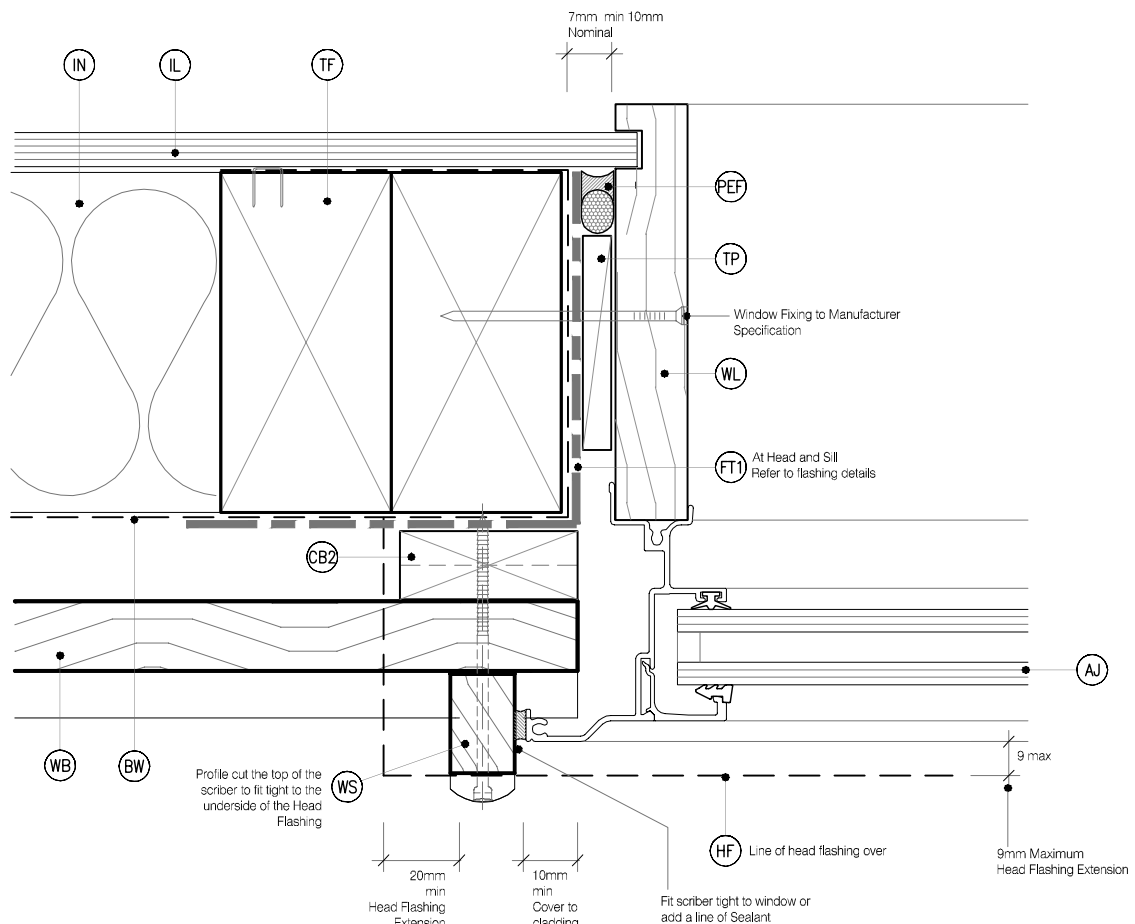

LEGEND:

- | | | |
|--|---|--|
| <p>(AJ) ALUMINIUM JOINERY: Selected double glazed aluminium joinery. To E2/AS1 9.1.10</p> <p>(BW) BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)</p> <p>(CB2) CAVITY BATTEN, VERTICAL: 20mm x 45mm H3.1. To form a 20mm cavity.</p> <p>(CB3) CAVITY BATTEN, VERTICAL - STRUCTURALLY FIXED: 45mm x 45mm SPP Radiata Pine, H3.2 70mm x 45mm SPP Radiata Pine, H3.2 To form a 45mm cavity</p> <p>(CS) CANT STRIP: Southern Pine H3.1 Cant Strip 25mm x 9 mm</p> <p>(SS) SILL SCRIBER: Southern Pine H3.2, Horizontal batten under window as necessary to suit profile, sealant to back of sill scribe</p> | <p>(CC) CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm Min drip edge to cladding</p> <p>(FT1) FLASHING TAPE: Flashing tape over wrap 70mm (50 min) turn-down required in corners only. Refer to Fig. 72 of NZBC E2/AS1</p> <p>(FT2) FLEXIBLE FLASHING TAPE: Flexible flashing tape lapped over aluminium head flashing or 2nd layer of Building Wrap, taped joint to top of timber frame</p> <p>(HF) HEAD FLASHING: Aluminium head flashing with minimum 15 degree fall, optional hemmed edges as per table 7 E2/AS1</p> <p>(IL) INTERNAL LINING: Selected Internal Lining</p> <p>(PEF) PEF ROD BACKING: Foam backing rod with sealant to cavity in Window perimeter that forms a waterproof air-seal. (Sealant 2:1 Ratio)</p> <p>(TP) TIMBER PACKER: Tan H3.2 Treated Packer</p> | <p>(TF) TIMBER FRAME: H1.2 min treated timber framing</p> <p>(WB) WEATHER BOARD: Southern Pine Bevel Back Weatherboard. Profile to NZS 3617</p> <p>(IN) INSULATION: Selected Insulation</p> <p>(WH) WEATHERHEAD: (OPTIONAL) Southern Pine H3.2, Horizontal batten above window as necessary to suit profile, shaped to shed water, sealant to back of head scribe</p> <p>(WL) WINDOW LINER: As Specified</p> <p>(WS) WINDOW SCRIBER: Southern Pine H3.1, profile cut to fit weatherboard, sealant to back of scribe and 75 x 3.15mm 316 Stainless Steel nail in 3mm predrilled hole. 40x18 or 60x18 depending on weatherboard size</p> <p>(WZ) WANZ SUPPORT: Provide window support as required by joinery manufacturer</p> |
|--|---|--|

NOTE : Where 75x3.15 jolt head nails are referenced, these may be substituted for 75mm jolt head weatherboard screws

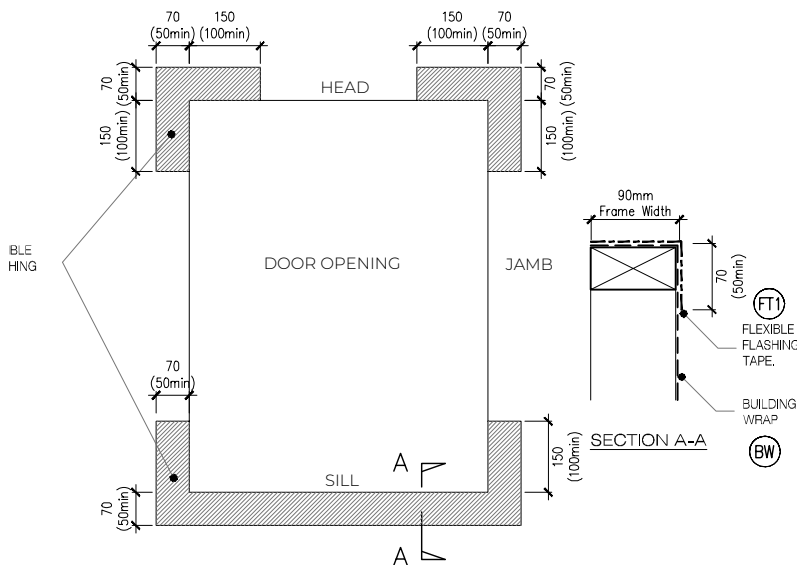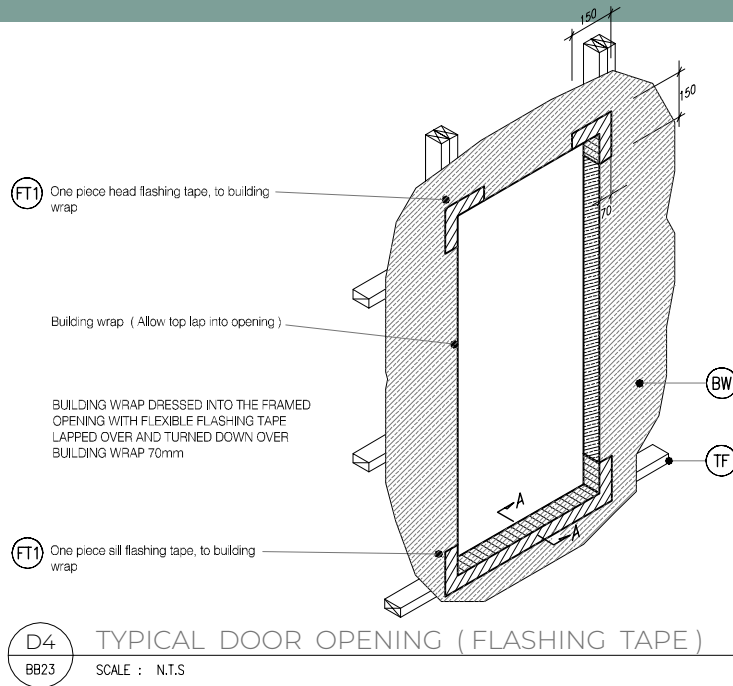


1. DENDRO® is Southern Pine's premium product range of H3.2 treated, solid, clear weatherboards. Manufactured from, high quality, pruned NZ Radiata Pine. Product warranty, 25 years if used in accordance with the Installation & Maintenance Guide.
2. All Southern Pine Weatherboard profiles have been machined to be compliant with NZS 3617 and BRANZ BU411
3. The Southern Pine Weatherboard System, if designed and installed as per the Installation & Maintenance Guide, will meet


the following provisions of the New Zealand Building Code (NZBC):

- Clause B1 Structure: Performance B1.3.1, B1.3.2, B1.3.4 (a), (b), (c), (d) and (e) for the
- Clause B2 Durability: Performance B2.3.1(b) and B2.3.2(b)
- Clause E2 External Moisture: Performance E2.3.2, E2.3.3, E2.3.5, E2.3.7(b) and (c)
- Clause F2 Hazardous Building Materials: Performance F2.3.1

4. This Weatherboard System must be installed by a qualified trade person. Restricted Building Work (RBW) requires a Licensed Building Practitioner (LBP) or supervised by an LBP. It is the specifier's responsibility to ensure that the details are appropriate for the intended application and that additional detailing is obtained for a specific design or any areas that fall outside the scope of the Southern Pine Products & E2/AS1 Acceptable solution.

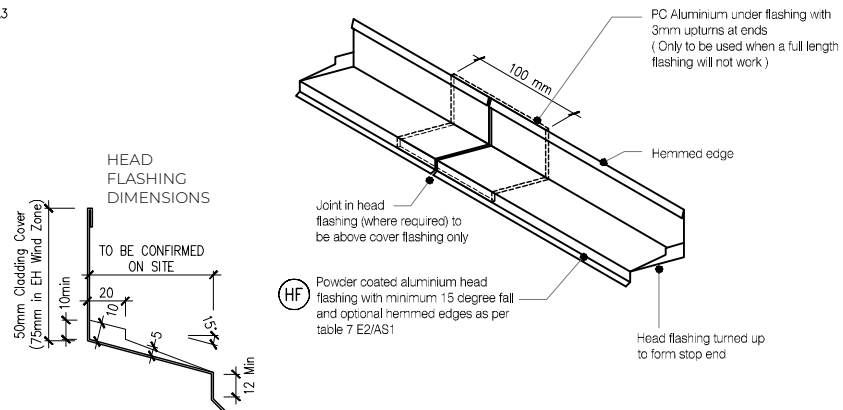


ONE PIECE PC ALUMINIUM HEAD FLASHING 15° SLOPE WITH 10mm min COVER TO JOINERY EXTEND 30mm min EITHER SIDE OF JOINERY WITH STOP ENDS

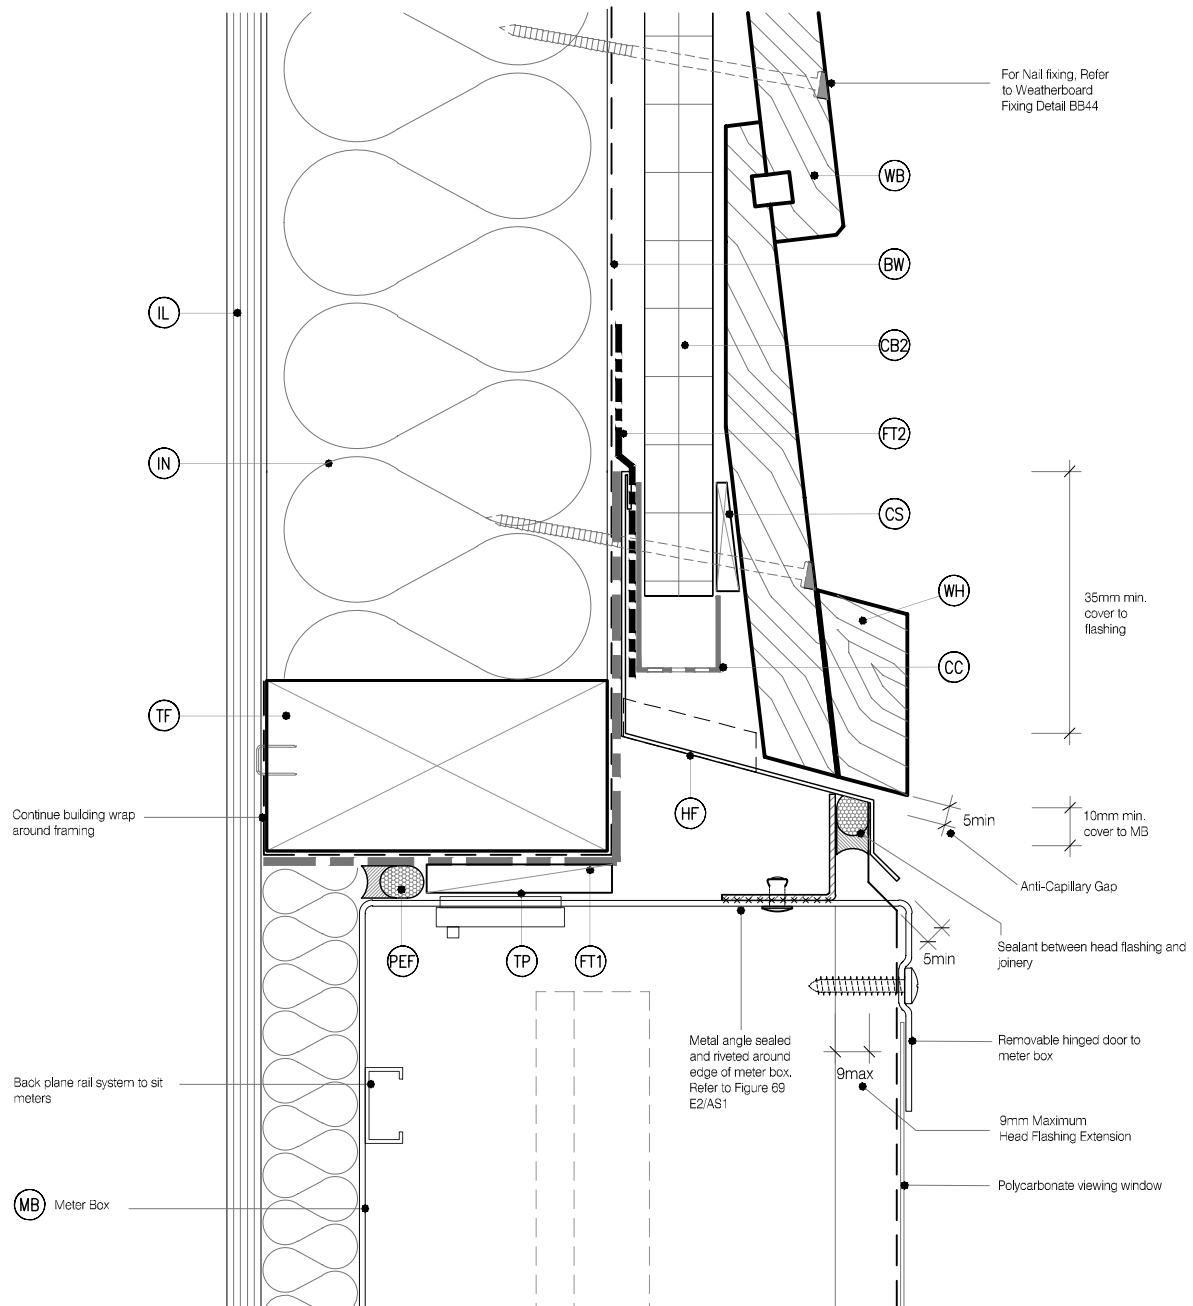

LEGEND:

- | | | |
|---|---|---|
| <p>(MB) METER BOX: Electrical meter box, with removable hinged door and polycarbonate viewing window</p> <p>(WB) BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)</p> <p>(CB2) CAVITY BATTEN, VERTICAL: 20mm x 45mm H3.1. To form a 20mm cavity.</p> <p>(CB3) CAVITY BATTEN, VERTICAL - STRUCTURALLY FIXED : 45mm x 45mm SPP Radiata Pine, H3.2 70mm x 45mm SPP Radiata Pine, H3.2 To form a 45mm cavity</p> <p>(CS) CANT STRIP: Southern Pine H3.1 Cant Strip 25mm x 9 mm</p> <p>(SS) SILL SCRIBER: Southern Pine H3.2, Horizontal batten under window as necessary to suit profile, sealant to back of sill scriber</p> | <p>(CC) CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm Min drip edge to cladding</p> <p>(FT1) FLASHING TAPE: Flashing tape over wrap 70mm (50 min) turn-down required in corners only. Refer to Fig. 72 of NZBC E2/AS1</p> <p>(FT2) FLEXIBLE FLASHING TAPE: Flexible flashing tape lapped over aluminium head flashing or 2nd layer of Building Wrap, taped joint to top of timber frame</p> <p>(HF) HEAD FLASHING: Aluminium head flashing with minimum 15 degree fall, optional hemmed edges as per table 7 E2/AS1</p> <p>(IL) INTERNAL LINING: Selected Internal Lining</p> <p>(PEF) PEF ROD BACKING: Foam backing rod with sealant to cavity in Window perimeter that forms a waterproof air-seal. (Sealant 2:1 Ratio)</p> <p>(TP) TIMBER PACKER: Tan H3.2 Treated Packer</p> | <p>(TF) TIMBER FRAME: H1.2 min treated timber framing</p> <p>(IN) INSULATION: Selected Insulation</p> <p>(WB) WEATHER BOARD: Southern Pine Bevel Back Weatherboard. Profile to NZS 3617</p> <p>(WL) WINDOW LINER: As Specified</p> <p>(WH) WEATHERHEAD: (OPTIONAL) Southern Pine, Horizontal batten above meter box as necessary to suit profile, shaped to shed water, sealant to back of head scriber</p> <p>(MS) METER BOX SCRIBER: Southern Pine H3.1, profile cut to fit weatherboard, sealant to back of scriber and 75 x 3.15mm 316 Stainless Steel nail in 3mm predrilled hole. 40x18 or 60x18 depending on weatherboard size</p> |
|---|---|---|


NOTE : Where 75x3.15 jolt head nails are referenced, these may be substituted for 75mm jolt head weatherboard screws

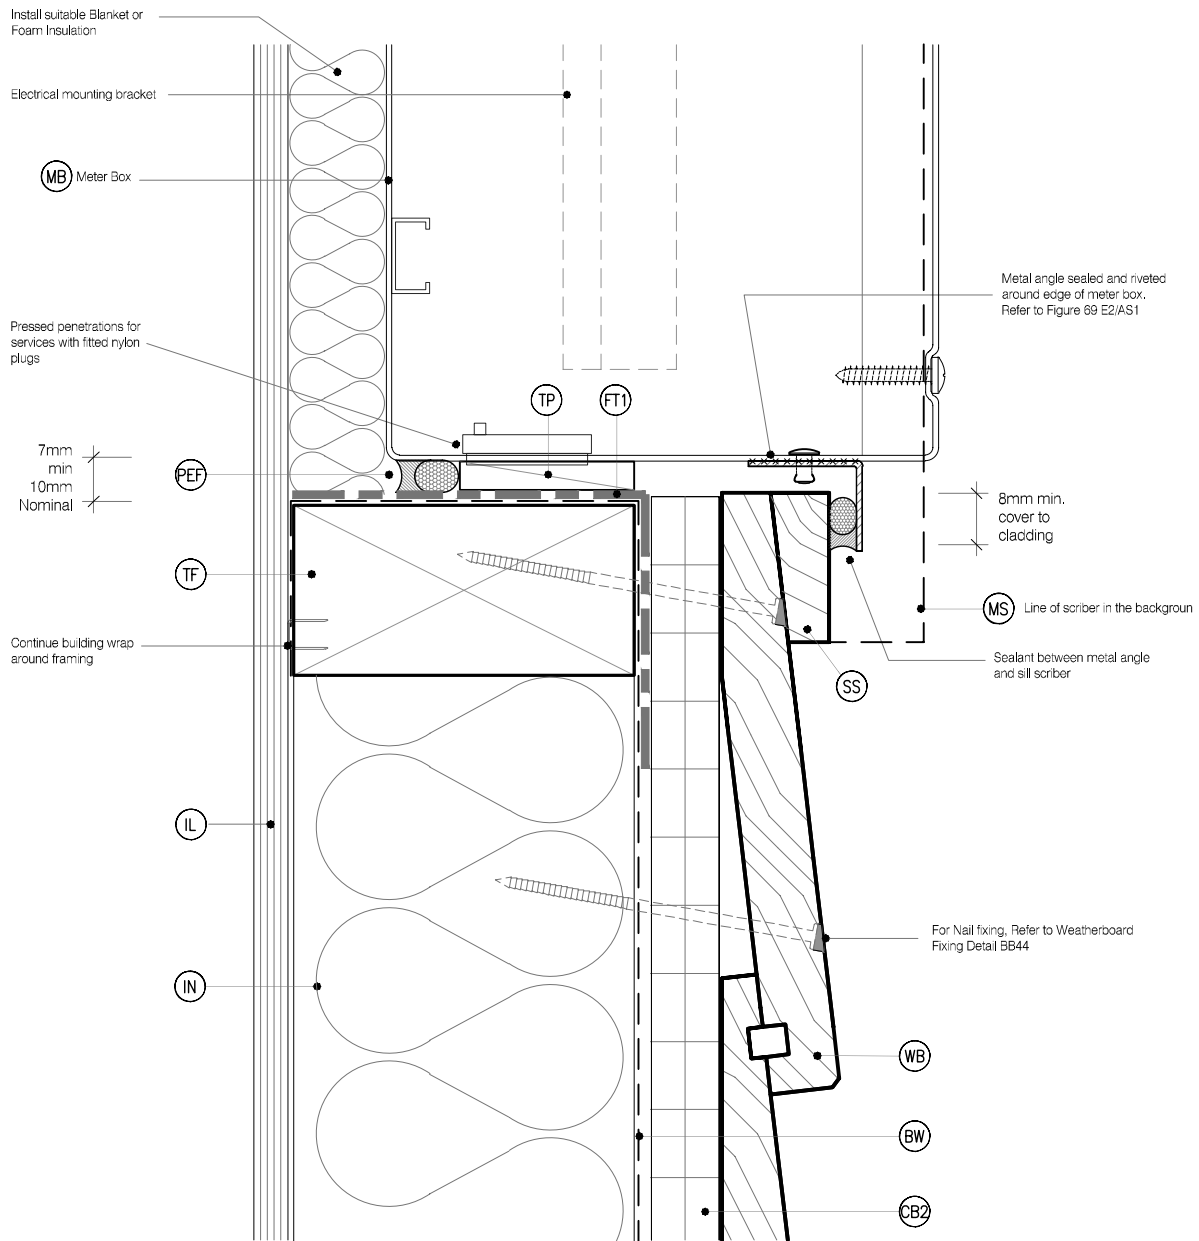

LEGEND:

- | | | |
|--|--|---|
| <p>(MB) METER BOX: Electrical meter box, with removable hinged door and polycarbonate viewing window</p> <p>(BW) BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)</p> <p>(CB2) CAVITY BATTEN, VERTICAL: 20mm x 45mm H3.1. To form a 20mm cavity.</p> <p>(CB3) CAVITY BATTEN, VERTICAL - STRUCTURALLY FIXED: 45mm x 45mm SPP Radiata Pine, H3.2 70mm x 45mm SPP Radiata Pine, H3.2 To form a 45mm cavity</p> <p>(CS) CANT STRIP: Southern Pine H3.1 Cant Strip 25mm x 9 mm</p> <p>(SS) SILL SCRIBER: Southern Pine H3.2, Horizontal batten under window as necessary to suit profile, sealant to back of sill scriber</p> | <p>(CC) CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm Min drip edge to cladding</p> <p>(FT1) FLASHING TAPE: Flashing tape over wrap 70mm (50 min) turn-down required in corners only. Refer to Fig. 72 of NZBC E2/AS1</p> <p>(FT2) FLEXIBLE FLASHING TAPE: Flexible flashing tape lapped over aluminium head flashing or 2nd layer of Building Wrap, taped joint to top of timber frame</p> <p>(HF) HEAD FLASHING: Aluminium head flashing with minimum 15 degree fall, optional hemmed edges as per table 7 E2/AS1</p> <p>(IL) INTERNAL LINING: Selected Internal Lining</p> <p>(PEF) PEF ROD BACKING: Foam backing rod with sealant to cavity in Window perimeter that forms a waterproof air-seal. (Sealant 2:1 Ratio)</p> <p>(TP) TIMBER PACKER: Tan H3.2 Treated Packer</p> | <p>(TF) TIMBER FRAME: H1.2 min treated timber framing</p> <p>(IN) INSULATION: Selected Insulation</p> <p>(WB) WEATHER BOARD: Southern Pine Bevel Back Weatherboard. Profile to NZS 3617</p> <p>(WL) WINDOW LINER: As Specified</p> <p>(WH) WEATHERHEAD: (OPTIONAL) Southern Pine, Horizontal batten above meter box as necessary to suit profile, shaped to shed water, sealant to back of head scriber</p> <p>(MS) METER BOX SCRIBER: Southern Pine H3.1, profile cut to fit weatherboard, sealant to back of scriber and 75 x 3.15mm 316 Stainless Steel nail in 3mm predrilled hole. 40x18 or 60x18 depending on weatherboard size</p> |
|--|--|---|

NOTE: Where 75x3.15 jolt head nails are referenced, these may be substituted for 75mm jolt head weatherboard screws

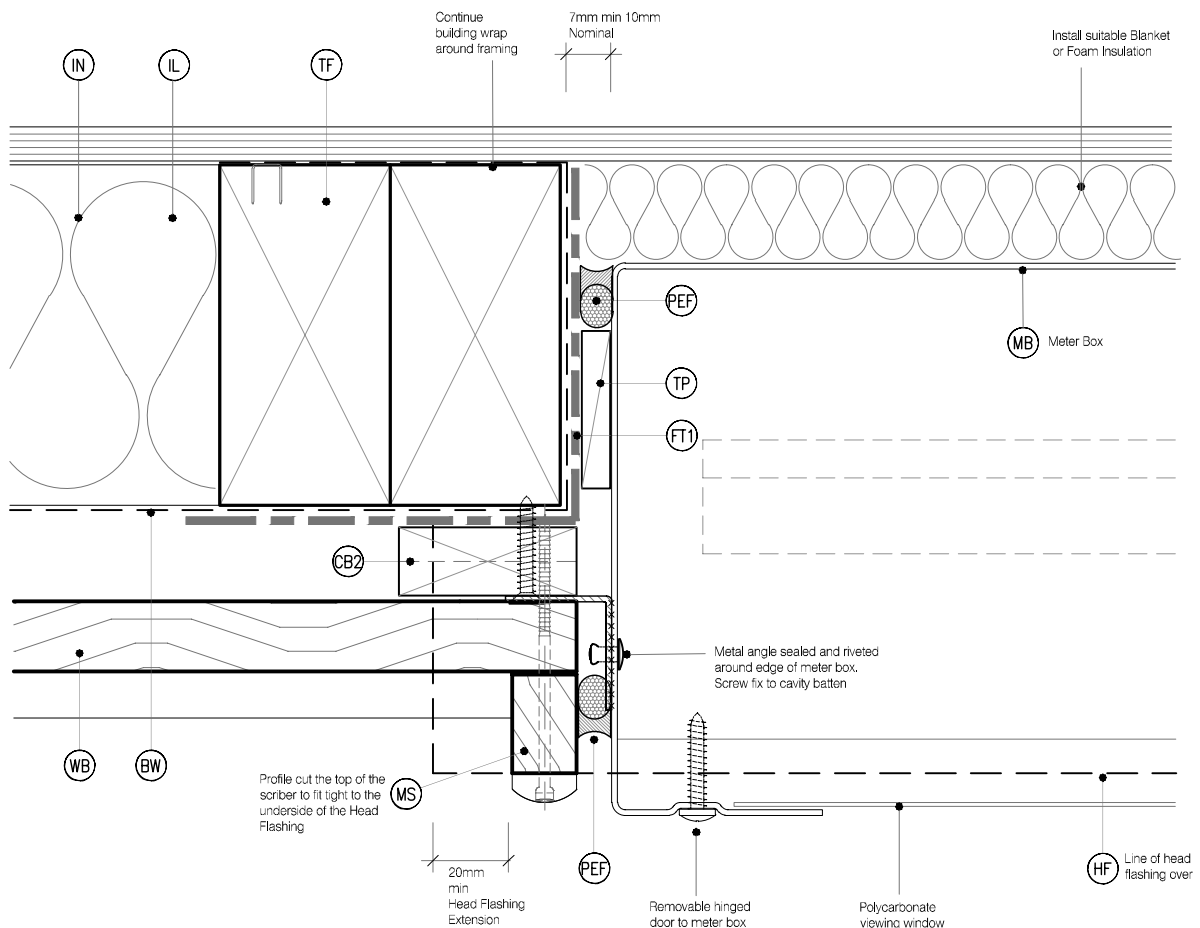

LEGEND:


- (MB)** METER BOX: Electrical meter box, with removable hinged door and polycarbonate viewing window
- (BW)** BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)
- (CB2)** CAVITY BATTEN, VERTICAL: 20mm x 45mm H3.1. To form a 20mm cavity.
- (CB3)** CAVITY BATTEN, VERTICAL - STRUCTURALLY FIXED : 45mm x 45mm SPP Radiata Pine, H3.2 70mm x 45mm SPP Radiata Pine, H3.2 To form a 45mm cavity
- (CS)** CANT STRIP: Southern Pine H3.1 Cant Strip 25mm x 9 mm
- (SS)** SILL SCRIBER: Southern Pine H3.2, Horizontal batten under window as necessary to suit profile, sealant to back of sill scriber

- (CC)** CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm Min drip edge to cladding
- (FT1)** FLASHING TAPE: Flashing tape over wrap 70mm (50 min) turn-down required in corners only. Refer to Fig. 72 of NZBC E2/AS1
- (FT2)** FLEXIBLE FLASHING TAPE: Flexible flashing tape lapped over aluminium head flashing or 2nd layer of Building Wrap, taped joint to top of timber frame
- (HF)** HEAD FLASHING: Aluminium head flashing with minimum 15 degree fall, optional hemmed edges as per table 7 E2/AS1
- (IL)** INTERNAL LINING: Selected Internal Lining
- (PEF)** PEF ROD BACKING: Foam backing rod with sealant to cavity in Window perimeter that forms a waterproof air-seal. (Sealant 2:1 Ratio)
- (TP)** TIMBER PACKER: Tan H3.2 Treated Packer


- (TF)** TIMBER FRAME: H1.2 min treated timber framing
- (IN)** INSULATION: Selected Insulation
- (WB)** WEATHER BOARD: Southern Pine Bevel Back Weatherboard. Profile to NZS 3617
- (WL)** WINDOW LINER: As Specified
- (WH)** WEATHERHEAD: (OPTIONAL) Southern Pine, Horizontal batten above meter box as necessary to suit profile, shaped to shed water, sealant to back of head scriber
- (MS)** METER BOX SCRIBER: Southern Pine H3.1, profile cut to fit weatherboard, sealant to back of scriber and 75 x 3.15mm 316 Stainless Steel nail in 3mm predrilled hole. 40x18 or 60x18 depending on weatherboard size

NOTE : Where 75x3.15 jolt head nails are referenced, these may be substituted for 75mm jolt head weatherboard screws

METER BOX FLASHING DETAILS

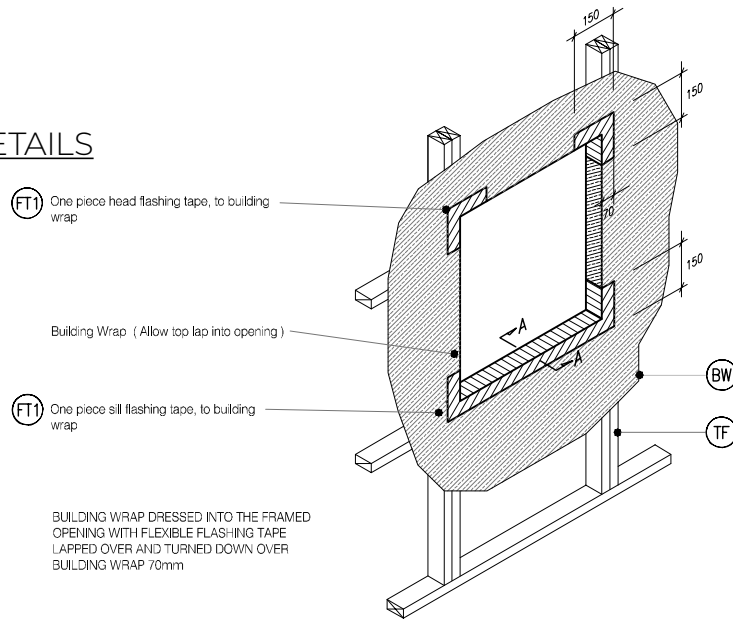

M4 TYPICAL METER BOX OPENING (FLASHING TAPE)
BB33 SCALE : N.T.S

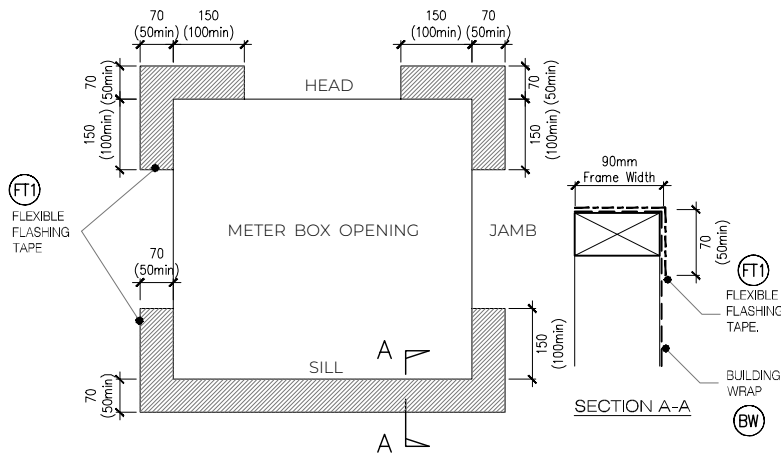


M5 FLEXIBLE BUILDING WRAP AT OPENING
BB33 SCALE : 1 / 5 @ A1, 1 / 10 @ A3

1. DENDRO® is Southern Pine's premium product range of H3.2 treated, solid, clear weatherboards. Manufactured from, high quality, pruned NZ Radiata Pine. Product warranty, 25 years if used in accordance with the Installation & Maintenance Guide.
2. All Southern Pine Weatherboard profiles have been machined to be compliant with NZS 3617 and BRAINZ BU411
3. The Southern Pine Weatherboard System, if designed and installed as per the Installation & Maintenance Guide, will meet


the following provisions of the New Zealand Building Code (NZBC):

- Clause B1 Structure: Performance B1.3.1, B1.3.2, B1.3.4 (a), (b), (c), (d) and (e) for the
- Clause B2 Durability: Performance B2.3.1(b) and B2.3.2(b)
- Clause E2 External Moisture: Performance E2.3.2, E2.3.3, E2.3.5, E2.3.7(b) and (c)
- Clause F2 Hazardous Building Materials: Performance F2.3.1

4. This Weatherboard System must be installed by a qualified trade person. Restricted Building Work (RBW) requires a Licensed Building Practitioner (LBP) or supervised by an LBP. It is the specifier's responsibility to ensure that the details are appropriate for the intended application and that additional detailing is obtained for a specific design or any areas that fall outside the scope of the Southern Pine Products & E2/AS1 Acceptable solution.

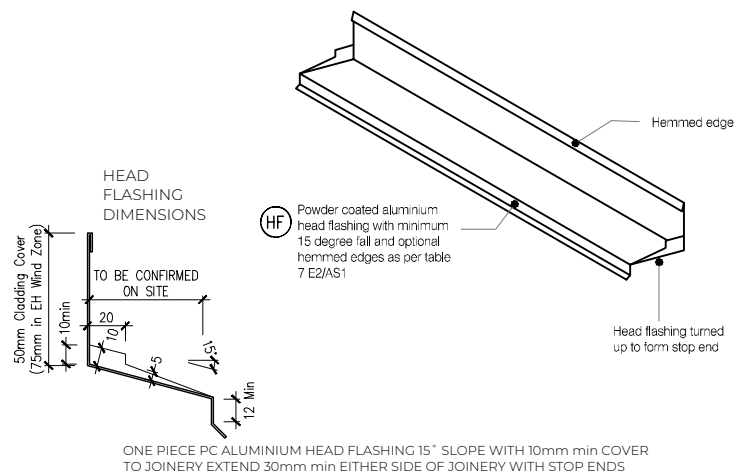


M6 TYPICAL HEAD & FLASHING JOINT
BB33 SCALE : 1 / 2 @ A1, 1 / 4 @ A3

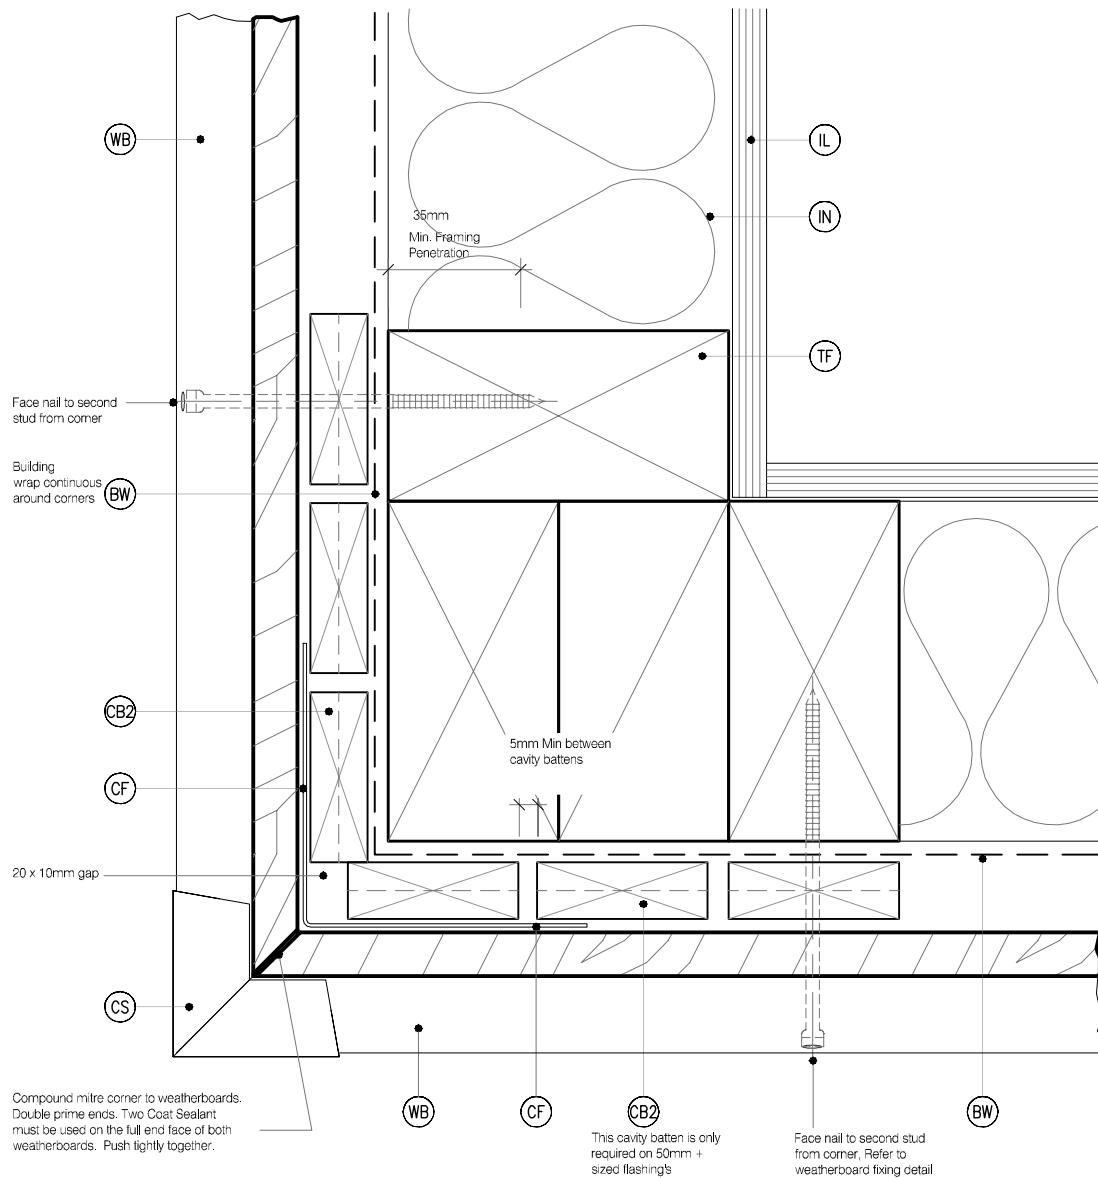

LEGEND:

BW BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)	CF CORNER FLASHING: Aluminium, PVC or Stainless Steel corner flashing. Refer NZBC E2/AS1 4.3 50x50 Hem or Hook to Flashing Edges 75x75 NO, Hem or Hook Required EXTRA HIGH WIND ZONE 100x100 Hem or Hook to Flashing Edges, Refer NZBC E2/AS1 4.5.1	IL INTERNAL LINING: Selected Internal Lining
CB2 CAVITY BATTEN, VERTICAL: 20mm x 45mm H3.1. To form a 20mm cavity.	IN INSULATION: Selected Insulation	FT3 FLEXIBLE FLASHING TAPE: Flexible flashing tape lapped into corner, Refer NZBC E2/AS1 4.3,11 Flashing tape is recommended due to movement that may occur in corners. Not required by E2/AS1
CB3 CAVITY BATTEN, VERTICAL - STRUCTURALLY FIXED : 45mm x 45mm SPP Radiata Pine, H3.2 70mm x 45mm SPP Radiata Pine, H3.2 To form a 45mm cavity	CC CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm Min drip edge to cladding	TF TIMBER FRAME: H1.2 min Treated timber framing
		WB WEATHER BOARD: Southern Pine Bevel Back Weatherboard. Profile to NZS 3617

NOTE : Where 75x3.15 jolt head nails are referenced, these may be substituted for 75mm jolt head weatherboard screws

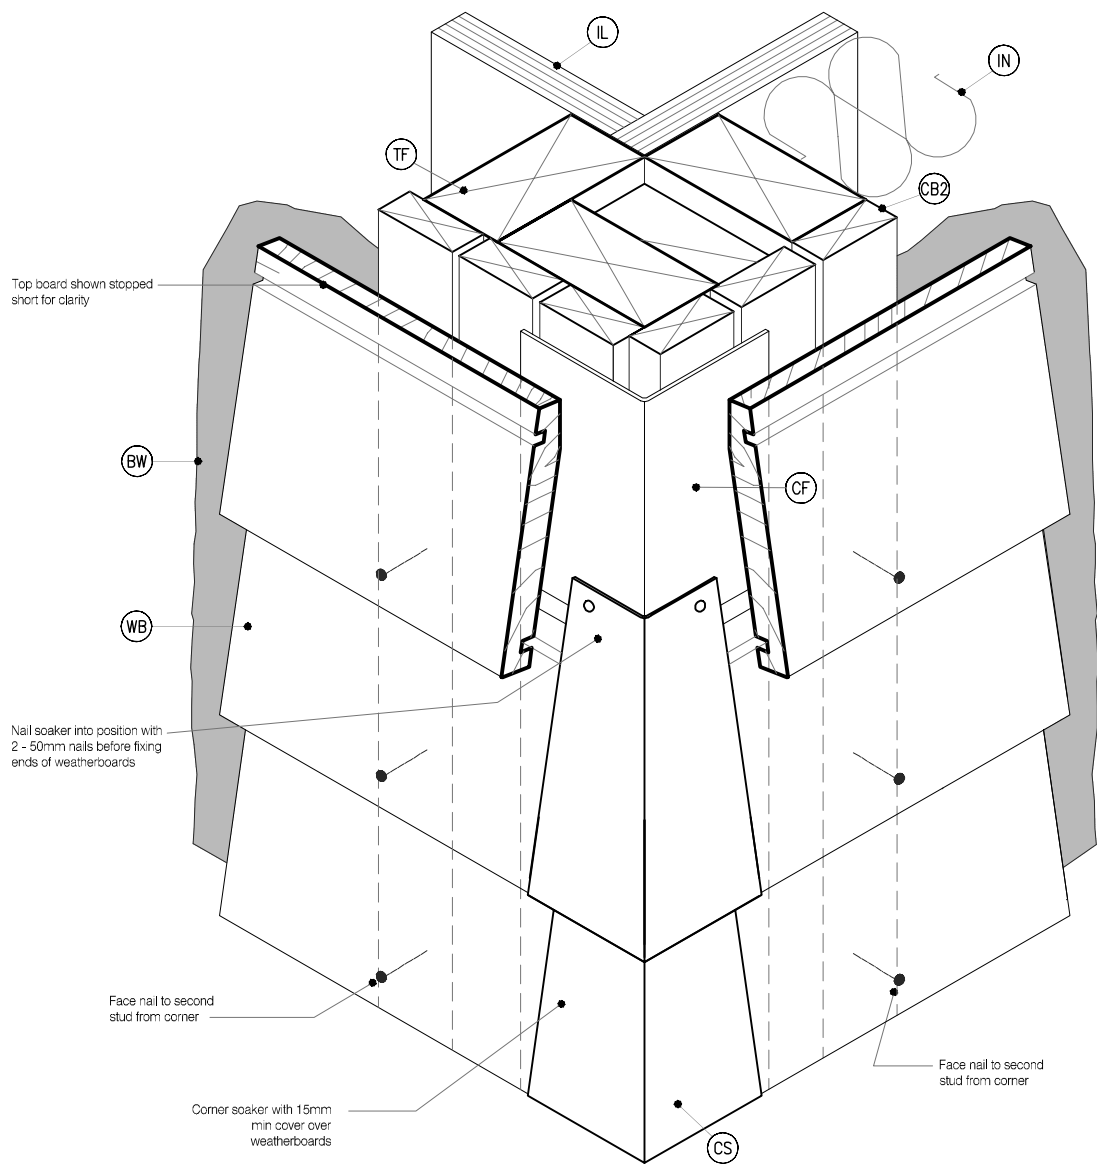

Soaker material	Nail material
Copper	Copper or phosphor bronze
Aluminium	Hot dip galvanised
Stainless steel	Stainless steel

LEGEND:

- BW** BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)

CB2 CAVITY BATTEN, VERTICAL: 20mm x 45mm H3.1. To form a 20mm cavity.

CB3 CAVITY BATTEN, VERTICAL - STRUCTURALLY FIXED : 45mm x 45mm SPP Radiata Pine, H3.2 70mm x 45mm SPP Radiata Pine, H3.2 To form a 45mm cavity
- CF** CORNER FLASHING: Aluminium, PVC or Stainless Steel corner flashing. Refer NZBC E2/AS1 4.3 50x50 Hem or Hook to Flashing Edges 75x75 NO, Hem or Hook Required EXTRA HIGH WIND ZONE 100x100 Hem or Hook to Flashing Edges, Refer NZBC E2/AS1 4.5.1

IN INSULATION: Selected Insulation


CC CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm Min drip edge to cladding
- IL** INTERNAL LINING: Selected Internal Lining

FT3 FLEXIBLE FLASHING TAPE: Flexible flashing tape lapped into corner, Refer NZBC E2/AS1 4.3.11 Flashing tape is recommended due to movement that may occur in corners. Not required by E2/AS1

TF TIMBER FRAME: H1.2 min Treated timber framing

WB WEATHER BOARD: Southern Pine Bevel Back Weatherboard. Profile to NZS 3617

NOTE : Where 75x3.15 jolt head nails are referenced, these may be substituted for 75mm jolt head weatherboard screws

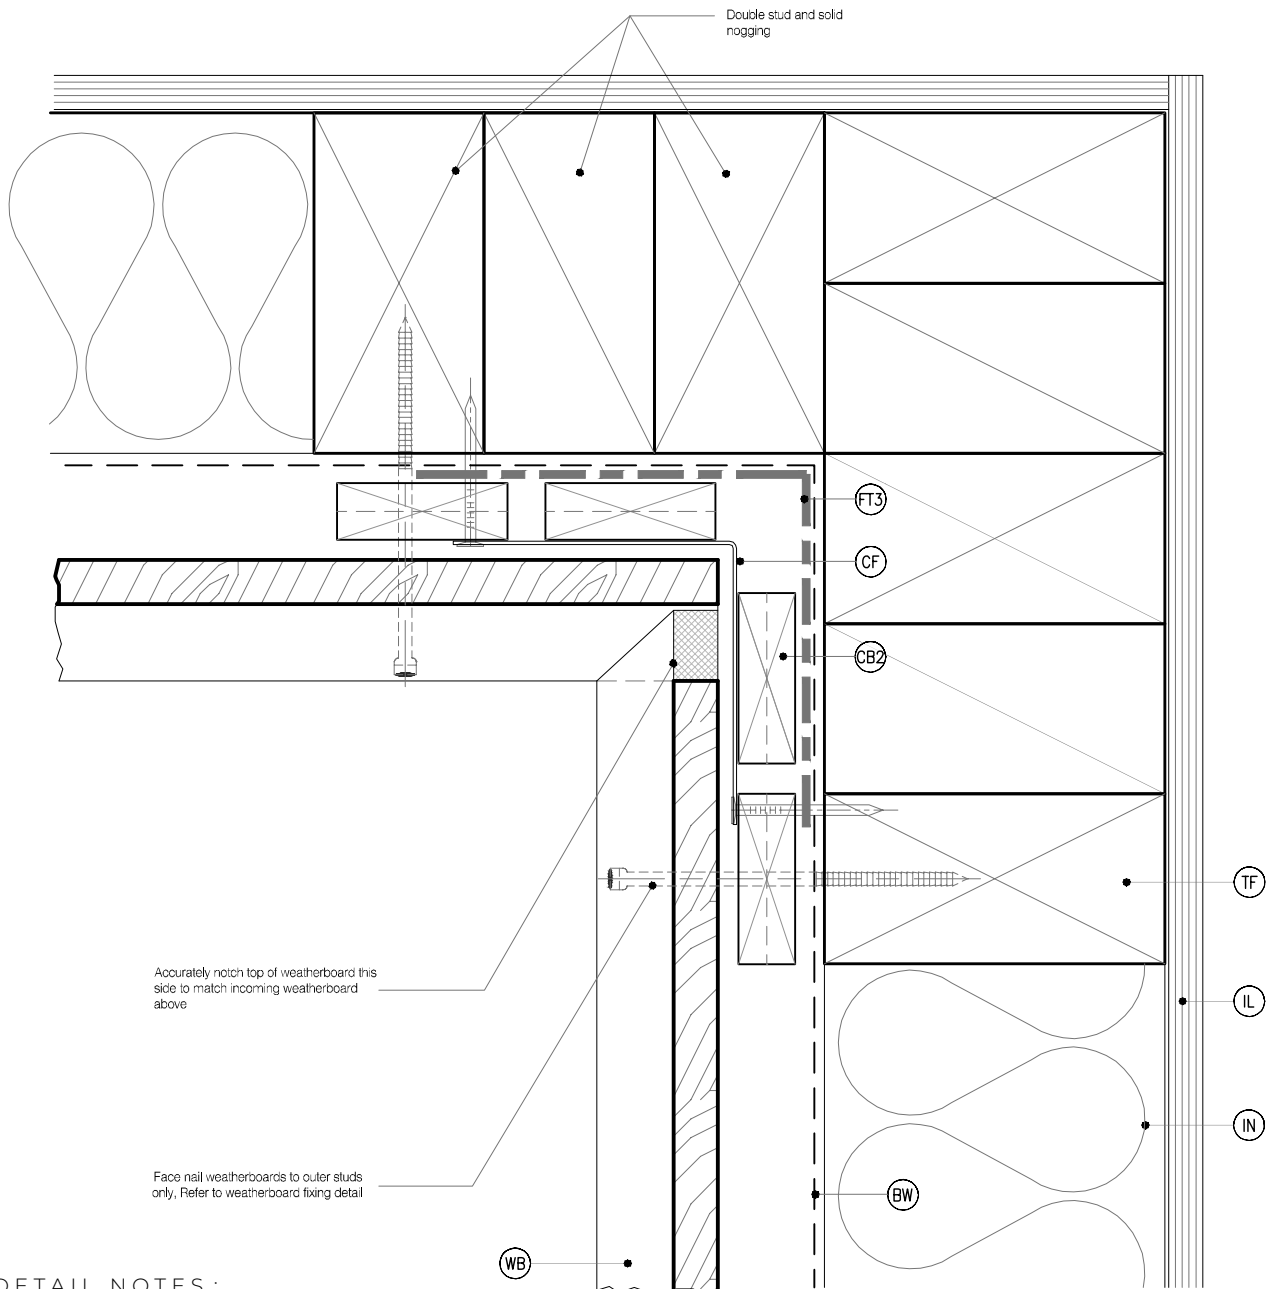

DETAIL NOTES :

1. Flashing tape is recommended due to movement that may occur in corners but it is not required by E2/AS1
2. Aluminium extrusion must not be continuous over solid floor joists.

LEGEND :



BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)



CAVITY BATTEN, VERTICAL: 20mm x 45mm H3.1. To form a 20mm cavity.



CAVITY BATTEN, VERTICAL - STRUCTURALLY FIXED : 45mm x 45mm SPP Radiata Pine, H3.2
70mm x 45mm SPP Radiata Pine, H3.2
To form a 45mm cavity



CORNER FLASHING: Aluminium, PVC or Stainless Steel corner flashing. Refer NZBC E2/AS1 4.3
50x50 Hem or Hook to Flashing Edges
75x75 NO, Hem or Hook Required
EXTRA HIGH WIND ZONE
100x100 Hem or Hook to Flashing Edges, Refer NZBC E2/AS1 4.5.1



INSULATION: Selected Insulation



CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm Min drip edge to cladding



INTERNAL LINING: Selected Internal Lining



FLEXIBLE FLASHING TAPE: Flexible flashing tape lapped into corner, Refer NZBC E2/AS1 4.3.11
Flashing tape is recommended due to movement that may occur in corners. Not required by E2/AS1




TIMBER FRAME: H1.2 min Treated timber framing



WEATHER BOARD: Southern Pine Bevel Back Weatherboard. Profile to NZS 3617

NOTE : Where 75x3.15 jolt head nails are referenced, these may be substituted for 75mm jolt head weatherboard screws

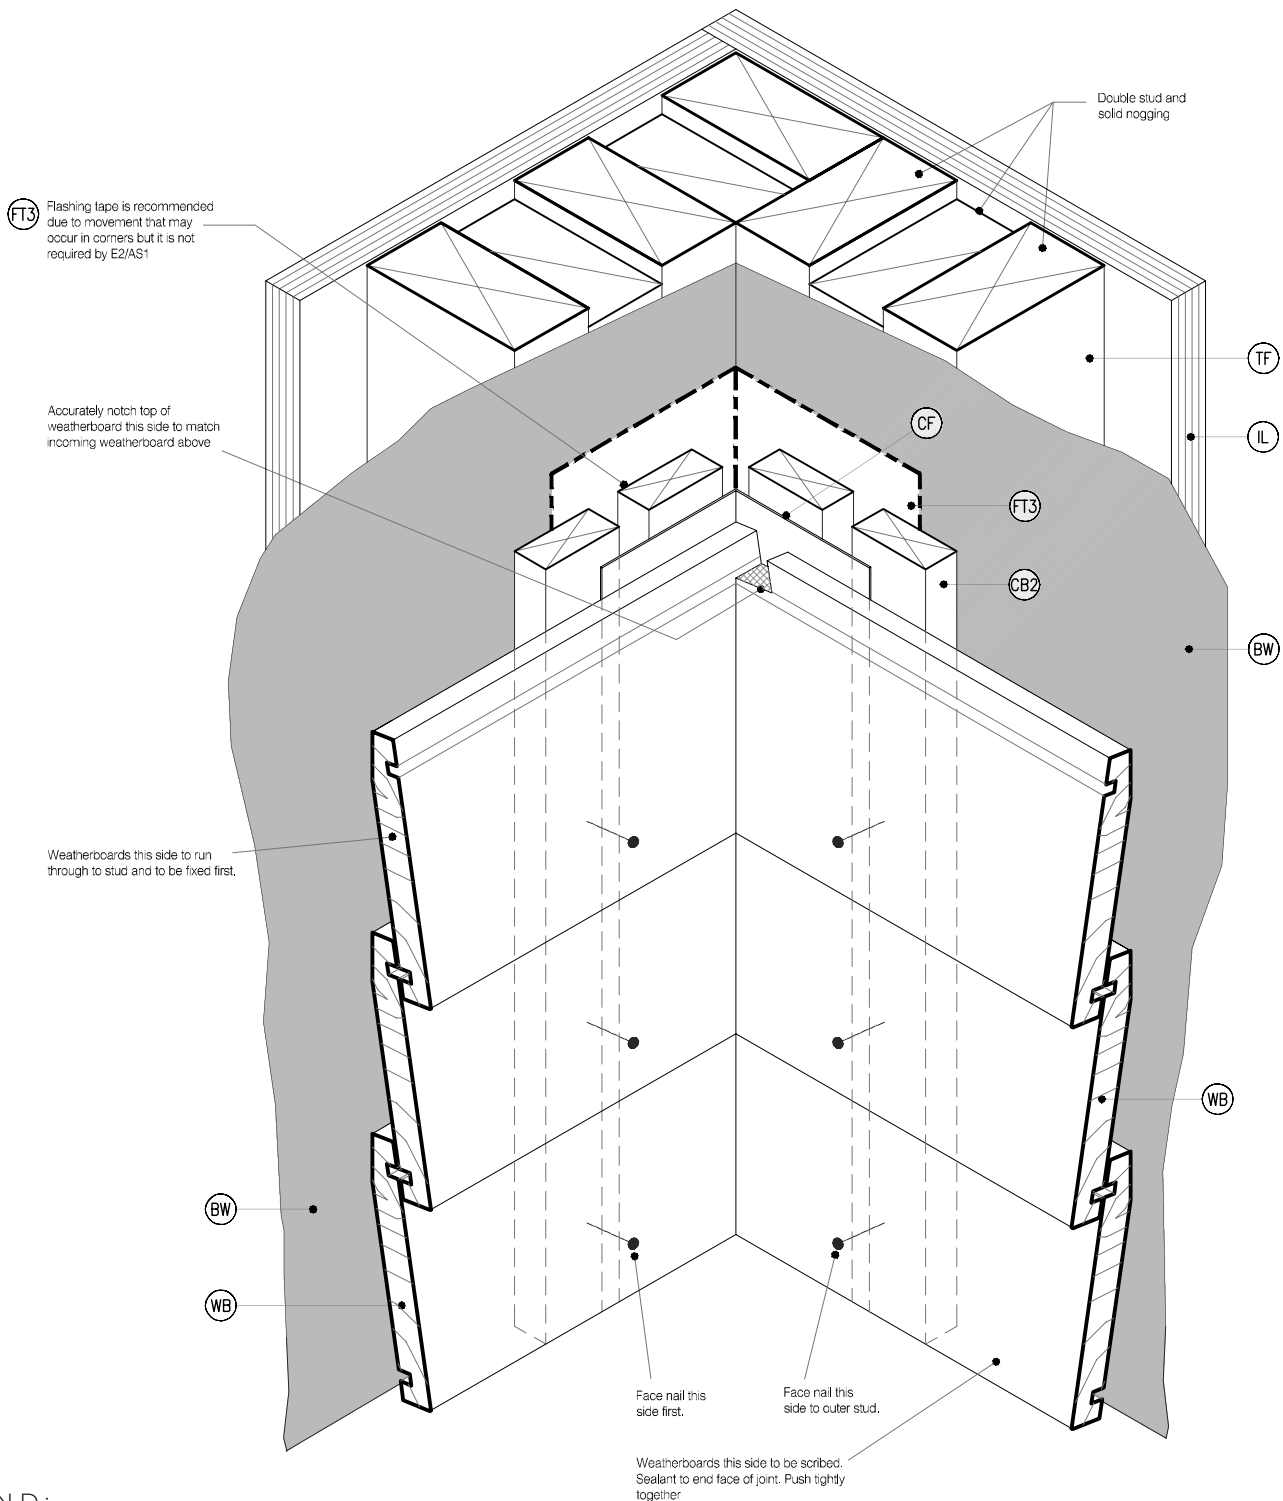


LEGEND:

- BW** BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)
- CB2** CAVITY BATTEN, VERTICAL: 20mm x 45mm H3.1. To form a 20mm cavity.
- CB3** CAVITY BATTEN, VERTICAL - STRUCTURALLY FIXED : 45mm x 45mm SPP Radiata Pine, H3.2 70mm x 45mm SPP Radiata Pine, H3.2 To form a 45mm cavity
- CF** CORNER FLASHING: Aluminium, PVC or Stainless Steel corner flashing. Refer NZBC E2/AS1 4.3 50x50 Hem or Hook to Flashing Edges 75x75 NO, Hem or Hook Required EXTRA HIGH WIND ZONE 100x100 Hem or Hook to Flashing Edges, Refer NZBC E2/AS1 4.5.1
- IN** INSULATION: Selected Insulation
- CC** CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm Min drip edge to cladding

- IL** INTERNAL LINING: Selected Internal Lining
- FT3** FLEXIBLE FLASHING TAPE: Flexible flashing tape lapped into corner, Refer NZBC E2/AS1 4.3.11 Flashing tape is recommended due to movement that may occur in corners. Not required by E2/AS1
- TF** TIMBER FRAME: H1.2 min Treated timber framing
- WB** WEATHER BOARD: Southern Pine Bevel Back Weatherboard. Profile to NZS 3617

NOTE : Where 75x3.15 jolt head nails are referenced, these may be substituted for 75mm jolt head weatherboard screws

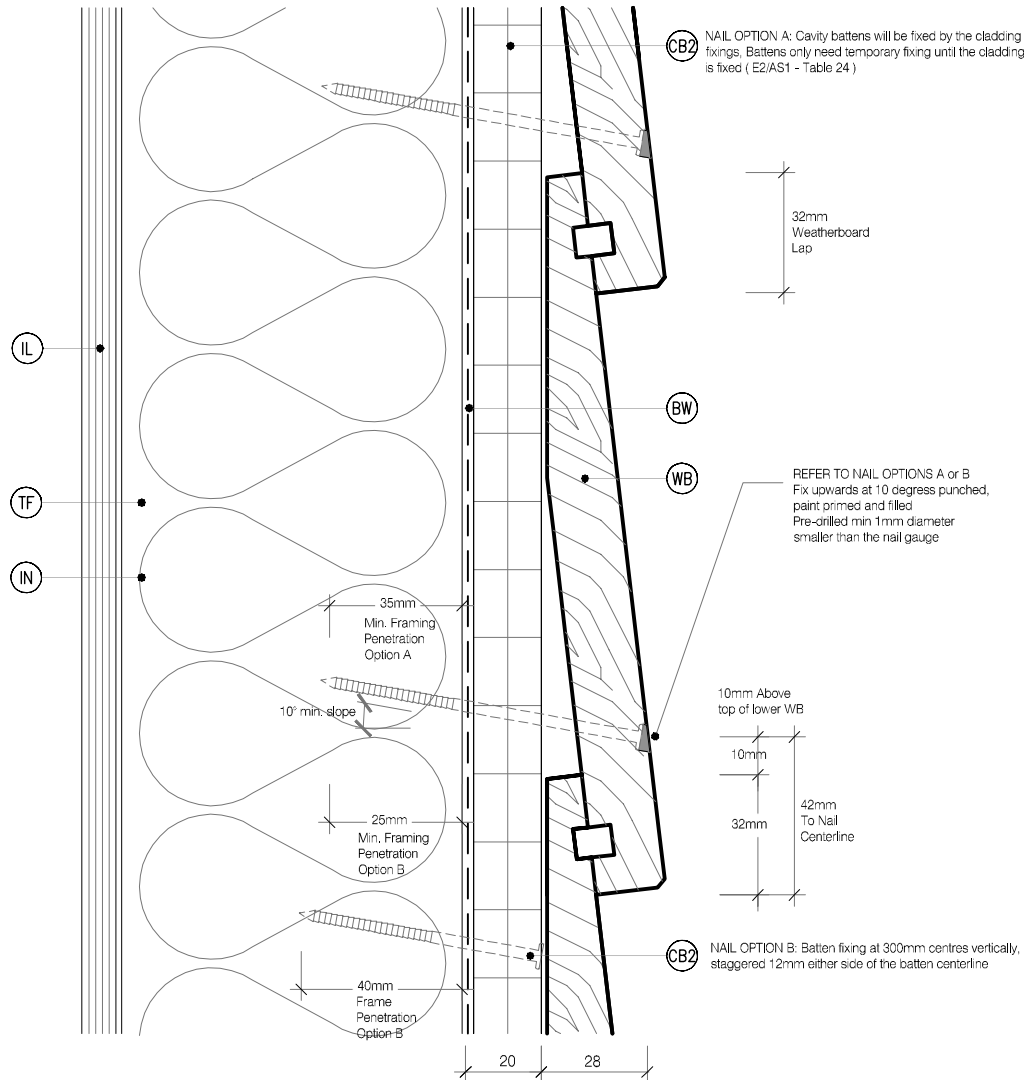

NAIL OPTION A - One Nail to Framing (Refer E2/AS1 - Table 24)

WEATHERBOARD & CAVITY BATTEN FIXING
90 x 3.55mm Jolt Head, Hot Dip Galvanised Nail
OR
75 x 3.15mm CSK Annular Grooved, HD Galv Nail
75 x 3.15mm CSK Annular Grooved, SS Nail

NAIL OPTION B - Structurally Fixed Cavity Bat ten (Refer BRANZ Bulletin No 582 & Test Report ST0589)

BATTEN FIXING OPTION
60 x 2.8mm Jolt Head, Hot Dip Galvanised Nail
65 x 2.87mm Power Driver, Hot Dip Galvanised Nail
65 x 2.87mm Power Driver, Annular Grooved SS Nail

WEATHERBOARD FIXING
75 x 3.15mm Jolt Head, Hot Dip Galvanised Nail
75 x 3.15mm CSK Annular Grooved, SS Nail


LEGEND:

- BW** BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Ridgid Underlay required (9.1.7.2 E2/AS1)
- CB2** CAVITY BATTEN, VERTICAL: 20mm x 45mm H3.1. To form a 20mm cavity.
- CB3** CAVITY BATTEN, VERTICAL - STRUCTURALLY FIXED : 45mm x 45mm SPP Radiata Pine, H3.2 70mm x 45mm SPP Radiata Pine, H3.2 To form a 45mm cavity

- CF** CORNER FLASHING: Aluminium, PVC or Stainless Steel corner flashing. Refer NZBC E2/AS1 4.3 50x50 Hem or Hook to Flashing Edges 75x75 NO, Hem or Hook Required EXTRA HIGH WIND ZONE 100x100 Hem or Hook to Flashing Edges, Refer NZBC E2/AS1 4.5.1
- IN** INSULATION: Selected Insulation
- CC** CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm Min drip edge to cladding

- IL** INTERNAL LINING: Selected Internal Lining
- FT3** FLEXIBLE FLASHING TAPE: Flexible flashing tape lapped into corner, Refer NZBC E2/AS1 4.3.11 Flashing tape is recommended due to movement that may occur in corners. Not required by E2/AS1
- TF** TIMBER FRAME: H1.2 min Treated timber framing
- WB** WEATHER BOARD: Southern Pine Bevel Back Weatherboard. Profile to NZS 3617

NOTE : Where 75x3.15 jolt head nails are referenced, these may be substituted for 75mm jolt head weatherboard screws




When joining weatherboards a 30 ° Scarf joint is to be used. This joint must face away from the prevailing weather. Alternatively a corrosion resistant soaker can be used, refer to E2/AS1 - 9.4.4.2 & Soakers materials to 4.32 to Paragraph 4.3.8

LEGEND:

- | | | | | | |
|--------------|---|-------------|--|--------------|--|
| (BW) | BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23. In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1) | (CF) | CORNER FLASHING: Aluminium, PVC or Stainless Steel corner flashing. Refer NZBC E2/AS1 4.3 50x50 Hem or Hook to Flashing Edges 75x75 NO, Hem or Hook Required
EXTRA HIGH WIND ZONE
100x100 Hem or Hook to Flashing Edges, Refer NZBC E2/AS1 4.5.1 | (IL) | INTERNAL LINING: Selected Internal Lining |
| (CB2) | CAVITY BATTEN, VERTICAL: 20mm x 45mm H3.1. To form a 20mm cavity. | (IN) | INSULATION: Selected Insulation | (FT3) | FLEXIBLE FLASHING TAPE: Flexible flashing tape lapped into corner, Refer NZBC E2/AS1 4.3.11. Flashing tape is recommended due to movement that may occur in corners. Not required by E2/AS1 |
| (CB3) | CAVITY BATTEN, VERTICAL - STRUCTURALLY FIXED : 45mm x 45mm SPP Radiata Pine, H3.2 70mm x 45mm SPP Radiata Pine, H3.2 To form a 45mm cavity | (CC) | CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm Min drip edge to cladding | (TF) | TIMBER FRAME: H1.2 min Treated timber framing |
| | | | | (WB) | WEATHER BOARD: Southern Pine Bevel Back Weatherboard. Profile to NZS 3617 |

NOTE : Where 75x3.15 jolt head nails are referenced, these may be substituted for 75mm jolt head weatherboard screws

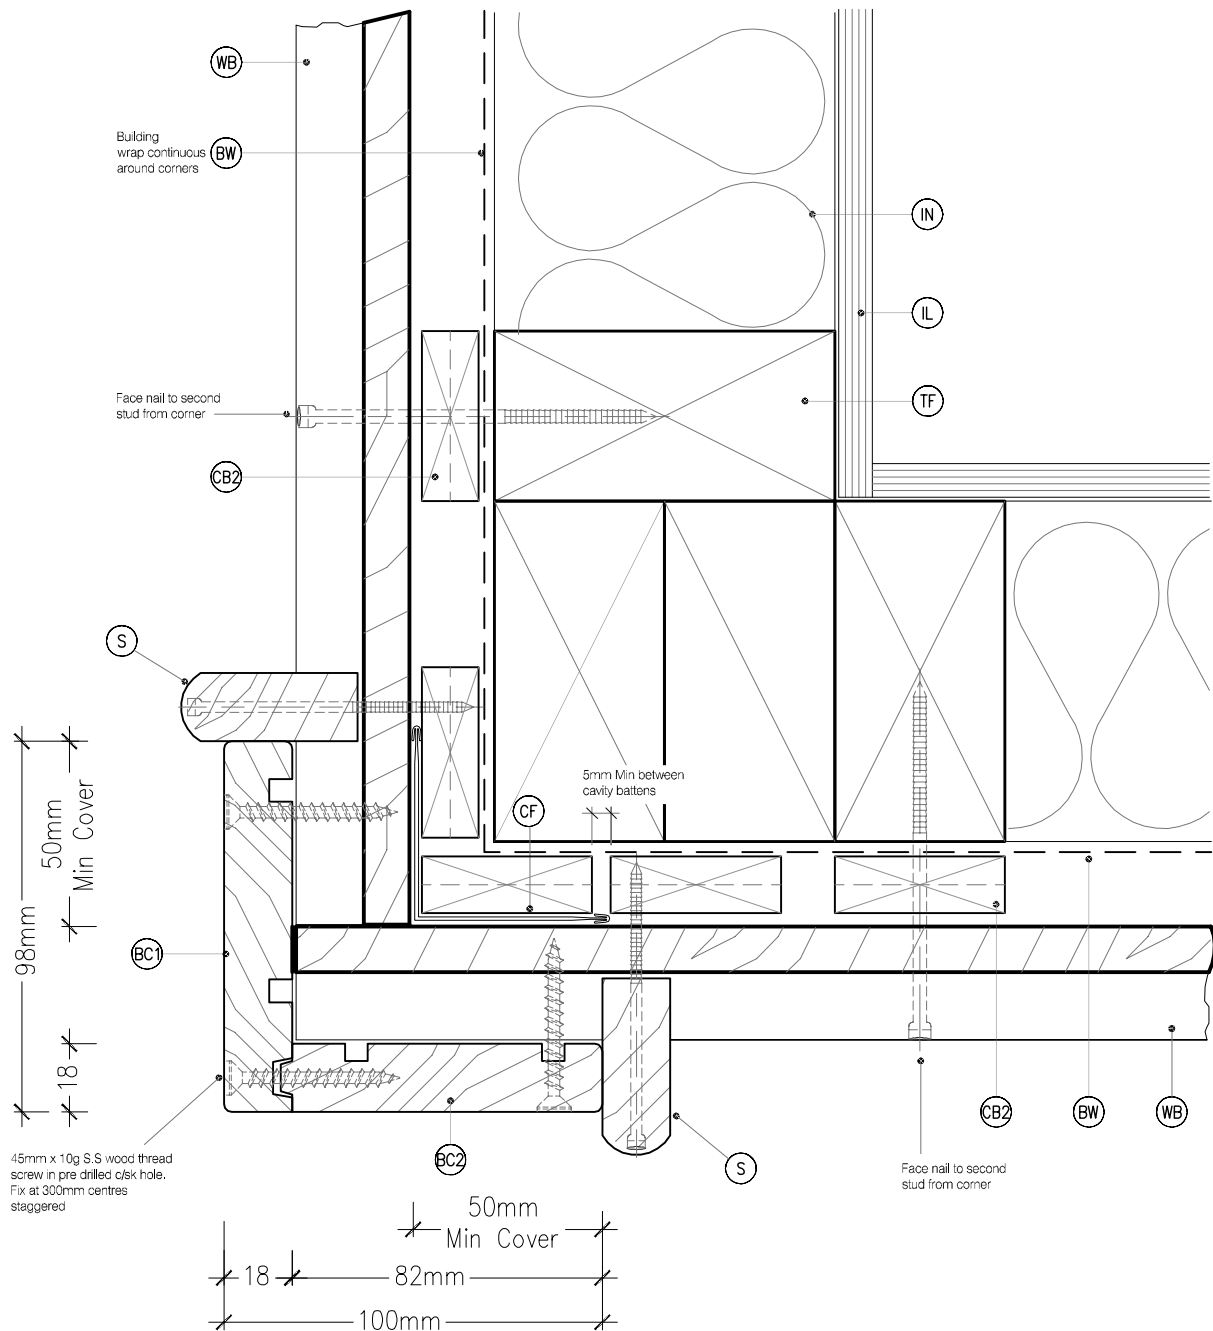


LEGEND:

- (BC1)** BOXED CORNER COVER : Southern Pine 100 x 18 H3.1 External box corner
- (BC2)** BOXED CORNER COVER : Southern Pine 87 x 18 H3.1 Reversible box corner
- (BC3)** BOXED CORNER COVER : Southern Pine 100 x 18 H3.1 Internal box corner
- (CB2)** CAVITY BATTEN, VERTICAL: 20mm x 45mm H3.1. To form a 20mm cavity.
- (CB3)** CAVITY BATTEN, VERTICAL - STRUCTURALLY FIXED : 45mm x 45mm SPP Radiata Pine, H3.2 70mm x 45mm SPP Radiata Pine, H3.2 To form a 45mm cavity
- (BW)** BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)

- (CF)** CORNER FLASHING: Aluminium, PVC or Stainless Steel corner flashing. Refer NZBC E2/AS1 4.3 50x50 Hem or Hook to Flashing Edges 75x75 NO. Hem or Hook Required EXTRA HIGH WIND ZONE 100x100 Hem or Hook to Flashing Edges, Refer NZBC E2/AS1 4.5.1
- (FT3)** FLEXIBLE FLASHING TAPE: Flexible flashing tape lapped into corner, Refer NZBC E2/AS1 4.3.11 Flashing tape is recommended due to movement that may occur in corners. (Not required by E2/AS1)
- (FT4)** FLEXIBLE FLASHING TAPE: Flexible flashing tape wrapped around pipe and over building wrap, Refer NZBC E2/AS1 4.3.11 & Figure 68

- (IN)** INSULATION: Selected Insulation
- (PEF)** PEF ROD BACKING: Foam backing rod with sealant to perimeter that forms a waterproof air-seal. (Sealant 2:1 Ratio)
- (TF)** TIMBER FRAME: H1.2 min treated timber framing
- (IL)** INTERNAL LINING: Selected Internal Lining
- (WB)** WEATHER BOARD: Southern Pine Bevel Back Weatherboard. Profile to NZS 3617
- (WS)** SCRIBER: Southern Pine H3.1, profile cut to fit weatherboard, sealant to back of scribe and 75 x 3.15mm 316 Stainless Steel nail in 3mm predrilled hole. 40x18 or 60x18 depending on weatherboard size

NOTE : Where 75x3.15 jolt head nails are referenced, these may be substituted for 75mm jolt head weatherboard screws

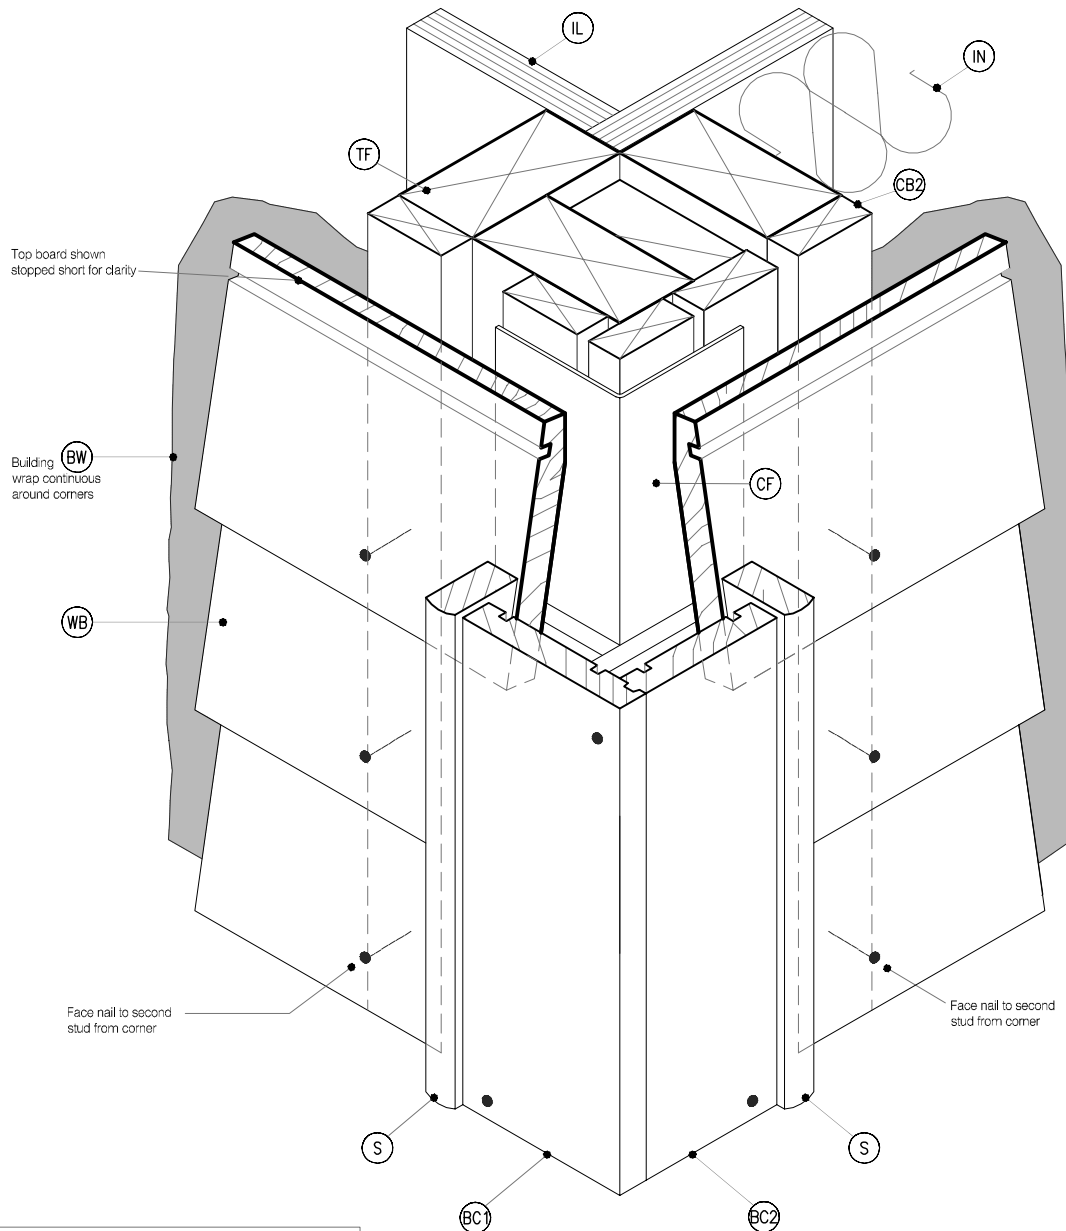

NOTE:
Box corner trim must not be continuous over solid floor joists.


LEGEND:

- BC1** BOXED CORNER COVER : Southern Pine 100 x 18 H3.1 External box corner
- BC2** BOXED CORNER COVER : Southern Pine 87 x 18 H3.1 Reversible box corner
- BC3** BOXED CORNER COVER : Southern Pine 100 x 18 H3.1 Internal box corner
- CB2** CAVITY BATTEN, VERTICAL: 20mm x 45mm H3.1. To form a 20mm cavity.
- CB3** CAVITY BATTEN, VERTICAL - STRUCTURALLY FIXED : 45mm x 45mm SPP Radiata Pine, H3.2 70mm x 45mm SPP Radiata Pine, H3.2 To form a 45mm cavity
- BW** BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)

- CF** CORNER FLASHING: Aluminium, PVC or Stainless Steel corner flashing. Refer NZBC E2/AS1 4.3 50x50 Hem or Hook to Flashing Edges 75x75 NO, Hem or Hook Required EXTRA HIGH WIND ZONE 100x100 Hem or Hook to Flashing Edges, Refer NZBC E2/AS1 4.5.1
- FT3** FLEXIBLE FLASHING TAPE: Flexible flashing tape lapped into corner, Refer NZBC E2/AS1 4.3.11 Flashing tape is recommended due to movement that may occur in corners. (Not required by E2/AS1)
- FT4** FLEXIBLE FLASHING TAPE: Flexible flashing tape wrapped around pipe and over building wrap, Refer NZBC E2/AS1 4.3.11 & Figure 68

- IN** INSULATION: Selected Insulation
- PEF** PEF ROD BACKING: Foam backing rod with sealant to perimeter that forms a waterproof air-seal. (Sealant 2:1 Ratio)
- TF** TIMBER FRAME: H1.2 min treated timber framing
- IL** INTERNAL LINING: Selected Internal Lining
- WB** WEATHER BOARD: Southern Pine Bevel Back Weatherboard. Profile to NZS 3617
- WS** SCRIBER: Southern Pine H3.1, profile cut to fit weatherboard, sealant to back of scriber and 75 x 3.15mm 316 Stainless Steel nail in 3mm predrilled hole, 40x18 or 60x18 depending on weatherboard size

NOTE : Where 75x3.15 jolt head nails are referenced, these may be substituted for 75mm jolt head weatherboard screws

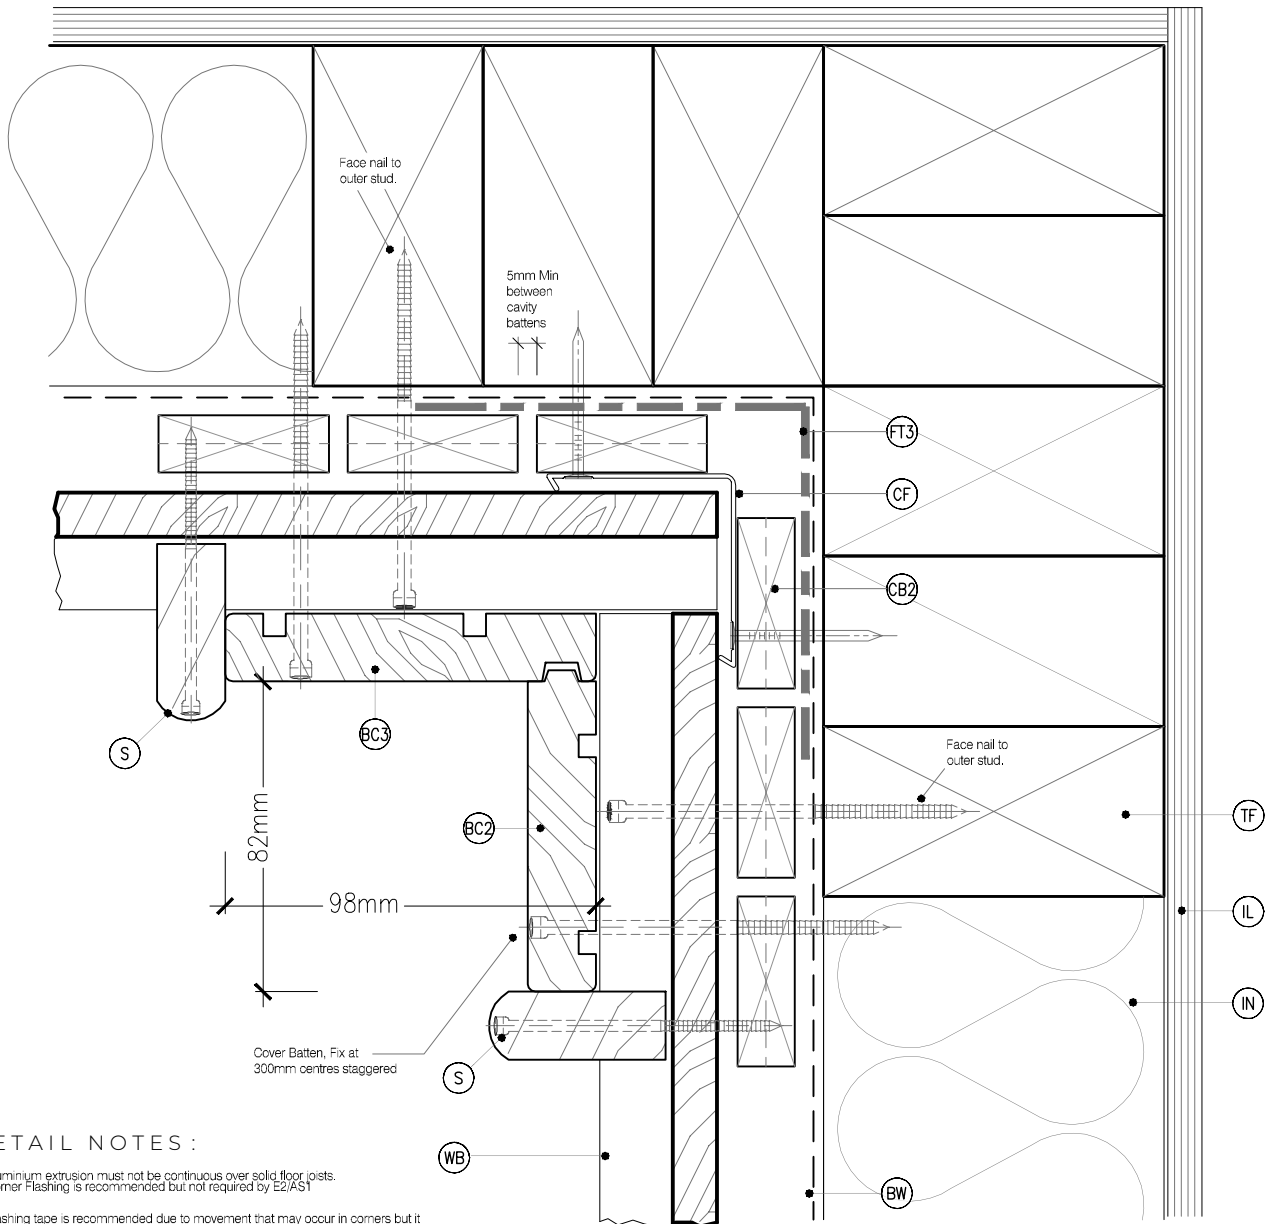

DETAIL NOTES :

1. Aluminium extrusion must not be continuous over solid floor joists.
2. Corner Flashing is recommended but not required by E2/AS1
3. Flashing tape is recommended due to movement that may occur in corners but it is not required by E2/AS1


LEGEND :

- BC1** BOXED CORNER COVER : Southern Pine 100 x 18 H3.1 External box corner
- BC2** BOXED CORNER COVER : Southern Pine 87 x 18 H3.1 Reversible box corner
- BC3** BOXED CORNER COVER : Southern Pine 100 x 18 H3.1 Internal box corner
- CB2** CAVITY BATTEN, VERTICAL: 20mm x 45mm H3.1. To form a 20mm cavity.
- CB3** CAVITY BATTEN, VERTICAL - STRUCTURALLY FIXED : 45mm x 45mm SPP Radiata Pine, H3.2 70mm x 45mm SPP Radiata Pine, H3.2 To form a 45mm cavity
- BW** BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)

- CF** CORNER FLASHING: Aluminium, PVC or Stainless Steel corner flashing. Refer NZBC E2/AS1 4.3 50x50 Hem or Hook to Flashing Edges 75x75 NO, Hem or Hook Required EXTRA HIGH WIND ZONE 100x100 Hem or Hook to Flashing Edges, Refer NZBC E2/AS1 4.5.1
- FT3** FLEXIBLE FLASHING TAPE: Flexible flashing tape lapped into corner, Refer NZBC E2/AS1 4.3.11 Flashing tape is recommended due to movement that may occur in corners. (Not required by E2/AS1)
- FT4** FLEXIBLE FLASHING TAPE: Flexible flashing tape wrapped around pipe and over building wrap, Refer NZBC E2/AS1 4.3.11 & Figure 68

- IN** INSULATION: Selected Insulation
- PEF** PEF ROD BACKING: Foam backing rod with sealant to perimeter that forms a waterproof air-seal. (Sealant 2:1 Ratio)
- TF** TIMBER FRAME: H1.2 min treated timber framing
- IL** INTERNAL LINING: Selected Internal Lining
- WB** WEATHER BOARD: Southern Pine Bevel Back Weatherboard. Profile to NZS 3617
- WS** SCRIBER: Southern Pine H3.1, profile cut to fit weatherboard, sealant to back of scriber and 75 x 3.15mm 316 Stainless Steel nail in 3mm predrilled hole. 40x18 or 60x18 depending on weatherboard size

NOTE : Where 75x3.15 jolt head nails are referenced, these may be substituted for 75mm jolt head weatherboard screws

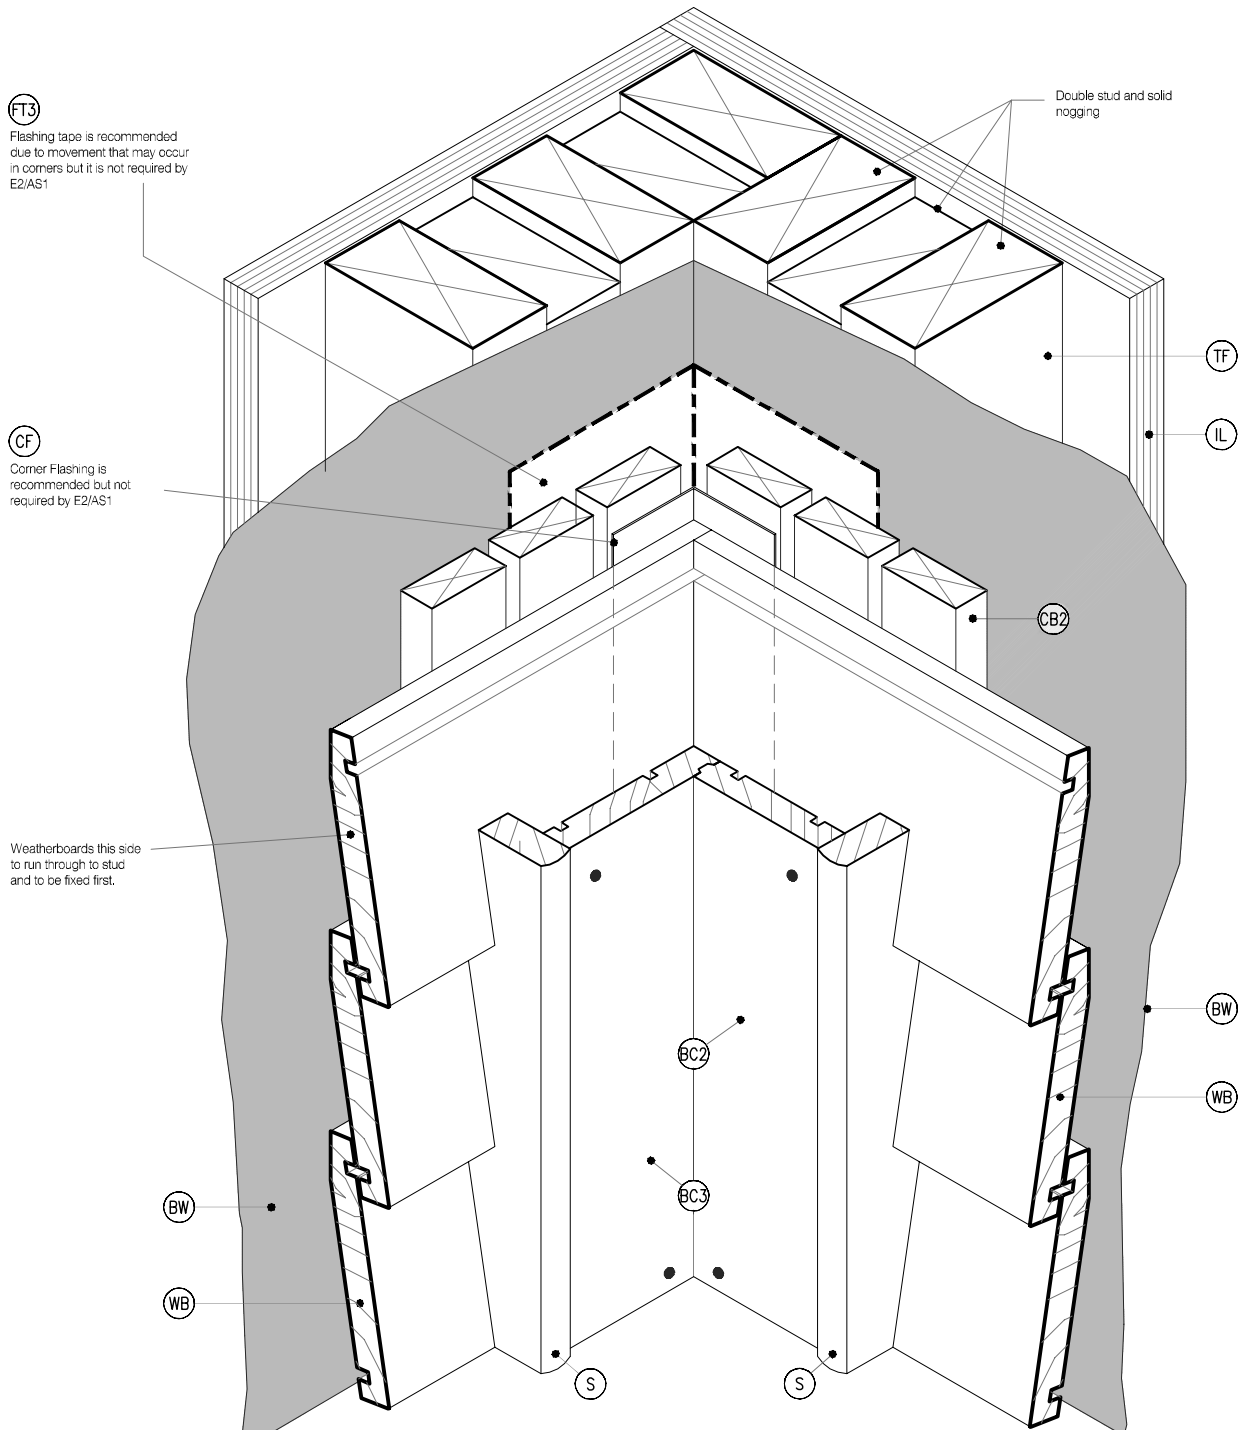


LEGEND:

- BC1** BOXED CORNER COVER : Southern Pine 100 x 18 H3.1 External box corner
- BC2** BOXED CORNER COVER : Southern Pine 87 x 18 H3.1 Reversible box corner
- BC3** BOXED CORNER COVER : Southern Pine 100 x 18 H3.1 Internal box corner
- CB2** CAVITY BATTEN, VERTICAL: 20mm x 45mm H3.1. To form a 20mm cavity.
- CB3** CAVITY BATTEN, VERTICAL - STRUCTURALLY FIXED : 45mm x 45mm SPP Radiata Pine, H3.2 70mm x 45mm SPP Radiata Pine, H3.2 To form a 45mm cavity
- BW** BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)

- CF** CORNER FLASHING: Aluminium, PVC or Stainless Steel corner flashing. Refer NZBC E2/AS1 4.3 50x50 Hem or Hook to Flashing Edges 75x75 NO, Hem or Hook Required EXTRA HIGH WIND ZONE 100x100 Hem or Hook to Flashing Edges, Refer NZBC E2/AS1 4.5.1
- FT3** FLEXIBLE FLASHING TAPE: Flexible flashing tape lapped into corner, Refer NZBC E2/AS1 4.3.11 Flashing tape is recommended due to movement that may occur in corners. (Not required by E2/AS1)
- FT4** FLEXIBLE FLASHING TAPE: Flexible flashing tape wrapped around pipe and over building wrap, Refer NZBC E2/AS1 4.3.11 & Figure 68

- IN** INSULATION: Selected Insulation
- PEF** PEF ROD BACKING: Foam backing rod with sealant to perimeter that forms a waterproof air-seal. (Sealant 2:1 Ratio)
- TF** TIMBER FRAME: H1.2 min treated timber framing
- IL** INTERNAL LINING: Selected Internal Lining
- WB** WEATHER BOARD: Southern Pine Bevel Back Weatherboard. Profile to NZS 3617
- WS** SCRIBER: Southern Pine H3.1, profile cut to fit weatherboard, sealant to back of scriber and 75 x 3.15mm 316 Stainless Steel nail in 3mm predrilled hole. 40x18 or 60x18 depending on weatherboard size

NOTE : Where 75x3,15 jolt head nails are referenced, these may be substituted for 75mm jolt head weatherboard screws

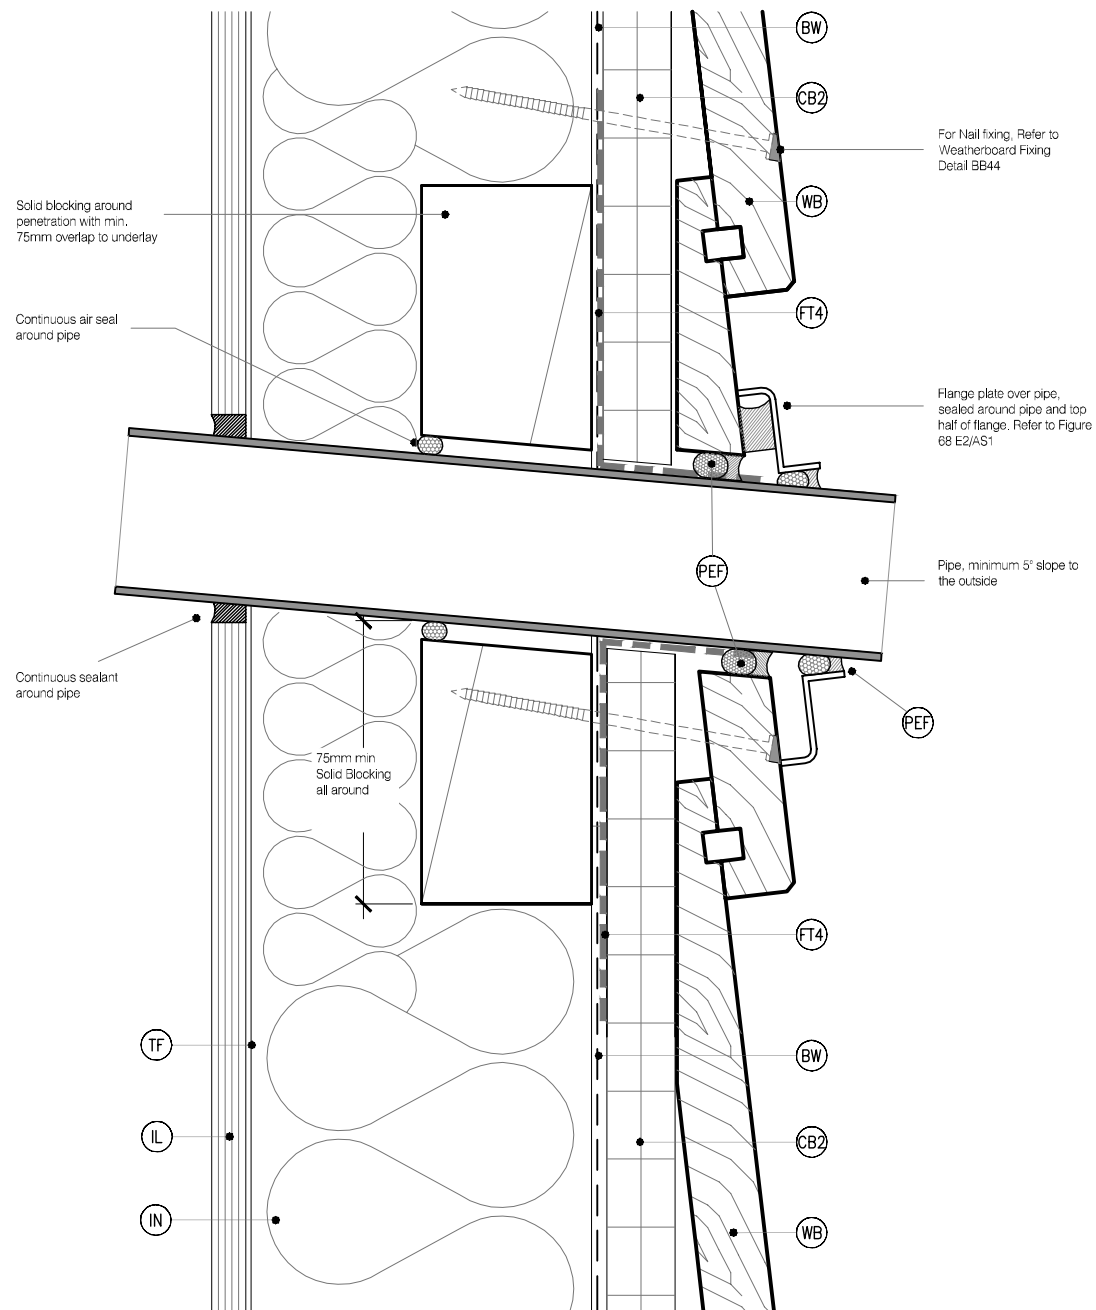


LEGEND:

- (BC1)** BOXED CORNER COVER : Southern Pine 100 x 18 H3.1 External box corner
- (BC2)** BOXED CORNER COVER : Southern Pine 87 x 18 H3.1 Reversible box corner
- (BC3)** BOXED CORNER COVER : Southern Pine 100 x 18 H3.1 Internal box corner
- (CB2)** CAVITY BATTEN, VERTICAL: 20mm x 45mm H3.1. To form a 20mm cavity.
- (CB3)** CAVITY BATTEN, VERTICAL - STRUCTURALLY FIXED : 45mm x 45mm SPP Radiata Pine, H3.2 70mm x 45mm SPP Radiata Pine, H3.2 To form a 45mm cavity
- (BW)** BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)

- (CF)** CORNER FLASHING: Aluminium, PVC or Stainless Steel corner flashing. Refer NZBC E2/AS1 4.3 50x50 Hem or Hook to Flashing Edges 75x75 NO, Hem or Hook Required EXTRA HIGH WIND ZONE 100x100 Hem or Hook to Flashing Edges, Refer NZBC E2/AS1 4.5.1
- (FT3)** FLEXIBLE FLASHING TAPE: Flexible flashing tape lapped into corner, Refer NZBC E2/AS1 4.3.11 Flashing tape is recommended due to movement that may occur in corners. (Not required by E2/AS1)
- (FT4)** FLEXIBLE FLASHING TAPE: Flexible flashing tape wrapped around pipe and over building wrap, Refer NZBC E2/AS1 4.3.11 & Figure 68

- (IN)** INSULATION: Selected Insulation
- (PEF)** PEF ROD BACKING: Foam backing rod with sealant to perimeter that forms a waterproof air-seal. (Sealant 2:1 Ratio)
- (TF)** TIMBER FRAME: H1.2 min treated timber framing
- (IL)** INTERNAL LINING: Selected Internal Lining
- (WB)** WEATHER BOARD: Southern Pine Bevel Back Weatherboard. Profile to NZS 3617
- (WS)** SCRIBER: Southern Pine H3.1, profile cut to fit weatherboard, sealant to back of scribe and 75 x 3.15mm 316 Stainless Steel nail in 3mm predrilled hole. 40x18 or 60x18 depending on weatherboard size

NOTE : Where 75x3.15 jolt head nails are referenced, these may be substituted for 75mm jolt head weatherboard screws

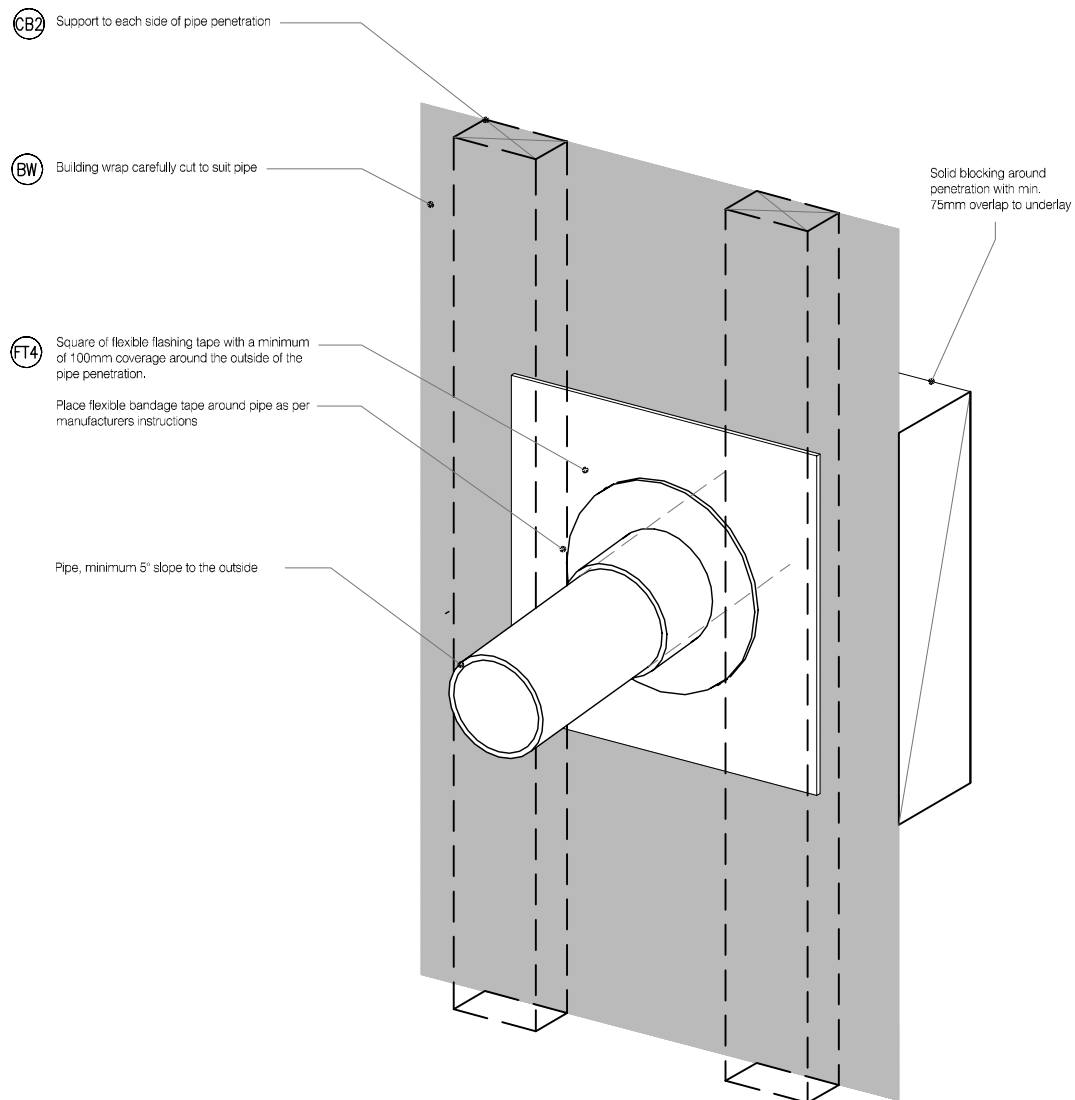


LEGEND:

- BC1** BOXED CORNER COVER : Southern Pine 100 x 18 H3.1 External box corner
- BC2** BOXED CORNER COVER : Southern Pine 87 x 18 H3.1 Reversible box corner
- BC3** BOXED CORNER COVER : Southern Pine 100 x 18 H3.1 Internal box corner
- CB2** CAVITY BATTEN, VERTICAL: 20mm x 45mm H3.1. To form a 20mm cavity.
- CB3** CAVITY BATTEN, VERTICAL - STRUCTURALLY FIXED : 45mm x 45mm SPP Radiata Pine, H3.2 70mm x 45mm SPP Radiata Pine, H3.2 To form a 45mm cavity
- BW** BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)

- CF** CORNER FLASHING: Aluminium, PVC or Stainless Steel corner flashing. Refer NZBC E2/AS1 4.3 50x50 Hem or Hook to Flashing Edges 75x75 NO, Hem or Hook Required EXTRA HIGH WIND ZONE 100x100 Hem or Hook to Flashing Edges, Refer NZBC E2/AS1 4.5.1
- FT3** FLEXIBLE FLASHING TAPE: Flexible flashing tape lapped into corner, Refer NZBC E2/AS1 4.3.11 Flashing tape is recommended due to movement that may occur in corners. (Not required by E2/AS1)
- FT4** FLEXIBLE FLASHING TAPE: Flexible flashing tape wrapped around pipe and over building wrap, Refer NZBC E2/AS1 4.3.11 & Figure 68

- IN** INSULATION: Selected Insulation
- PEF** PEF ROD BACKING: Foam backing rod with sealant to perimeter that forms a waterproof air-seal. (Sealant 2:1 Ratio)
- TF** TIMBER FRAME: H1.2 min treated timber framing
- IL** INTERNAL LINING: Selected Internal Lining
- WB** WEATHER BOARD: Southern Pine Bevel Back Weatherboard. Profile to NZS 3617
- WS** SCRIBER: Southern Pine H3.1, profile cut to fit weatherboard, sealant to back of scribe and 75 x 3.15mm 316 Stainless Steel nail in 3mm predrilled hole. 40x18 or 60x18 depending on weatherboard size


NOTE : Where 75x3.15 jolt head nails are referenced, these may be substituted for 75mm jolt head weatherboard screws

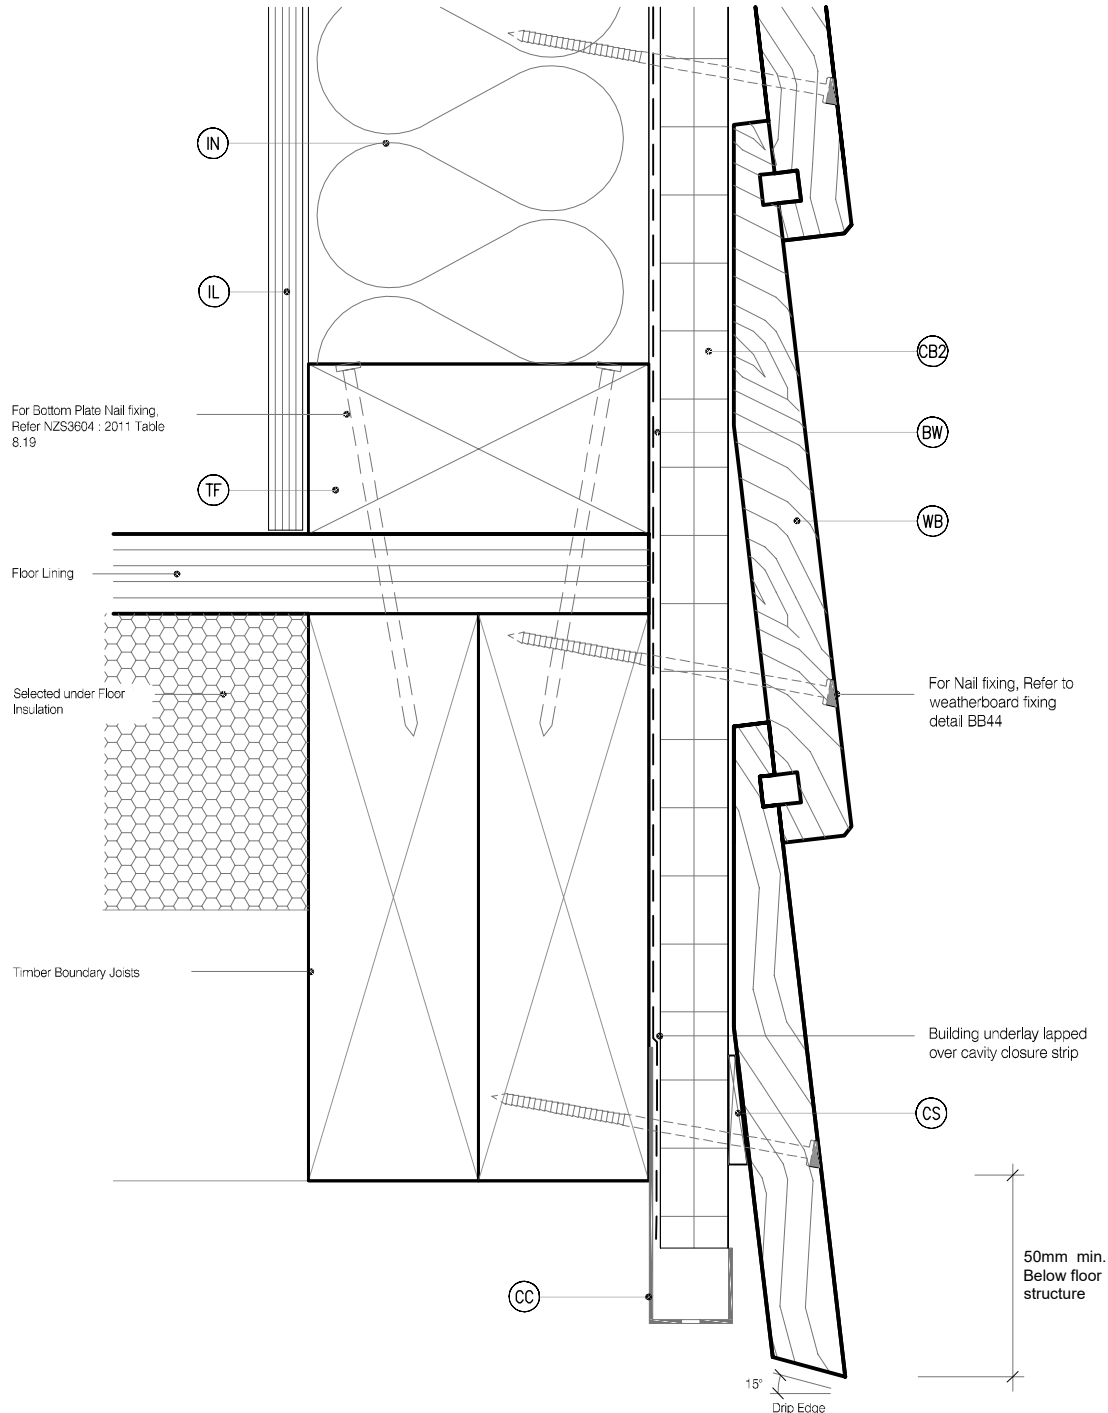

LEGEND :

- | | | |
|--|--|--|
| <p>(AF) APRON FLASHING: Materials as per E2/AS1 4.0, Coating to match roofing material or refer E2/AS1 Table 21. Flashing Cover 130mm min. (L,M & H ≥ 10°) All others 200mm Refer Table 7 E2/AS1</p> <p>(BW) BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)</p> <p>(CC) CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm Min drip edge to cladding</p> <p>(IL) INTERNAL LINING: Selected Internal Lining</p> <p>(IN) INSULATION: Selected Insulation</p> | <p>(CB2) CAVITY BATTEN, VERTICAL: 20mm x 45mm H3.1. To form a 20mm cavity.</p> <p>(CB3) CAVITY BATTEN, VERTICAL - STRUCTURALLY FIXED : 45mm x 45mm SPP Radiata Pine, H3.2 70mm x 45mm SPP Radiata Pine, H3.2 To form a 45mm cavity</p> <p>(HS) HEAD SOFFIT SCRIBER: Southern Pine Eaves Mould EM40x27. Fix with 75 x 3.15 316 SS nail in 2.5mm predrilled hole (spaced off cladding with 5mm EPDM washer to provide ventilation. Recommended moisture control, but not required by E2/AS1</p> <p>(MR) METAL ROOFING : Selected Metal Roofing</p> | <p>(CS) CANT STRIP: Southern Pine H3.1 Cant Strip 25mm x 9 mm</p> <p>(SL) SOFFIT LINING: Selected Soffit Lining</p> <p>(TP) TIMBER PACKER: Cant Strip, H3.2 Treated at 300crs to allow ventilation over the top of the wall.</p> <p>(TF) TIMBER FRAME: H1.2 min treated timber framing</p> <p>(RU) ROOFING UNDERLAY: Selected Roofing Underlay As Per AS/AZS4200 with Mesh or Self Supported</p> <p>(WB) WEATHER BOARD: Southern Pine Bevel Back Weatherboard, Profile to NZS 3617</p> |
|--|--|--|


NOTE : Where 75x3.15 jolt head nails are referenced, these may be substituted for 75mm jolt head weatherboard screws

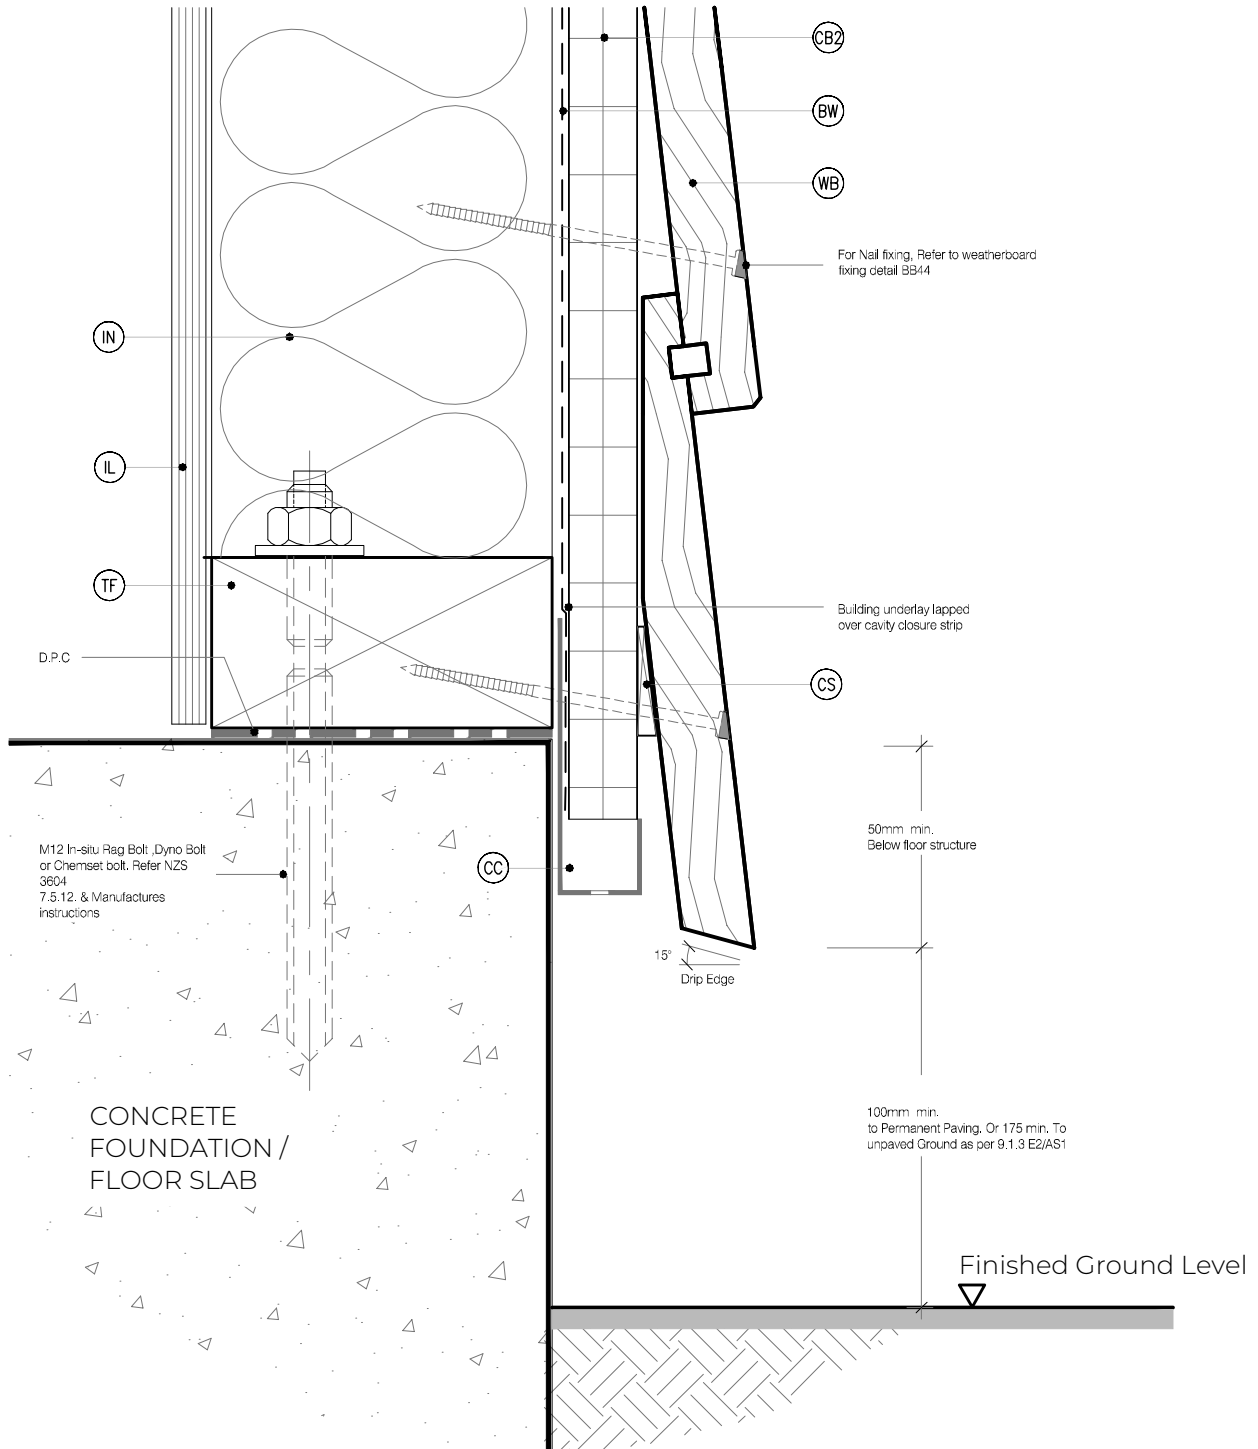

LEGEND:

- | | | |
|--|--|--|
| <p>AF APRON FLASHING: Materials as per E2/AS1 4.0, Coating to match roofing material or refer E2/AS1 Table 21. Flashing Cover 130mm min. (L,M & H ≥ 10°) All others 200mm Refer Table 7 E2/AS1</p> <p>BW BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)</p> <p>CC CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm Min drip edge to cladding</p> <p>IL INTERNAL LINING: Selected Internal Lining</p> <p>IN INSULATION: Selected Insulation</p> | <p>CB2 CAVITY BATTEN, VERTICAL: 20mm x 45mm H3.1. To form a 20mm cavity.</p> <p>CB3 CAVITY BATTEN, VERTICAL - STRUCTURALLY FIXED : 45mm x 45mm SPP Radiata Pine, H3.2 70mm x 45mm SPP Radiata Pine, H3.2 To form a 45mm cavity</p> <p>HS HEAD SOFFIT SCRIBER: Southern Pine Eaves Mould EM40x27. Fix with 75 x 3.15 316 SS nail in 2.5mm predrilled hole (spaced off cladding with 5mm EPDM washer to provide ventilation. Recommended moisture control, but not required by E2/AS1</p> <p>MR METAL ROOFING : Selected Metal Roofing</p> | <p>CS CANT STRIP: Southern Pine H3.1 Cant Strip 25mm x 9 mm</p> <p>SL SOFFIT LINING: Selected Soffit Lining</p> <p>TP TIMBER PACKER: Cant Strip, H3.2 Treated at 300crs to allow ventilation over the top of the wall.</p> <p>TF TIMBER FRAME: H1.2 min treated timber framing</p> <p>RU ROOFING UNDERLAY: Selected Roofing Underlay As Per AS/AZS4200 with Mesh or Self Supported</p> <p>WB WEATHER BOARD: Southern Pine Bevel Back Weatherboard. Profile to NZS 3617</p> |
|--|--|--|


NOTE : Where 75x3.15 jolt head nails are referenced, these may be substituted for 75mm jolt head weatherboard screws

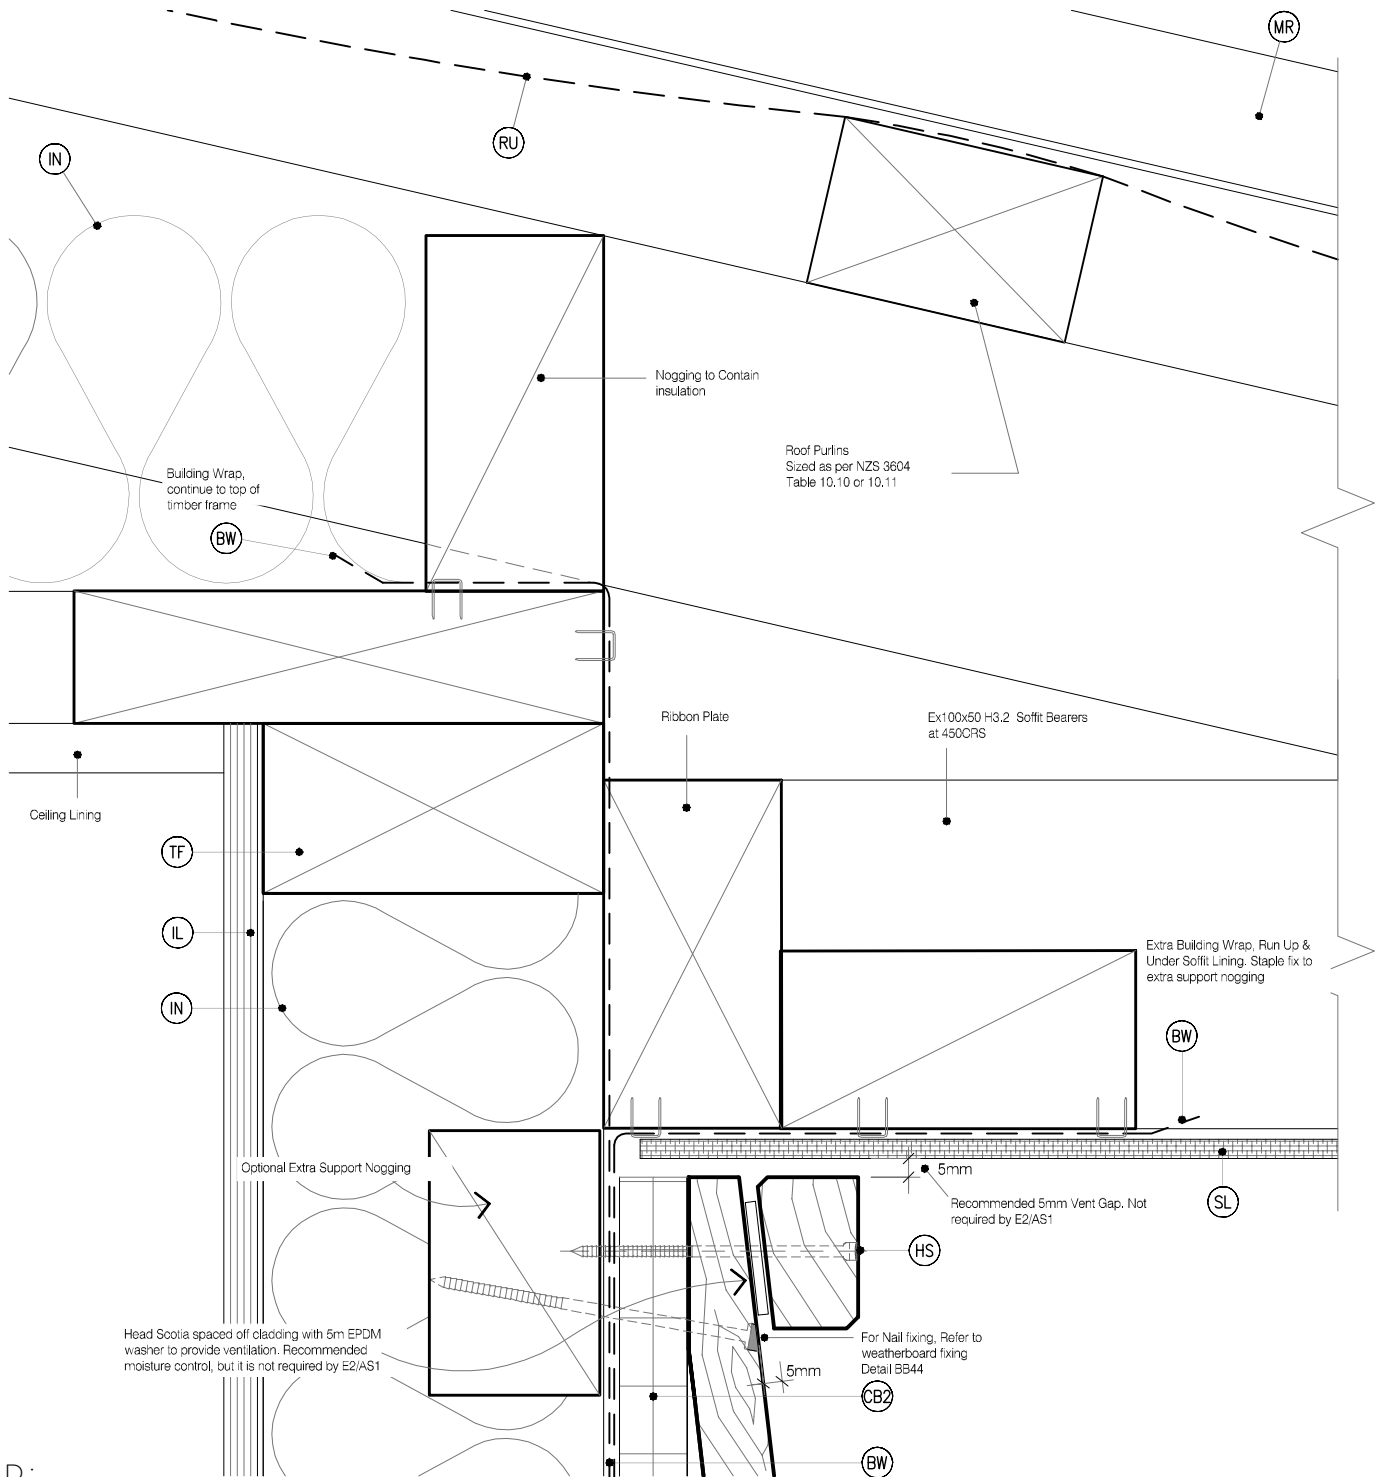

LEGEND:

- | | | | | | |
|-------------|---|--------------|---|-------------|---|
| (AF) | APRON FLASHING: Materials as per E2/AS1 4.0, Coating to match roofing material or refer E2/AS1 Table 21. Flashing Cover 130mm min. (L,M & H ≥ 10°) All others 200mm Refer Table 7 E2/AS1 | (CB2) | CAVITY BATTEN, VERTICAL: 20mm x 45mm H3.1. To form a 20mm cavity. | (CS) | CANT STRIP: Southern Pine H3.1
Cant Strip 25mm x 9 mm |
| (BW) | BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Riddig Underlay required (9.1.7.2 E2/AS1) | (CB3) | CAVITY BATTEN, VERTICAL - STRUCTURALLY FIXED : 45mm x 45mm SPP Radiata Pine, H3.2
70mm x 45mm SPP Radiata Pine, H3.2
To form a 45mm cavity | (SL) | SOFFIT LINING: Selected Soffit Lining |
| (CC) | CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm Min drip edge to cladding | (HS) | HEAD SOFFIT SCRIBER: Southern Pine Eaves Mould EM40x27. Fix with 75 x 3.15 316 SS nail in 2,5mm predrilled hole (spaced off cladding with 5mm EPDM washer to provide ventilation. Recommended moisture control, but not required by E2/AS1 | (TP) | TIMBER PACKER: Cant Strip, H3.2 Treated at 300crs to allow ventilation over the top of the wall. |
| (IL) | INTERNAL LINING: Selected Internal Lining | (MR) | METAL ROOFING : Selected Metal Roofing | (TF) | TIMBER FRAME: H1.2 min treated timber framing |
| (IN) | INSULATION: Selected Insulation | | | (RU) | ROOFING UNDERLAY: Selected Roofing Underlay As Per AS/AZS4200 with Mesh or Self Supported |
| | | | | (WB) | WEATHER BOARD: Southern Pine Bevel Back Weatherboard. Profile to NZS 3617 |


NOTE : Where 75x3.15 jolt head nails are referenced, these may be substituted for 75mm jolt head weatherboard screws

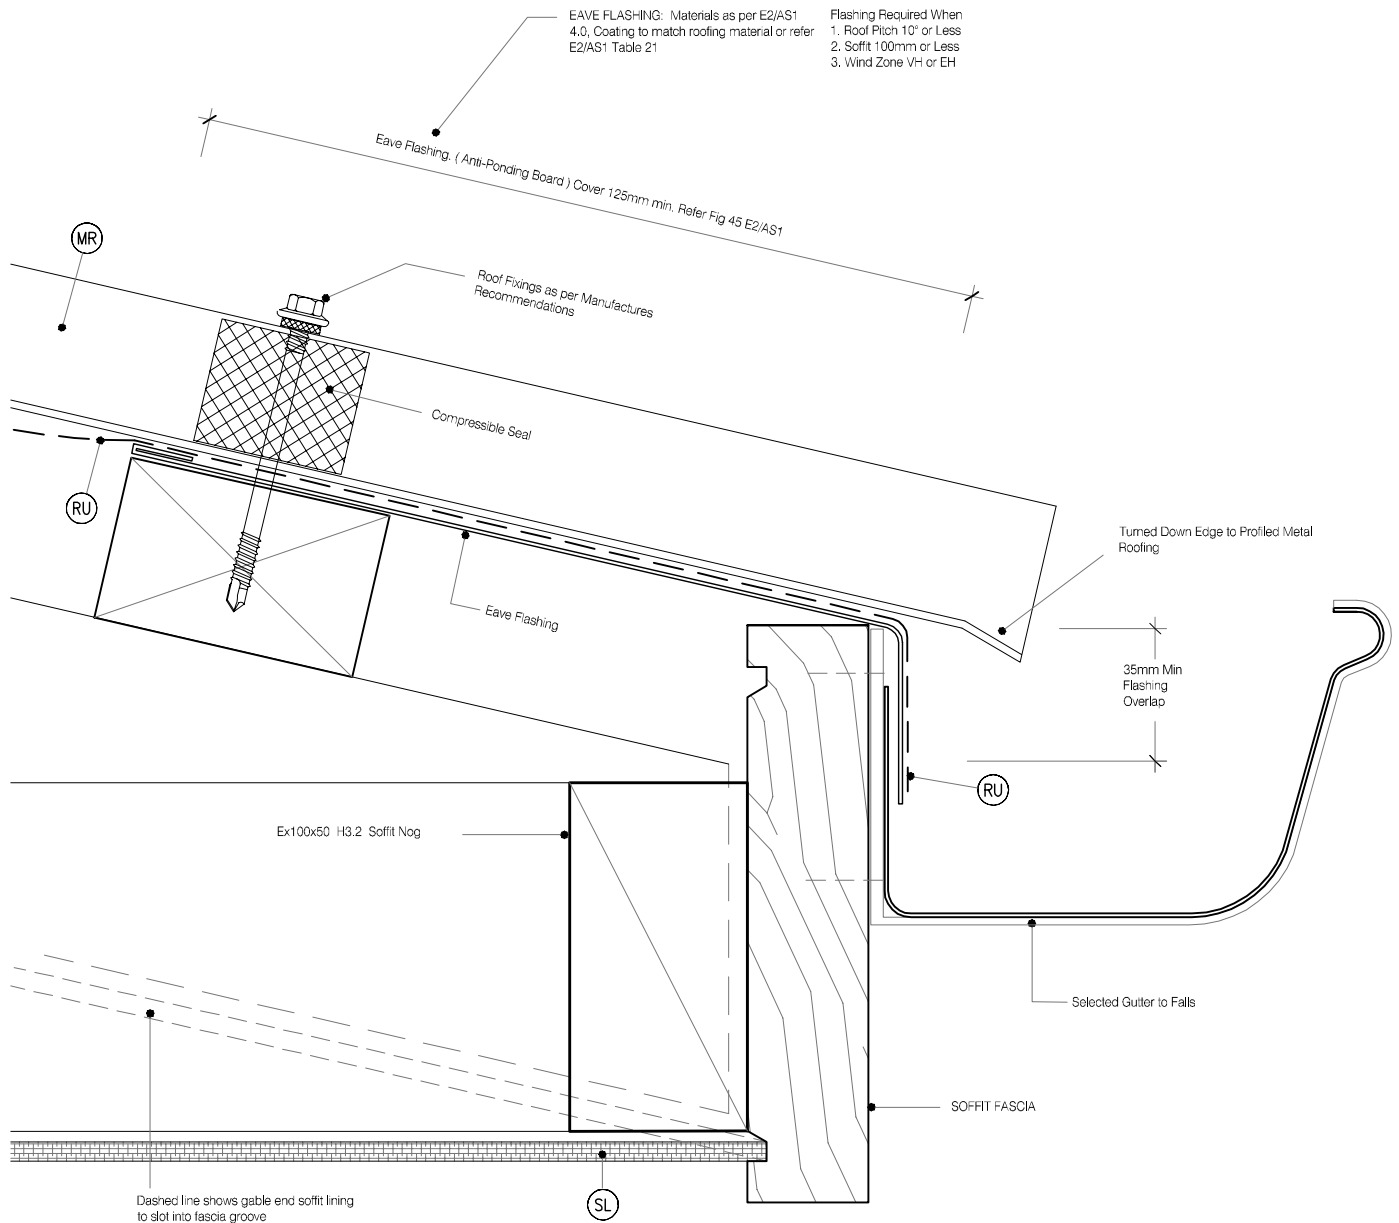

LEGEND:

- | | | |
|---|--|--|
| <p>(AF) APRON FLASHING: Materials as per E2/AS1 4.0, Coating to match roofing material or refer E2/AS1 Table 21. Flashing Cover 130mm min. (L, M & H $\geq 10^\circ$) All others 200mm Refer Table 7 E2/AS1</p> <p>(BW) BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)</p> <p>(CC) CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm Min drip edge to cladding</p> <p>(IL) INTERNAL LINING: Selected Internal Lining</p> <p>(IN) INSULATION: Selected Insulation</p> | <p>(CB2) CAVITY BATTEN, VERTICAL: 20mm x 45mm H3.1. To form a 20mm cavity.</p> <p>(CB3) CAVITY BATTEN, VERTICAL - STRUCTURALLY FIXED: 45mm x 45mm SPP Radiata Pine, H3.2 70mm x 45mm SPP Radiata Pine, H3.2 To form a 45mm cavity</p> <p>(HS) HEAD SOFFIT SCRIBER: Southern Pine Eaves Mould EM40x27. Fix with 75 x 3.15 316 SS nail in 2.5mm predrilled hole (spaced off cladding with 5mm EPDM washer to provide ventilation. Recommended moisture control, but not required by E2/AS1</p> <p>(MR) METAL ROOFING: Selected Metal Roofing</p> | <p>(CS) CANT STRIP: Southern Pine H3.1 Cant Strip 25mm x 9 mm</p> <p>(SL) SOFFIT LINING: Selected Soffit Lining</p> <p>(TP) TIMBER PACKER: Cant Strip, H3.2 Treated at 300crs to allow ventilation over the top of the wall.</p> <p>(TF) TIMBER FRAME: H1.2 min treated timber framing</p> <p>(RU) ROOFING UNDERLAY: Selected Roofing Underlay As Per AS/AZS4200 with Mesh or Self Supported</p> <p>(WB) WEATHER BOARD: Southern Pine Bevel Back Weatherboard. Profile to NZS 3617</p> |
|---|--|--|


NOTE: Where 75x3.15 jolt head nails are referenced, these may be substituted for 75mm jolt head weatherboard screws

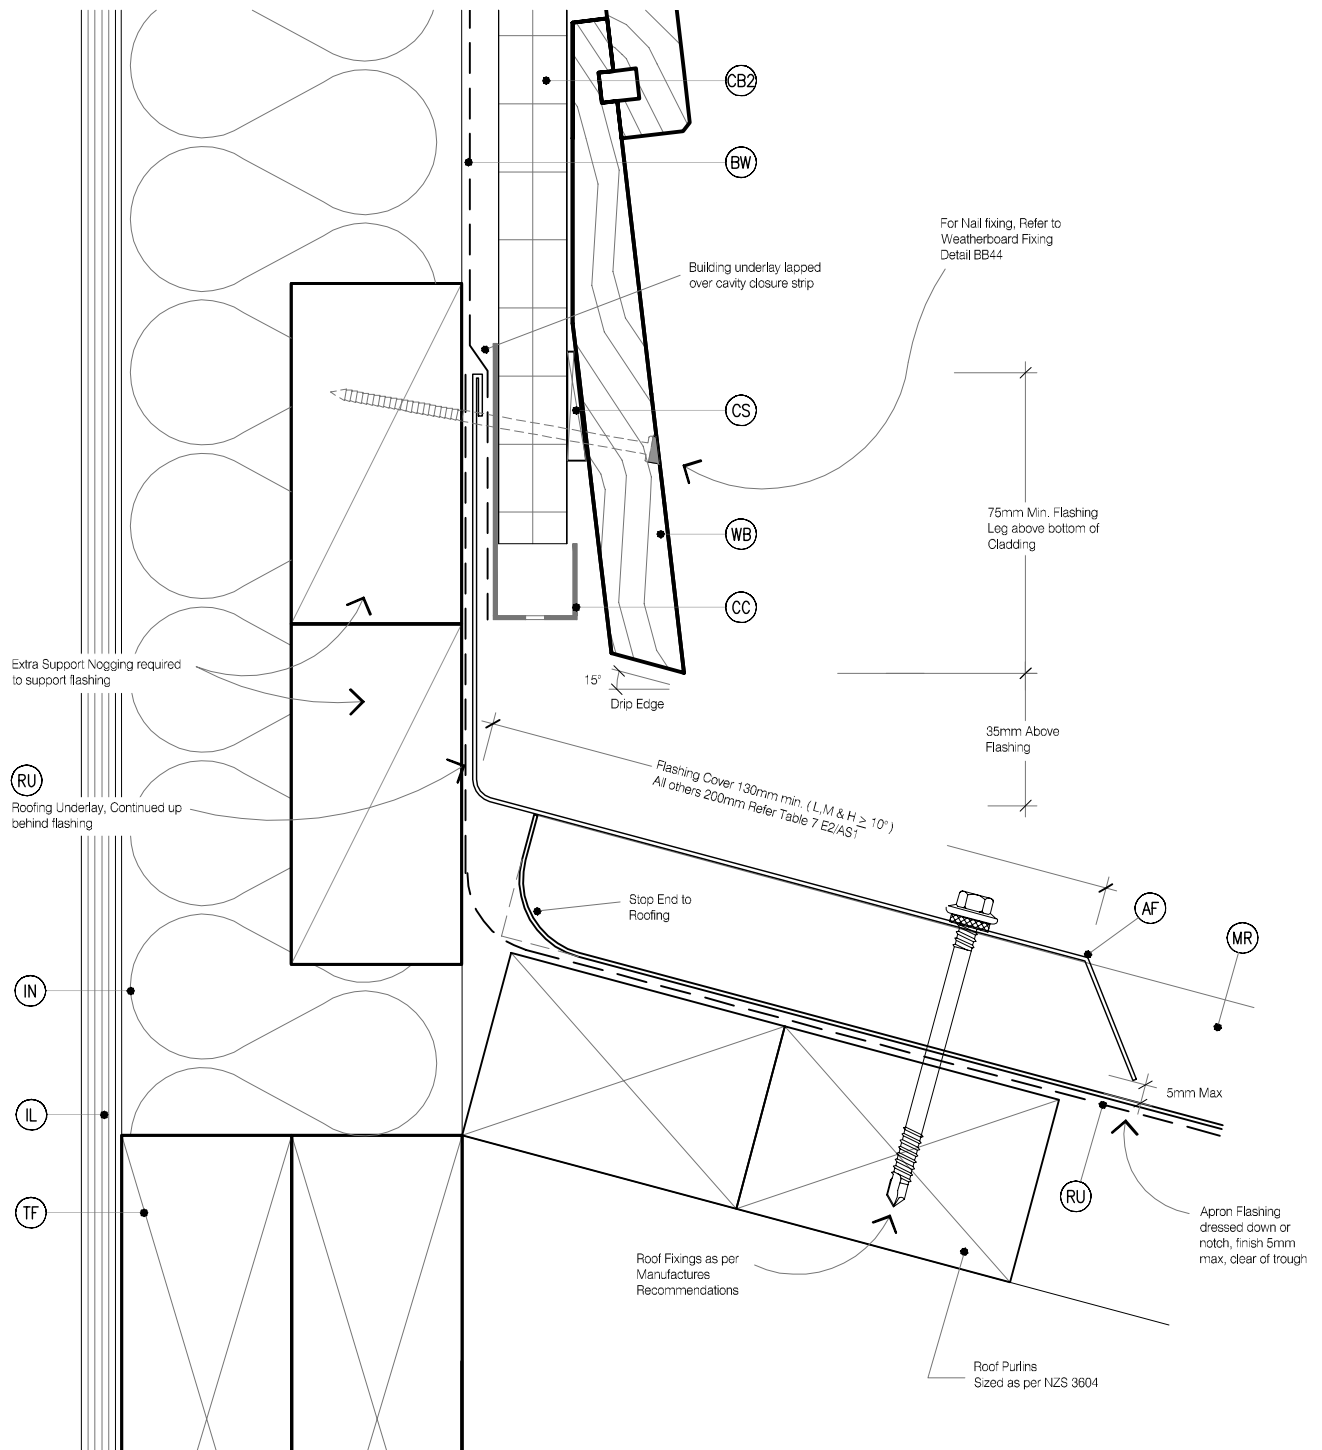

LEGEND:

- | | | |
|---|--|--|
| <p>AF APRON FLASHING: Materials as per E2/AS1 4.0, Coating to match roofing material or refer E2/AS1 Table 21. Flashing Cover 130mm min. (L & H $\geq 10^\circ$) All others 200mm Refer Table 7 E2/AS1</p> <p>BW BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)</p> <p>CC CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm Min drip edge to cladding</p> <p>IL INTERNAL LINING: Selected Internal Lining</p> <p>IN INSULATION: Selected Insulation</p> | <p>CB2 CAVITY BATTEN, VERTICAL: 20mm x 45mm H3.1. To form a 20mm cavity.</p> <p>CB3 CAVITY BATTEN, VERTICAL - STRUCTURALLY FIXED: 45mm x 45mm SPP Radiata Pine, H3.2 70mm x 45mm SPP Radiata Pine, H3.2 To form a 45mm cavity</p> <p>HS HEAD SOFFIT SCRIBER: Southern Pine Eaves Mould EM40x27. Fix with 75 x 3.15 316 SS nail in 2.5mm predrilled hole (spaced off cladding with 5mm EPDM washer to provide ventilation. Recommended moisture control, but not required by E2/AS1</p> <p>MR METAL ROOFING: Selected Metal Roofing</p> | <p>CS CANT STRIP: Southern Pine H3.1 Cant Strip 25mm x 9 mm</p> <p>SL SOFFIT LINING: Selected Soffit Lining</p> <p>TP TIMBER PACKER: Cant Strip, H3.2 Treated at 300crs to allow ventilation over the top of the wall.</p> <p>TF TIMBER FRAME: H1.2 min treated timber framing</p> <p>RU ROOFING UNDERLAY: Selected Roofing Underlay As Per AS/AZS4200 with Mesh or Self Supported</p> <p>WB WEATHER BOARD: Southern Pine Bevel Back Weatherboard. Profile to NZS 3617</p> |
|---|--|--|


NOTE: Where 75x3.15 jolt head nails are referenced, these may be substituted for 75mm jolt head weatherboard screws

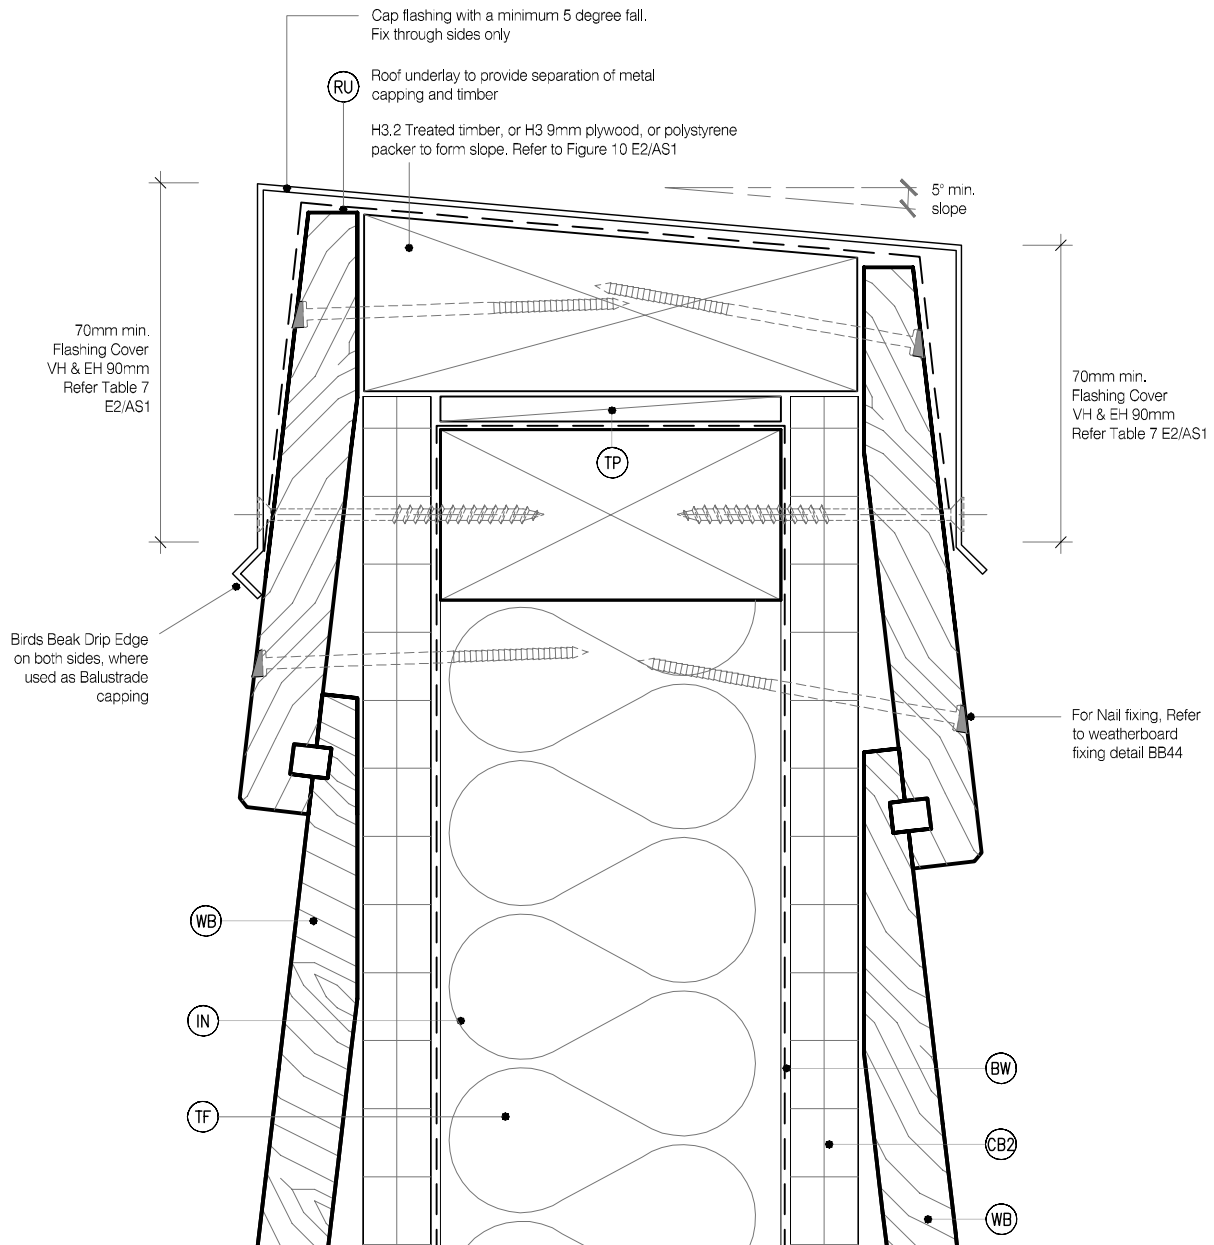

LEGEND:

- | | | |
|---|--|--|
| <p>(AF) APRON FLASHING: Materials as per E2/AS1 4.0, Coating to match roofing material or refer E2/AS1 Table 21, Flashing Cover 130mm min. (L, M & H ≥ 10°) All others 200mm Refer Table 7 E2/AS1</p> <p>(BW) BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)</p> <p>(CC) CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm Min drip edge to cladding</p> <p>(IL) INTERNAL LINING: Selected Internal Lining</p> <p>(IN) INSULATION: Selected Insulation</p> | <p>(CB2) CAVITY BATTEN, VERTICAL: 20mm x 45mm H3.1. To form a 20mm cavity.</p> <p>(CB3) CAVITY BATTEN, VERTICAL - STRUCTURALLY FIXED: 45mm x 45mm SPP Radiata Pine, H3.2 70mm x 45mm SPP Radiata Pine, H3.2 To form a 45mm cavity</p> <p>(HS) HEAD SOFFIT SCRIBER: Southern Pine Eaves Mould EM40x27. Fix with 75 x 3.15 316 SS nail in 2.5mm predrilled hole (spaced off cladding with 5mm EPDM washer to provide ventilation. Recommended moisture control, but not required by E2/AS1</p> <p>(MR) METAL ROOFING: Selected Metal Roofing</p> | <p>(CS) CANT STRIP: Southern Pine H3.1 Cant Strip 25mm x 9 mm</p> <p>(SL) SOFFIT LINING: Selected Soffit Lining</p> <p>(TP) TIMBER PACKER: Cant Strip, H3.2 Treated at 300crs to allow ventilation over the top of the wall.</p> <p>(TF) TIMBER FRAME: H1.2 min treated timber framing</p> <p>(RU) ROOFING UNDERLAY: Selected Roofing Underlay As Per AS/AZS4200 with Mesh or Self Supported</p> <p>(WB) WEATHER BOARD: Southern Pine Bevel Back Weatherboard. Profile to NZS 3617</p> |
|---|--|--|


NOTE: Where 75x3.15 jolt head nails are referenced, these may be substituted for 75mm jolt head weatherboard screws

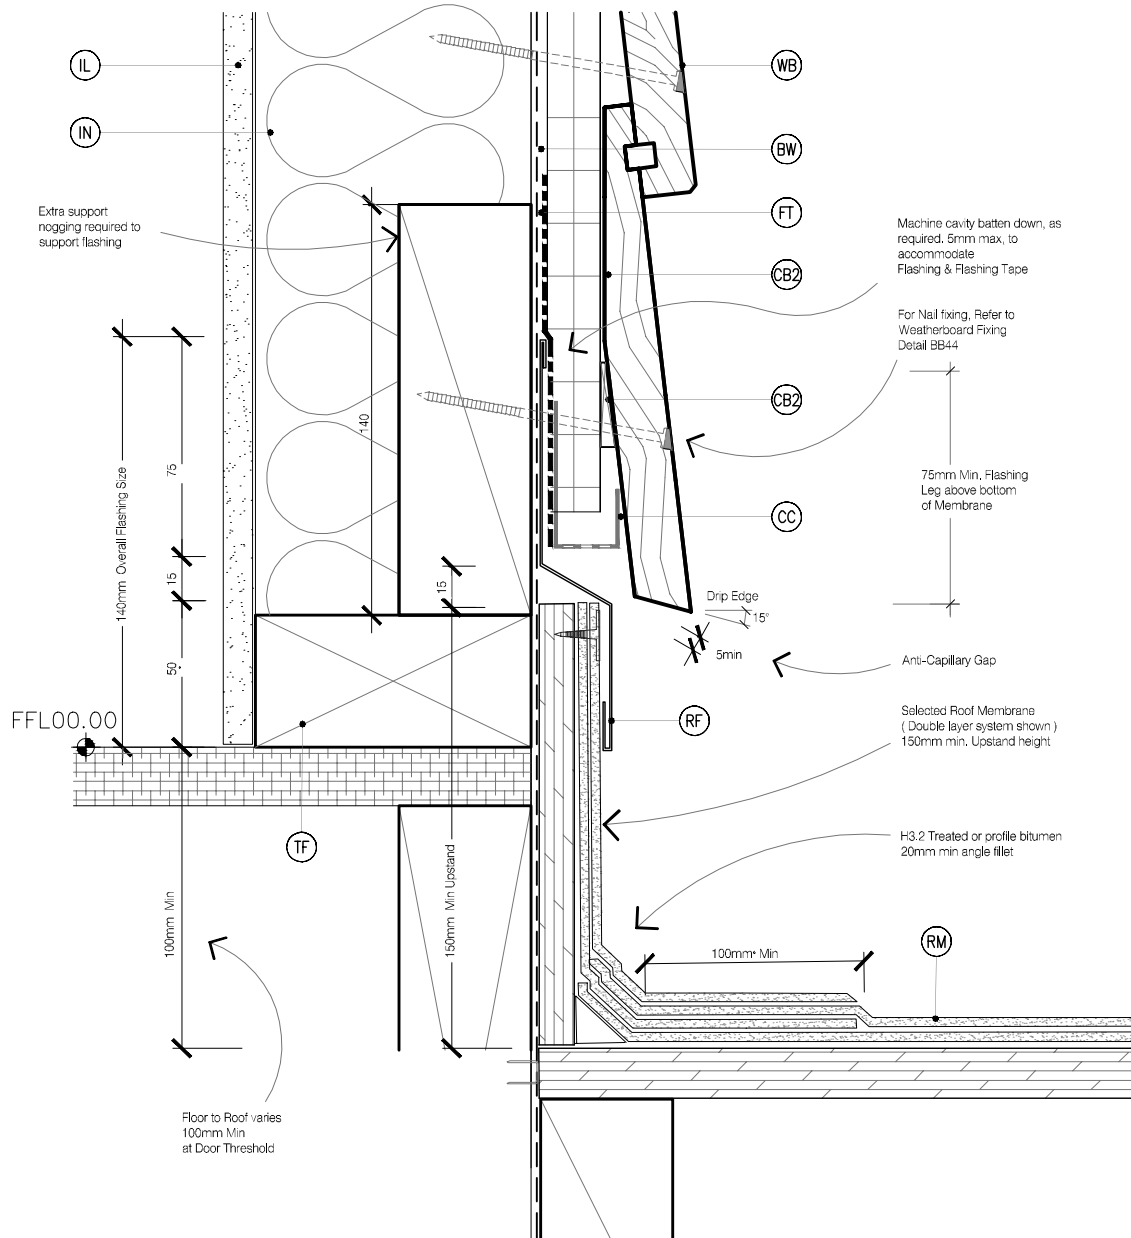

LEGEND:

(PSF) PARAPET SADDLE FLASHING: Materials as per E2/AS1 4.0, refer E2/AS1 Figure 11 & 12. Typically 0.45mm Min 316 Stainless Steel. Refer Table 20 & Table 21 for Comparability of Materials in Contact	(CB2) CAVITY BATTEN, VERTICAL: 20mm x 45mm H3.1. To form a 20mm cavity.	(IN) INSULATION: Selected Insulation
(BW) BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)	(CB3) CAVITY BATTEN, VERTICAL - STRUCTURALLY FIXED: 45mm x 45mm SPP Radiata Pine, H3.2 70mm x 45mm SPP Radiata Pine, H3.2 To form a 45mm cavity	(RF) ROOF FLASHING: Materials as per E2/AS1 4.3
(FT) FLASHING TAPE: As per E2/AS1 4.3.11	(RM) ROOFING MEMBRANE: Selected System on 17mm CCA treated H3.2 grade plywood glued and screwed to Rafter. Roof Membrane requires 400mm solid block support each way & solid support to all sheet edges	(PB) PLYWOOD BACKING: 17mm CCA treated H3.2 grade plywood substrate
(CC) CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm Min drip edge to cladding		(CF) CAP FLASHING: Continuous parapet flashing. Materials as per E2/AS1 4.3 + Figure 9 & Table 7
(IL) INTERNAL LINING: Selected Internal Lining		(TF) TIMBER FRAME: H1.2 min treated timber framing
		(WB) WEATHER BOARD: Southern Pine Bevel Back Weatherboard. Profile to NZS 3617

NOTE : Where 75x3.15 jolt head nails are referenced, these may be substituted for 75mm jolt head weatherboard screws

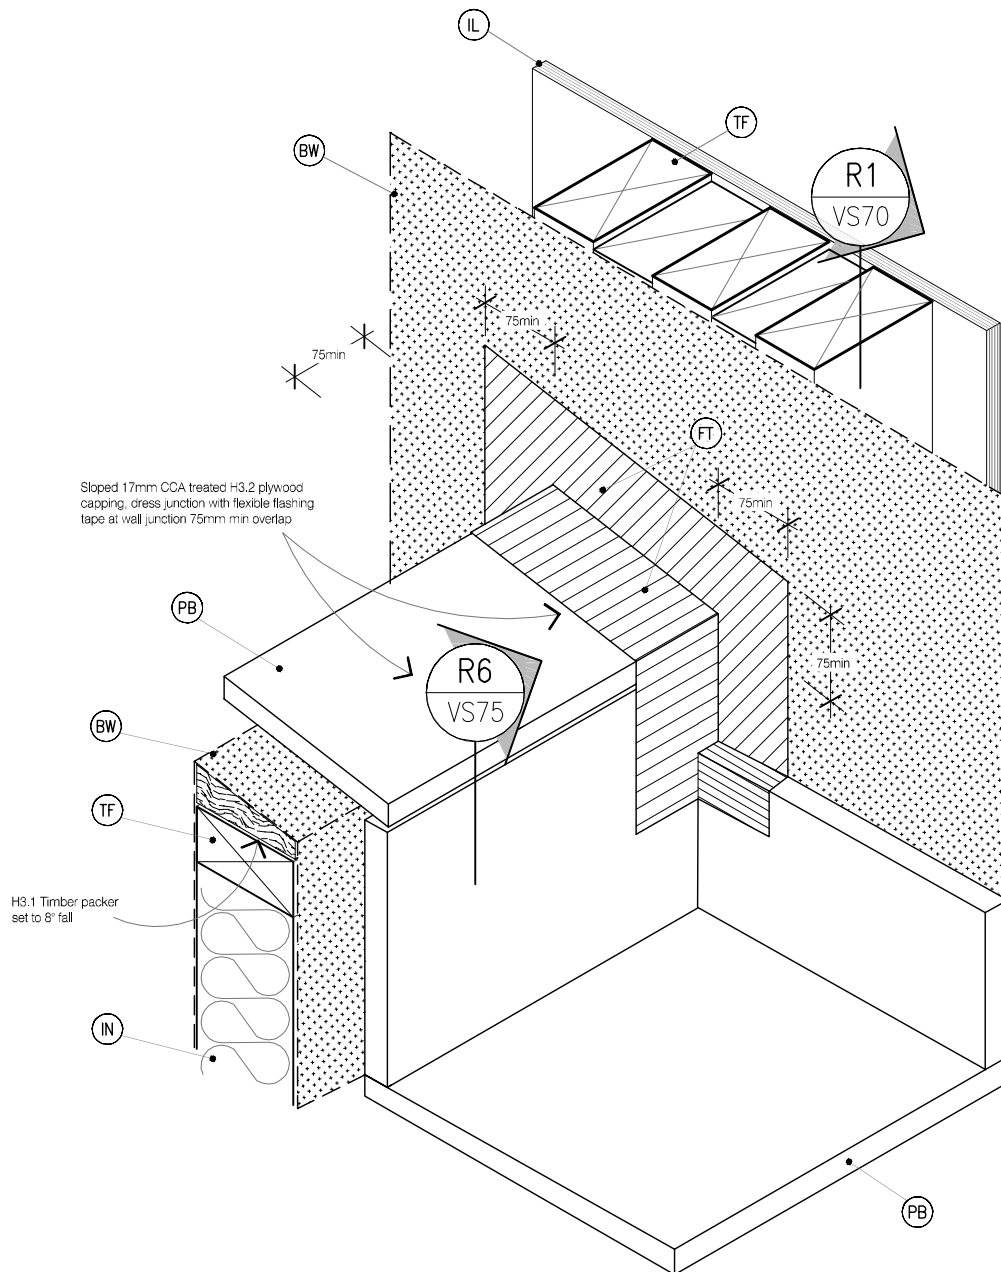

LEGEND:



PARAPET SADDLE FLASHING: Materials as per E2/AS1 4.0, refer E2/AS1 Figure 11 & 12. Typically 0.45mm Min 316 Stainless Steel. Refer Table 20 & Table 21 for Comparability of Materials in Contact



BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)



FLASHING TAPE: As per E2/AS1 4.3.11



CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm Min drip edge to cladding



INTERNAL LINING: Selected Internal Lining



CAVITY BATTEN, VERTICAL: 20mm x 45mm H3.1. To form a 20mm cavity.



CAVITY BATTEN, VERTICAL - STRUCTURALLY FIXED: 45mm x 45mm SPP Radiata Pine, H3.2 70mm x 45mm SPP Radiata Pine, H3.2 To form a 45mm cavity



ROOFING MEMBRANE: Selected System on 17mm CCA treated H3.2 grade plywood glued and screwed to Rafters. Roof Membrane requires 400mm solid block support each way & solid support to all sheet edges



INSULATION: Selected Insulation



ROOF FLASHING: Materials as per E2/AS1 4.3



PLYWOOD BACKING: 17mm CCA treated H3.2 grade plywood substrate



CAP FLASHING: Continuous parapet flashing. Materials as per E2/AS1 4.3 + Figure 9 & Table 7




TIMBER FRAME: H1.2 min treated timber framing



WEATHER BOARD: Southern Pine Bevel Back Weatherboard. Profile to NZS 3617

NOTE: Where 75x3.15 jolt head nails are referenced, these may be substituted for 75mm jolt head weatherboard screws

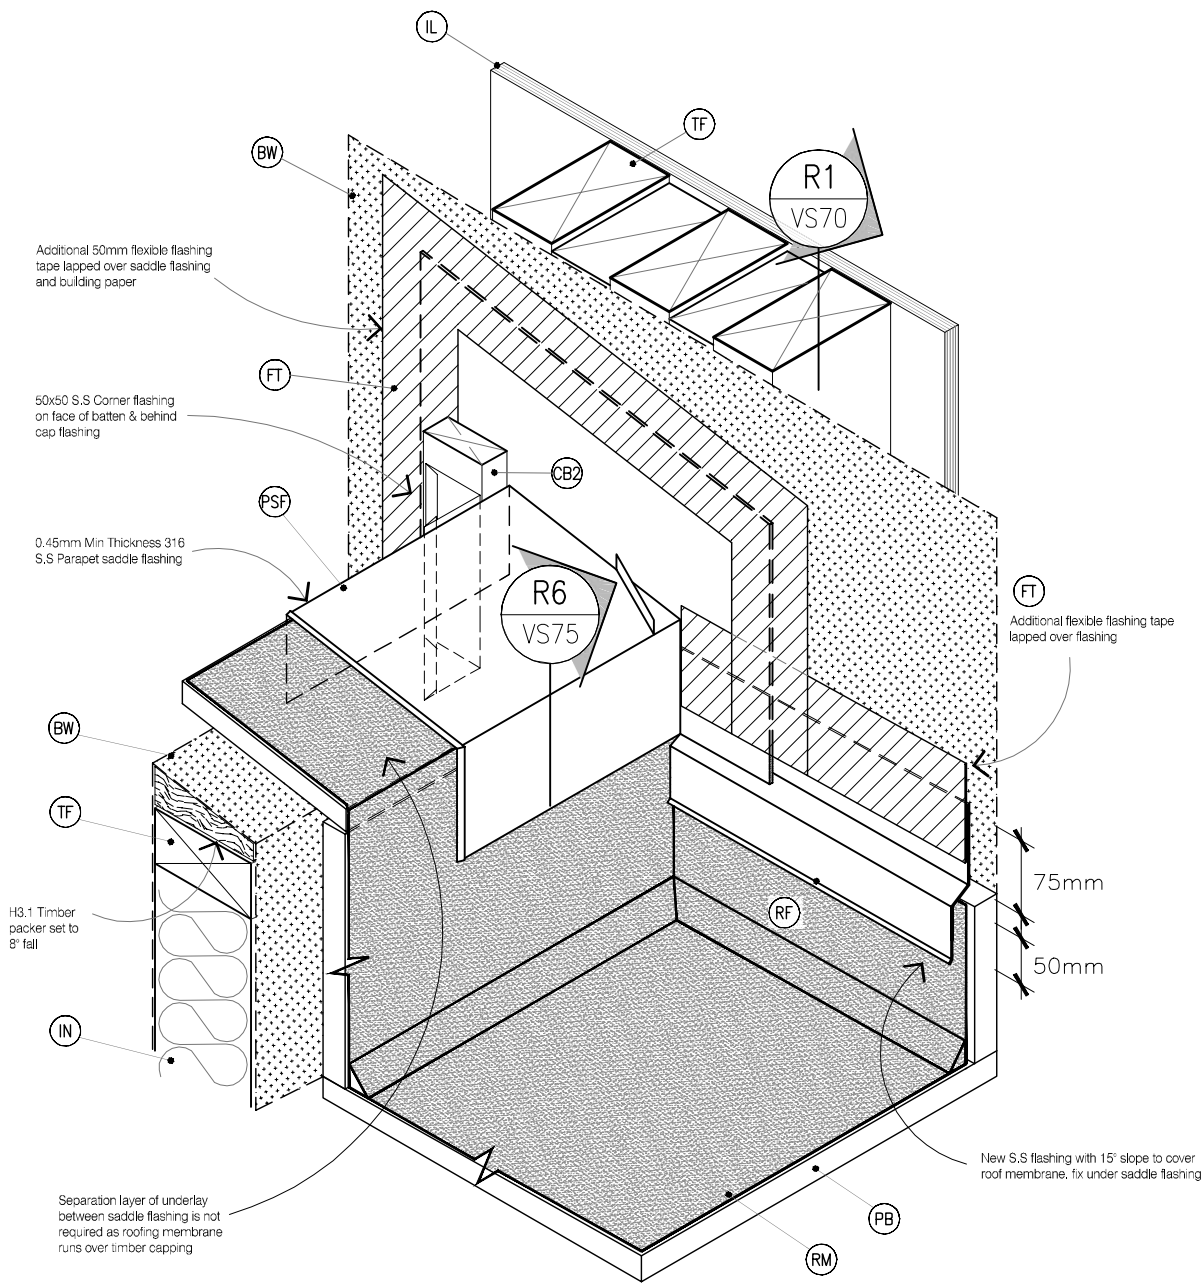


STAGE TWO

LEGEND :

(PSF)	PARAPET SADDLE FLASHING: Materials as per E2/AS1 4.0, refer E2/AS1 Figure 11 & 12 . Typically 0.45mm Min 316 Stainless Steel. Refer Table 20 & Table 21 for Comparability of Materials in Contact	(CB2)	CAVITY BATTEN, VERTICAL: 20mm x 45mm H3.1. To form a 20mm cavity.	(IN)	INSULATION: Selected Insulation
(BW)	BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Ridgid Underlay required (9.1.7.2 E2/AS1)	(CB3)	CAVITY BATTEN, VERTICAL - STRUCTURALLY FIXED : 45mm x 45mm SPP Radiata Pine, H3.2 70mm x 45mm SPP Radiata Pine, H3.2 To form a 45mm cavity	(RF)	ROOF FLASHING: Materials as per E2/AS1 4.3
(FT)	FLASHING TAPE: As per E2/AS1 4.3.11	(RM)	ROOFING MEMBRANE: Selected System on 17mm CCA treated H3.2 grade plywood glued and screwed to Rafters. Roof Membrane requires 400mm solid block support each way & solid support to all sheet edges	(PB)	PLYWOOD BACKING: 17mm CCA treated H3.2 grade plywood substrate
(CC)	CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm Min drip edge to cladding			(CF)	CAP FLASHING: Continuous parapet flashing. Materials as per E2/AS1 4.3 + Figure 9 & Table 7
(IL)	INTERNAL LINING: Selected Internal Lining			(TF)	TIMBER FRAME: H1.2 min treated timber framing
				(WB)	WEATHER BOARD: Southern Pine Bevel Back Weatherboard. Profile to NZS 3617

NOTE : Where 75x13,15 jolt head nails are referenced, these may be substituted for 75mm jolt head weatherboard screws



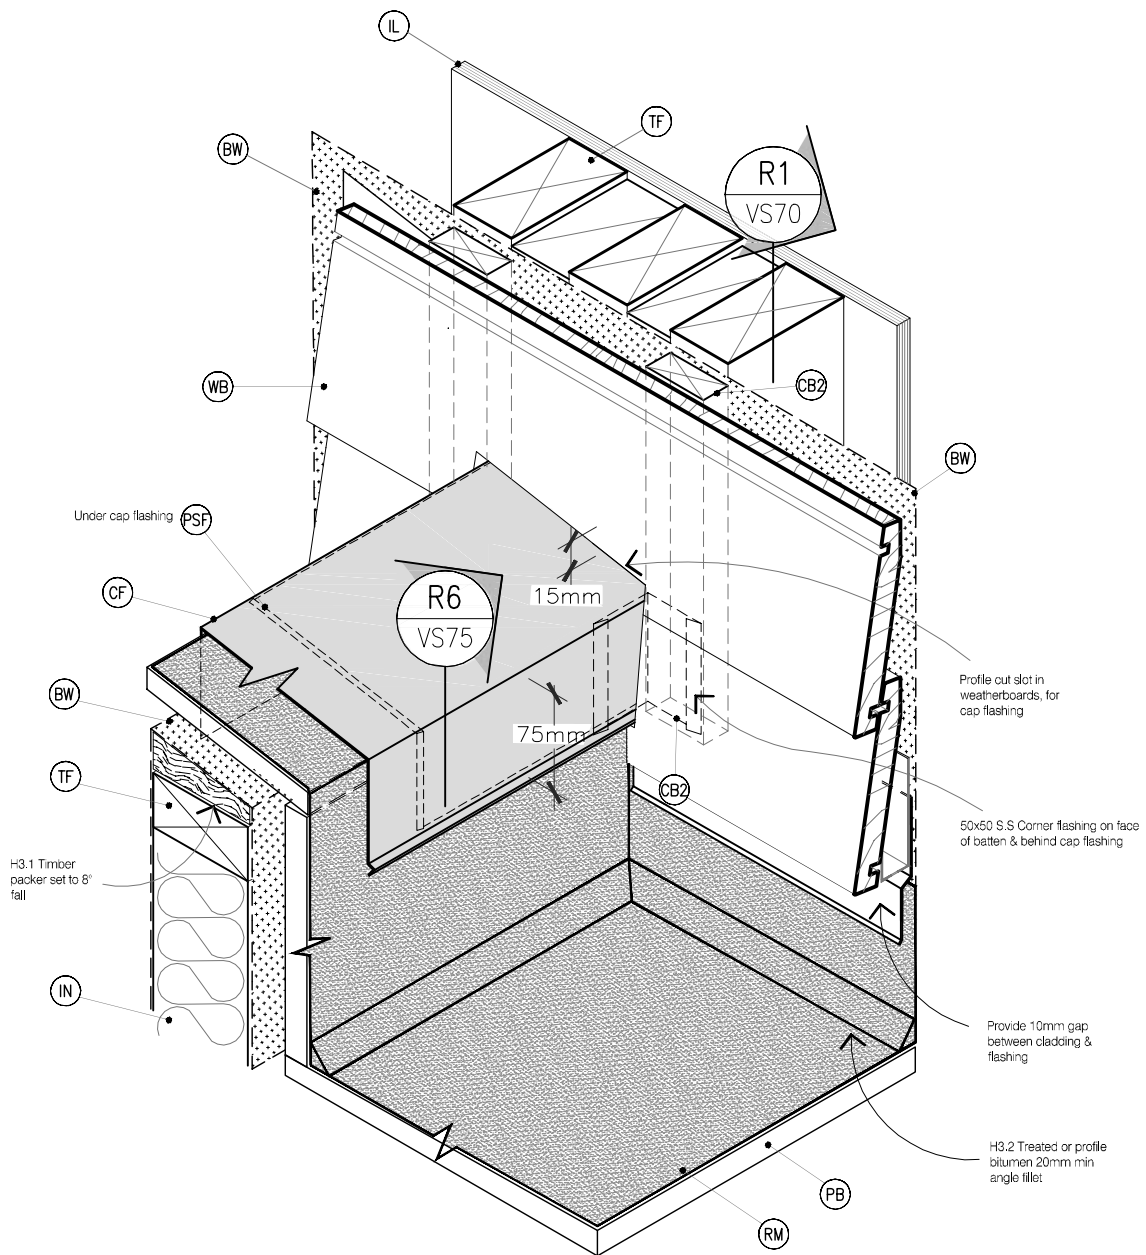


STAGE THREE

LEGEND:

(PSF) PARAPET SADDLE FLASHING: Materials as per E2/AS1 4.0, refer E2/AS1 Figure 11 & 12. Typically 0.45mm Min 316 Stainless Steel. Refer Table 20 & Table 21 for Comparability of Materials in Contact	(CB2) CAVITY BATTEN, VERTICAL: 20mm x 45mm H3.1. To form a 20mm cavity.	(IN) INSULATION: Selected Insulation
(BW) BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)	(CB3) CAVITY BATTEN, VERTICAL - STRUCTURALLY FIXED : 45mm x 45mm SPP Radiata Pine, H3.2 70mm x 45mm SPP Radiata Pine, H3.2 To form a 45mm cavity	(RF) ROOF FLASHING: Materials as per E2/AS1 4.3
(FT) FLASHING TAPE: As per E2/AS1 4.3.11	(RM) ROOFING MEMBRANE: Selected System on 17mm CCA treated H3.2 grade plywood glued and screwed to Rafters. Roof Membrane requires 400mm solid block support each way & solid support to all sheet edges	(PB) PLYWOOD BACKING: 17mm CCA treated H3.2 grade plywood substrate
(CC) CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm Min drip edge to cladding		(CF) CAP FLASHING: Continuous parapet flashing. Materials as per E2/AS1 4.3 + Figure 9 & Table 7
(IL) INTERNAL LINING: Selected Internal Lining		(TF) TIMBER FRAME: H1.2 min treated timber framing
		(WB) WEATHER BOARD: Southern Pine Bevel Back Weatherboard. Profile to NZS 3617

NOTE : Where 75x3.15 jolt head nails are referenced, these may be substituted for 75mm jolt head weatherboard screws

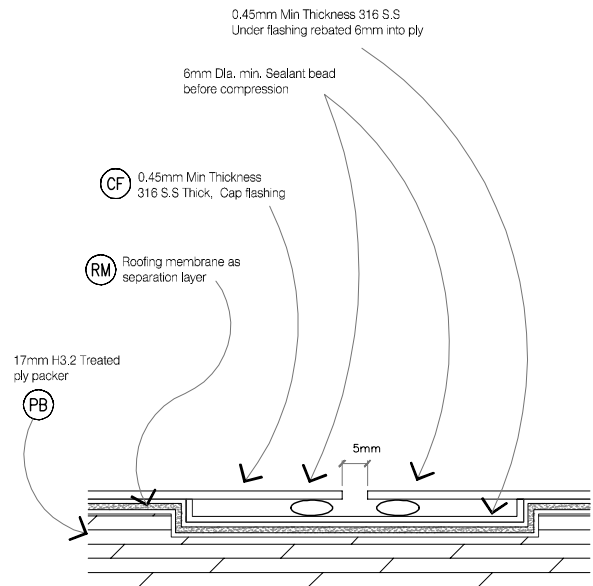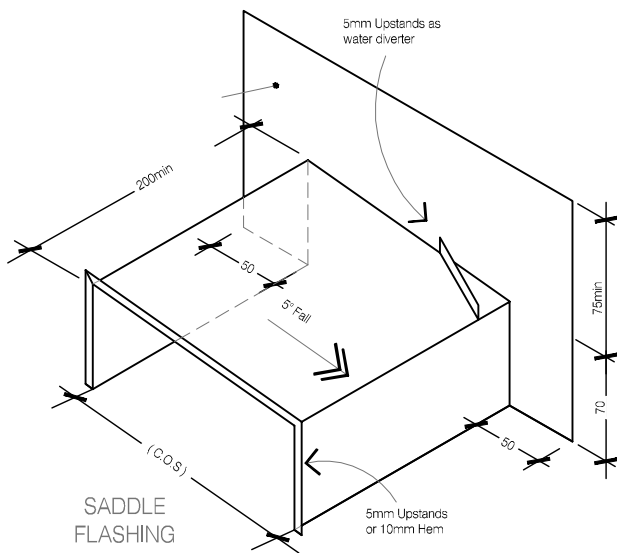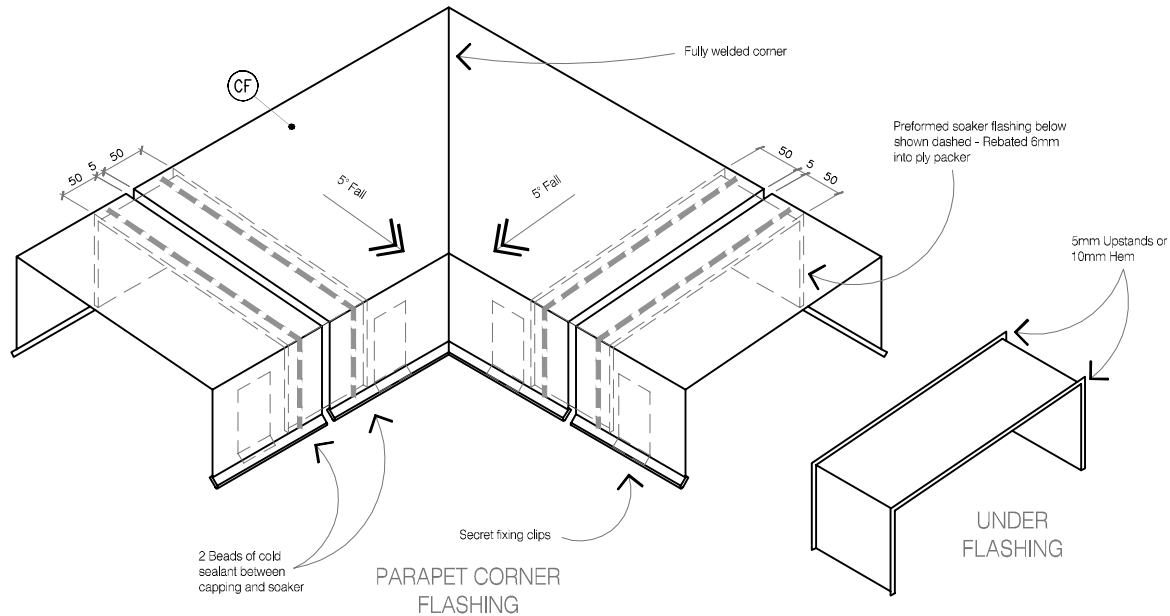

LEGEND:



PARAPET SADDLE FLASHING: Materials as per E2/AS1 4.0, refer E2/AS1 Figure 11 & 12. Typically 0.45mm Min 316 Stainless Steel. Refer Table 20 & Table 21 for Comparability of Materials in Contact



BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)



FLASHING TAPE: As per E2/AS1 4.3.11



CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm Min drip edge to cladding



INTERNAL LINING: Selected Internal Lining



CAVITY BATTEN, VERTICAL: 20mm x 45mm H3.1. To form a 20mm cavity.



CAVITY BATTEN, VERTICAL - STRUCTURALLY FIXED: 45mm x 45mm SPP Radiata Pine, H3.2 70mm x 45mm SPP Radiata Pine, H3.2 To form a 45mm cavity



ROOFING MEMBRANE: Selected System on 17mm CCA treated H3.2 grade plywood glued and screwed to Rafters. Roof Membrane requires 400mm solid block support each way & solid support to all sheet edges



INSULATION: Selected Insulation



ROOF FLASHING: Materials as per E2/AS1 4.3



PLYWOOD BACKING: 17mm CCA treated H3.2 grade plywood substrate



CAP FLASHING: Continuous parapet flashing. Materials as per E2/AS1 4.3 + Figure 9 & Table 7




TIMBER FRAME: H1.2 min treated timber framing



WEATHER BOARD: Southern Pine Bevel Back Weatherboard. Profile to NZS 3617


NOTE: Where 75x3.15 jolt head nails are referenced, these may be substituted for 75mm jolt head weatherboard screws

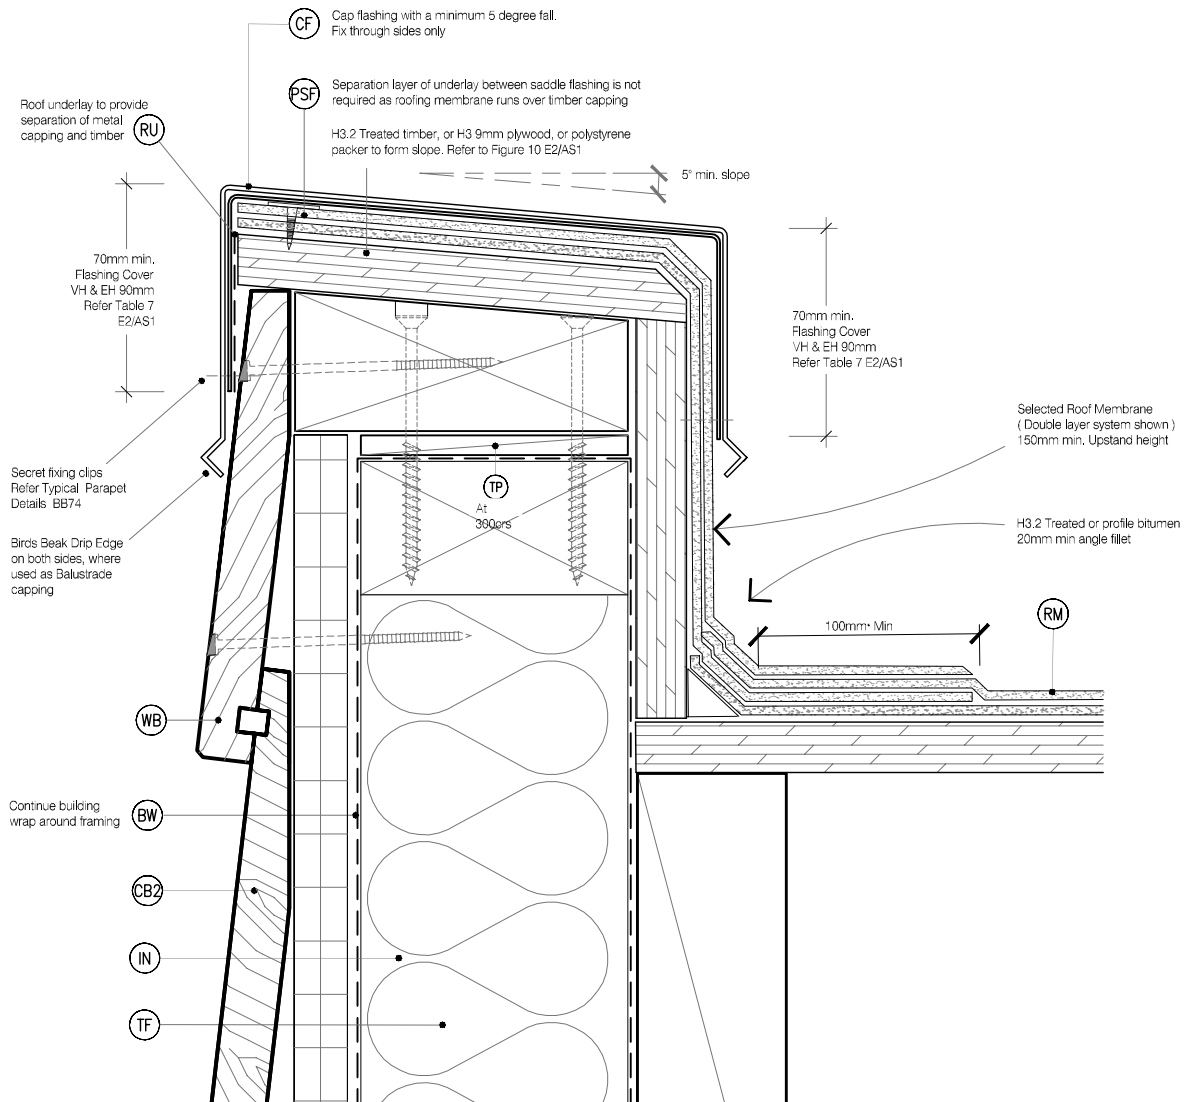

LEGEND:

(PSF) PARAPET SADDLE FLASHING: Materials as per E2/AS1 4.0, refer E2/AS1 Figure 11 & 12. Typically 0.45mm Min 316 Stainless Steel. Refer Table 20 & Table 21 for Comparability of Materials in Contact	(CB2) CAVITY BATTEN, VERTICAL: 20mm x 45mm H3.1. To form a 20mm cavity.	(IN) INSULATION: Selected Insulation
(BW) BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)	(CB3) CAVITY BATTEN, VERTICAL - STRUCTURALLY FIXED: 45mm x 45mm SPP Radiata Pine, H3.2 70mm x 45mm SPP Radiata Pine, H3.2 To form a 45mm cavity	(RF) ROOF FLASHING: Materials as per E2/AS1 4.3
(FT) FLASHING TAPE: As per E2/AS1 4.3.11	(RM) ROOFING MEMBRANE: Selected System on 17mm CCA treated H3.2 grade plywood glued and screwed to Rafters. Roof Membrane requires 400mm solid block support each way & solid support to all sheet edges	(PB) PLYWOOD BACKING: 17mm CCA treated H3.2 grade plywood substrate
(CC) CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm Min drip edge to cladding		(CF) CAP FLASHING: Continuous parapet flashing. Materials as per E2/AS1 4.3 + Figure 9 & Table 7
(IL) INTERNAL LINING: Selected Internal Lining		(TF) TIMBER FRAME: H1.2 min treated timber framing
		(WB) WEATHER BOARD: Southern Pine Bevel Back Weatherboard. Profile to NZS 3617


NOTE : Where 75x3.15 jolt head nails are referenced, these may be substituted for 75mm jolt head weatherboard screws

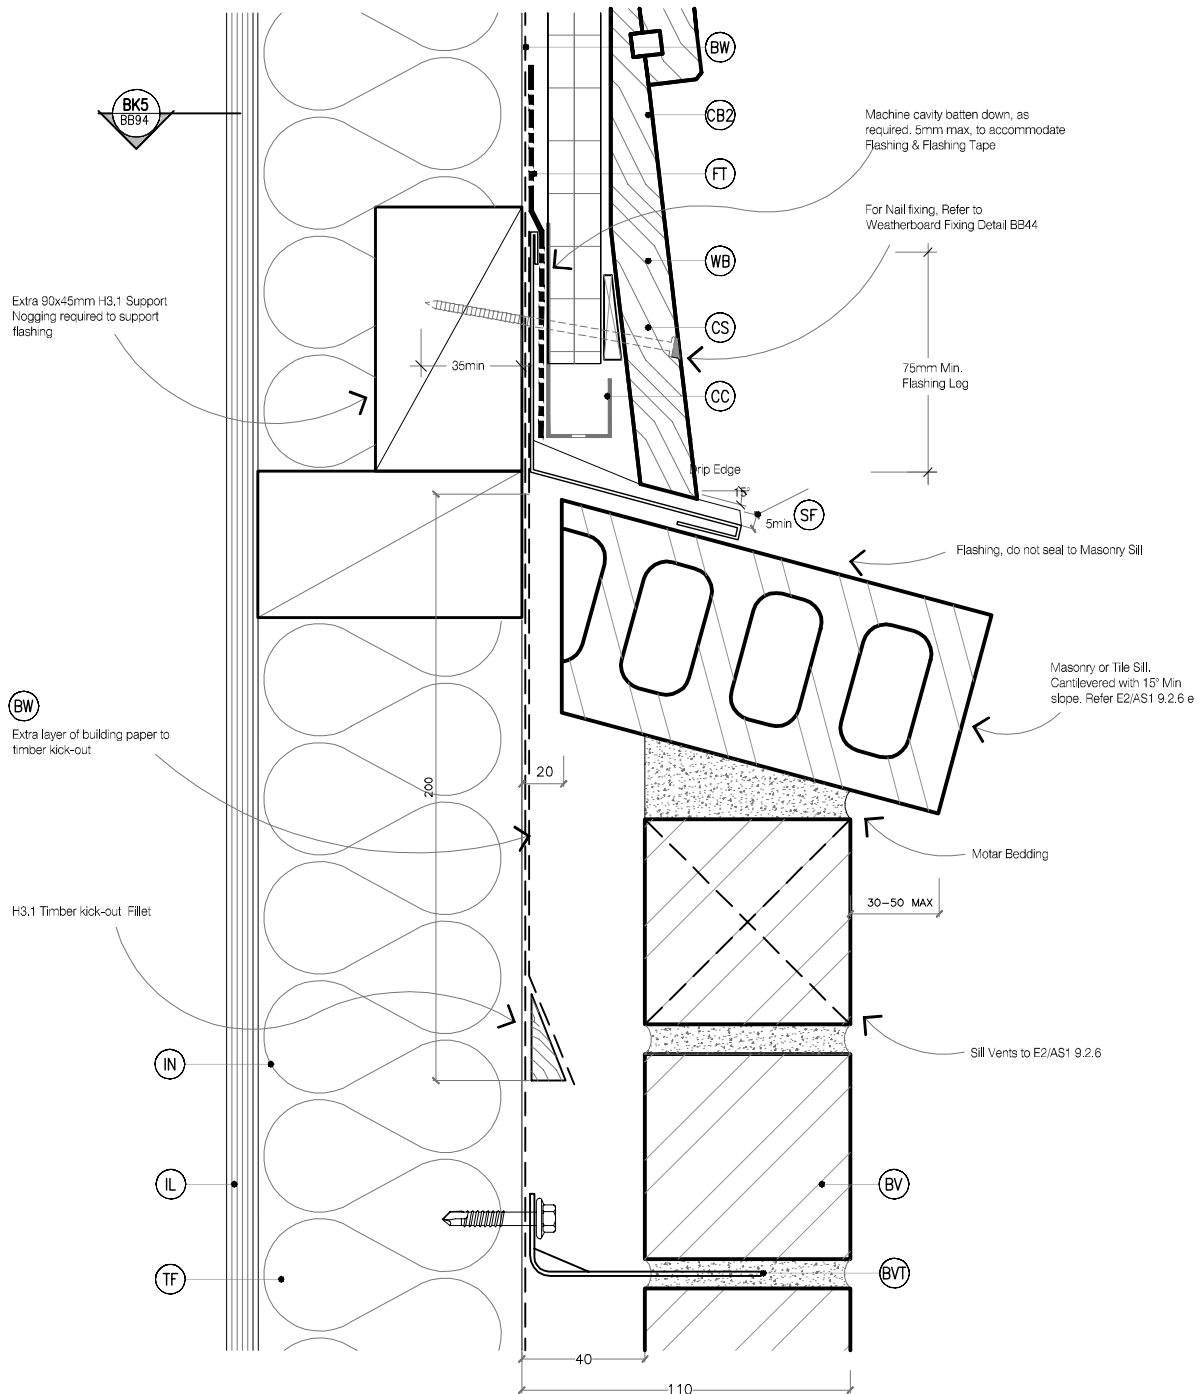

LEGEND:

- | | | | | | |
|-------|--|-------|--|------|--|
| (SF) | SILL FLASHING: Continuous flashing on 15° min slope with turn back ends at end of walls. Materials as per E2/AS1 4.0 Typically 0.45mm Min 316 Stainless Steel. | (CB2) | CAVITY BATTEN, VERTICAL: 20mm x 45mm H3.1. To form a 20mm cavity. | (IL) | INTERNAL LINING: Selected Internal Lining |
| (BW) | BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Ridgid Underlay required (9.1.7.2 E2/AS1) | (CB3) | CAVITY BATTEN, VERTICAL - STRUCTURALLY FIXED: 45mm x 45mm SPP Radiata Pine, H3.2 70mm x 45mm SPP Radiata Pine, H3.2 To form a 45mm cavity | (IN) | INSULATION: Selected Insulation |
| (BV) | BRICK VENEER: Selected brick veneer. Typically 70 series clay brick veneer on 40mm cavity | (CC) | CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm Min drip edge to cladding | (TF) | TIMBER FRAME: H1.2 min treated timber framing |
| (FT) | FLASHING TAPE: As per E2/AS1 4.3.11 | (CF) | CORNER FLASHING: 316 Stainless Steel corner flashing. Refer NZBC E2/AS1 4.3, 75x75 Hem or Hook to Flashing Edges. EXTRA HIGH WIND ZONE 100x100 Hem or Hook to Flashing Edges | (WB) | WEATHER BOARD: Southern Pine Bevel Back Weatherboard. Profile to NZS 3617 |
| (BVT) | BRICK VENEER TIES: Stainless Steel brick Veneer ties screw fixed to framing - spacing NZS4210, ties to be within 300mm of internal or external corner | | | (FF) | FLAT FLASHING: 316 Stainless Steel 100mm Hem or Hook to Flashing Edges. EXTRA HIGH WIND ZONE 150mm Hem or Hook to Flashing Edges |
| | | | | (CS) | CANT STRIP: Southern Pine H3.1 Cant Strip 25mm x 9 mm |


NOTE : Where 75x3.15 jolt head nails are referenced, these may be substituted for 75mm jolt head weatherboard screws

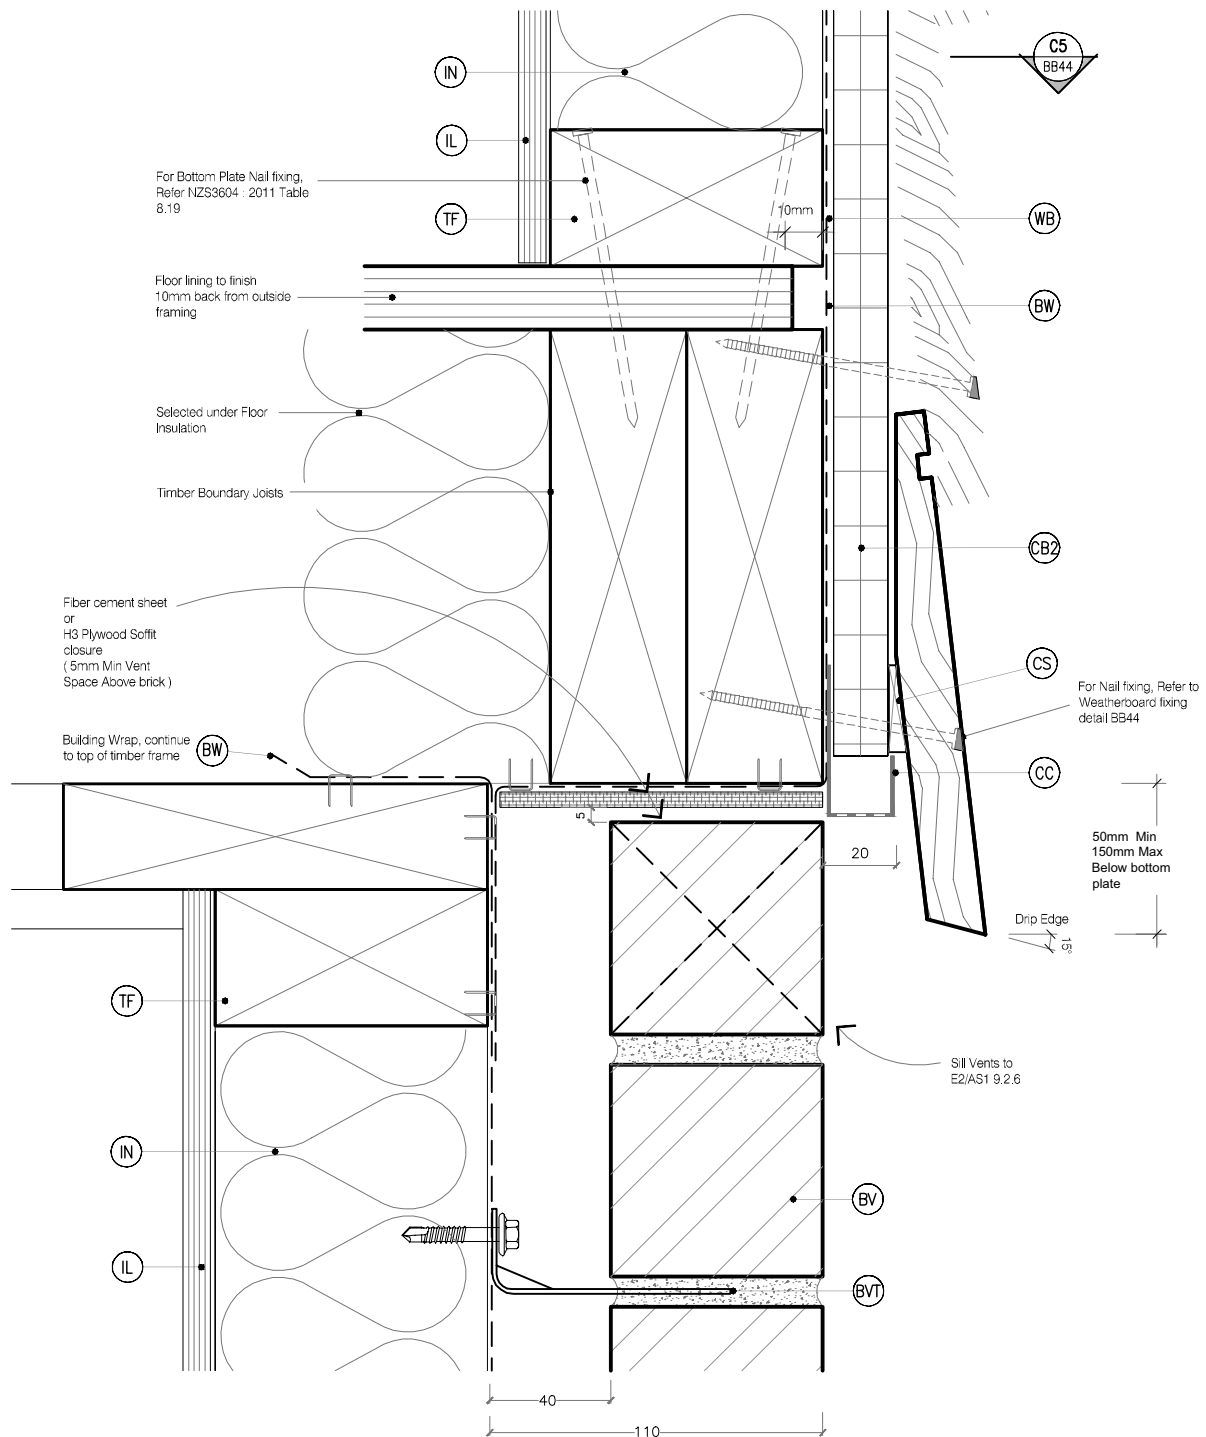

LEGEND:

- | | | |
|---|--|--|
| <p>(SF) SILL FLASHING: Continuous flashing on 15° min slope with turn back ends at end of walls. Materials as per E2/AS1 4.0 Typically 0.45mm Min 316 Stainless Steel.</p> <p>(BW) BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)</p> <p>(BV) BRICK VENEER: Selected brick veneer. Typically 70 series clay brick veneer on 40mm cavity</p> <p>(FT) FLASHING TAPE: As per E2/AS1 4.3.11</p> <p>(BVT) BRICK VENEER TIES: Stainless Steel brick Veneer ties screw fixed to framing - spacing NZS4210, ties to be within 300mm of internal or external corner</p> | <p>(CB2) CAVITY BATTEN, VERTICAL: 20mm x 45mm H3.1. To form a 20mm cavity.</p> <p>(CB3) CAVITY BATTEN, VERTICAL - STRUCTURALLY FIXED: 45mm x 45mm SPP Radiata Pine, H3.2 70mm x 45mm SPP Radiata Pine, H3.2 To form a 45mm cavity</p> <p>(CC) CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm Min drip edge to cladding</p> <p>(CF) CORNER FLASHING: 316 Stainless Steel corner flashing. Refer NZBC E2/AS1 4.3. 75x75 Hem or Hook to Flashing Edges. EXTRA HIGH WIND ZONE 100x100 Hem or Hook to Flashing Edges</p> | <p>(IL) INTERNAL LINING: Selected Internal Lining</p> <p>(IN) INSULATION: Selected Insulation</p> <p>(TF) TIMBER FRAME: H1.2 min treated timber framing</p> <p>(WB) WEATHER BOARD: Southern Pine Bevel Back Weatherboard. Profile to NZS 3617</p> <p>(FF) FLAT FLASHING: 316 Stainless Steel 100mm Hem or Hook to Flashing Edges. EXTRA HIGH WIND ZONE 150mm Hem or Hook to Flashing Edges</p> <p>(CS) CANT STRIP: Southern Pine H3.1 Cant Strip 25mm x 9 mm</p> |
|---|--|--|


NOTE : Where 75x3.15 jolt head nails are referenced, these may be substituted for 75mm jolt head weatherboard screws

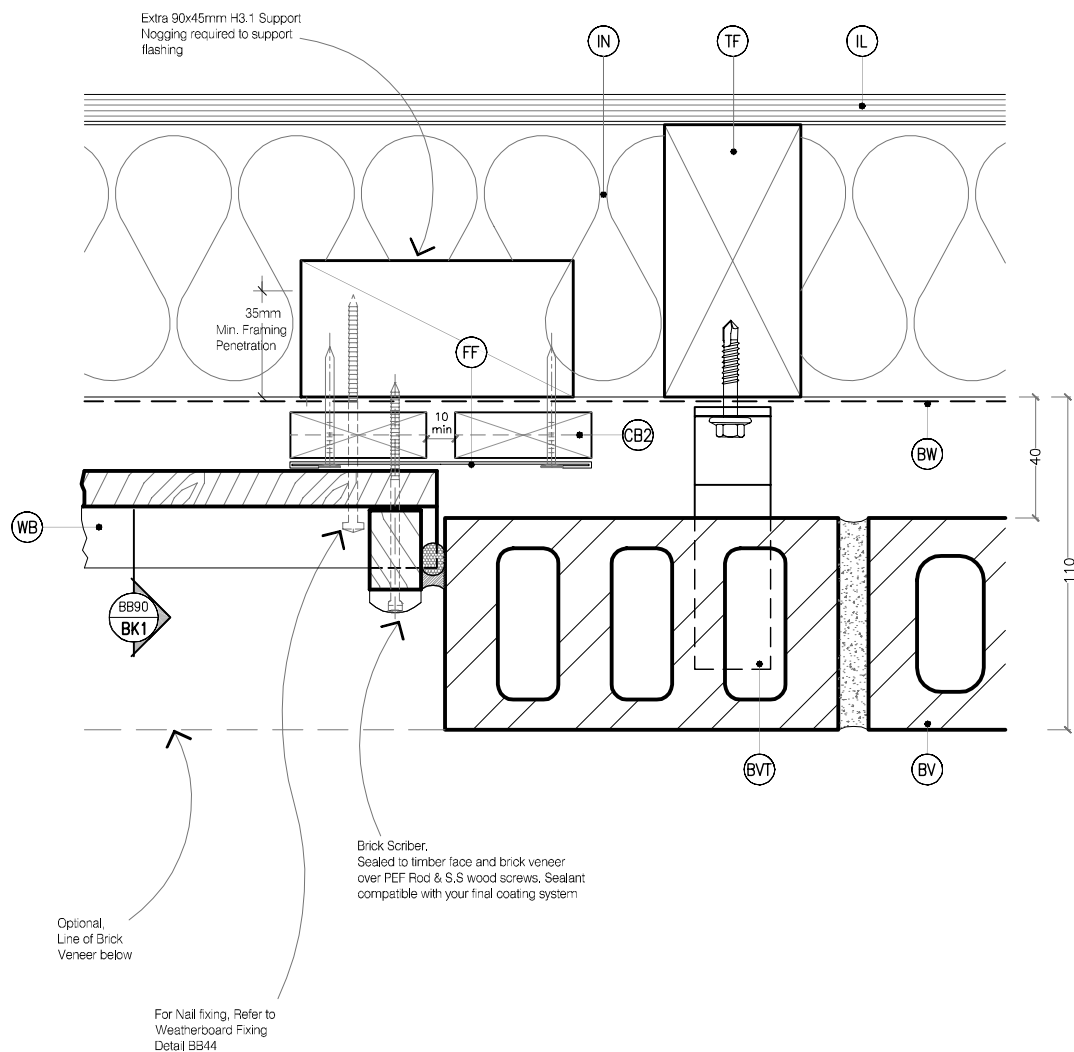

LEGEND:

(SF)	SILL FLASHING: Continuous flashing on 15° min slope with turn back ends at end of walls. Materials as per E2/AS1 4.0 Typically 0.45mm Min 316 Stainless Steel.	(CB2)	CAVITY BATTEN, VERTICAL: 20mm x 45mm H3.1. To form a 20mm cavity.	(IL)	INTERNAL LINING: Selected Internal Lining
(BW)	BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)	(CB3)	CAVITY BATTEN, VERTICAL - STRUCTURALLY FIXED: 45mm x 45mm SPP Radiata Pine, H3.2 70mm x 45mm SPP Radiata Pine, H3.2 To form a 45mm cavity	(IN)	INSULATION: Selected Insulation
(BV)	BRICK VENEER: Selected brick veneer. Typically 70 series clay brick veneer on 40mm cavity	(CC)	CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm Min drip edge to cladding	(TF)	TIMBER FRAME: H1.2 min treated timber framing
(FT)	FLASHING TAPE: As per E2/AS1 4.3.11	(CF)	CORNER FLASHING: 316 Stainless Steel corner flashing. Refer NZBC E2/AS1 4.3. 75x75 Hem or Hook to Flashing Edges. EXTRA HIGH WIND ZONE 100x100 Hem or Hook to Flashing Edges	(WB)	WEATHER BOARD: Southern Pine Bevel Back Weatherboard. Profile to NZS 3617
(BVT)	BRICK VENEER TIES: Stainless Steel brick Veneer ties screw fixed to framing - spacing NZS4210, ties to be within 300mm of internal or external corner			(FF)	FLAT FLASHING: 316 Stainless Steel 100mm Hem or Hook to Flashing Edges. EXTRA HIGH WIND ZONE 150mm Hem or Hook to Flashing Edges
				(CS)	CANT STRIP: Southern Pine H3.1 Cant Strip 25mm x 9 mm

NOTE : Where 75x3.15 jolt head nails are referenced, these may be substituted for 75mm jolt head weatherboard screws

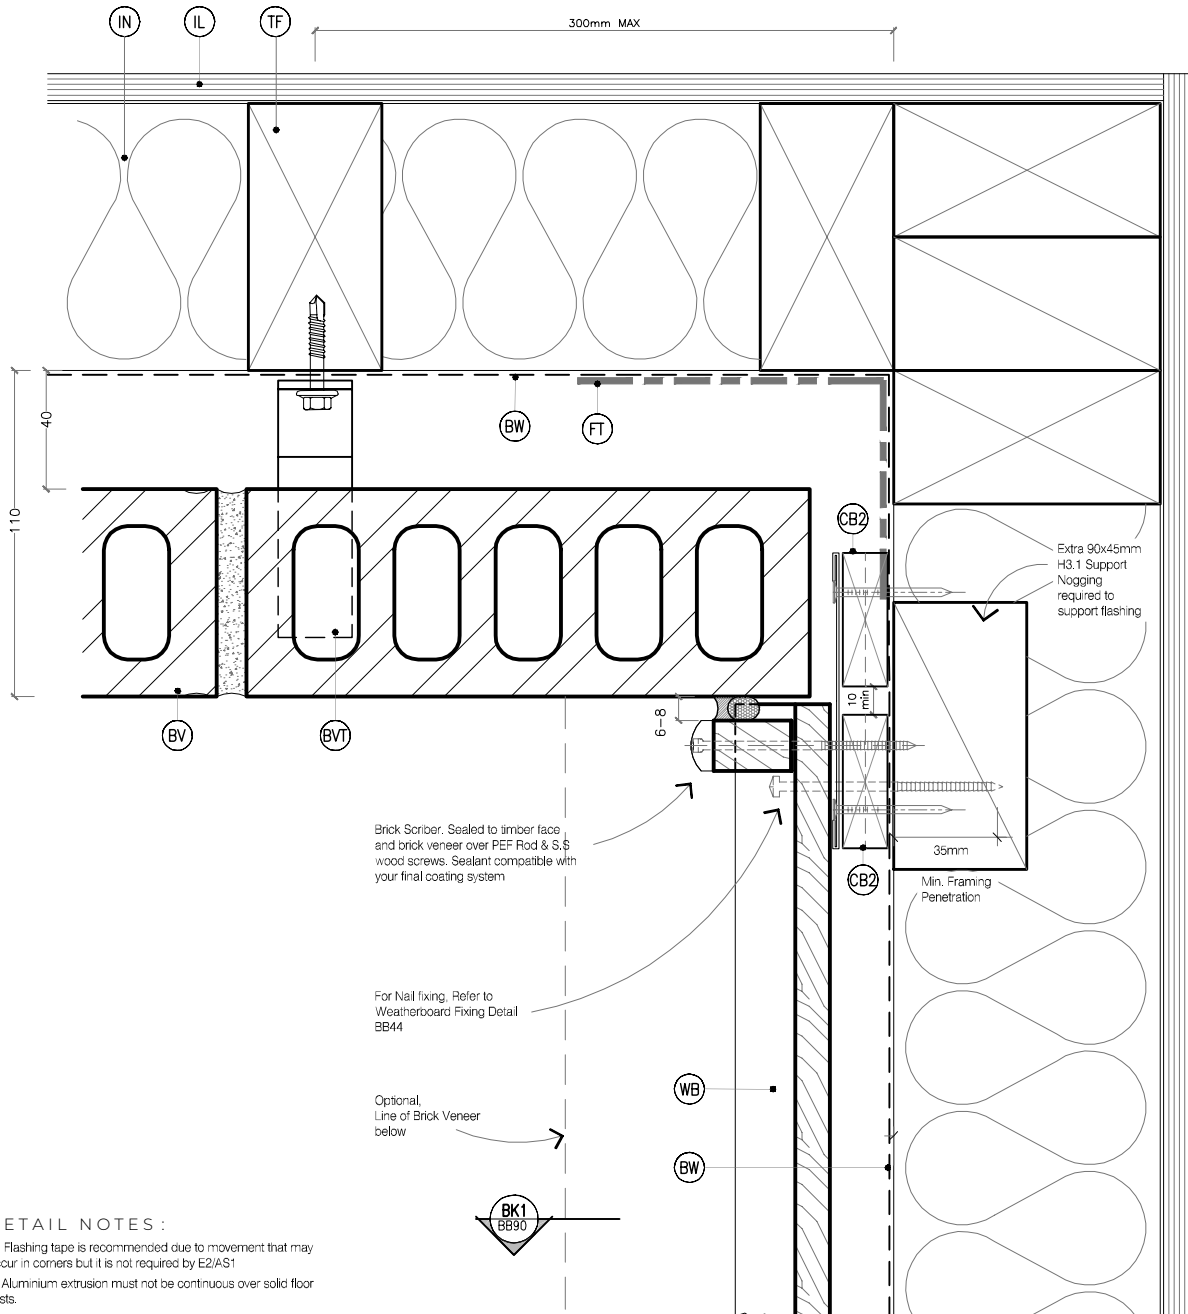


DETAIL NOTES :

1. Flashing tape is recommended due to movement that may occur in corners but it is not required by E2/AS1
2. Aluminium extrusion must not be continuous over solid floor joists.

LEGEND:

- | | | |
|---|---|--|
| <p>(SF) SILL FLASHING: Continuous flashing on 15° min slope with turn back ends at end of walls. Materials as per E2/AS1 4.0 Typically 0.45mm Min 316 Stainless Steel.</p> <p>(BW) BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)</p> <p>(BV) BRICK VENEER: Selected brick veneer. Typically 70 series clay brick veneer on 40mm cavity</p> <p>(FT) FLASHING TAPE: As per E2/AS1 4.3.11</p> <p>(BVT) BRICK VENEER TIES: Stainless Steel brick Veneer ties screw fixed to framing - spacing NZS4210, ties to be within 300mm of internal or external corner</p> | <p>(CB2) CAVITY BATTEN, VERTICAL: 20mm x 45mm H3.1. To form a 20mm cavity.</p> <p>(CB3) CAVITY BATTEN, VERTICAL - STRUCTURALLY FIXED : 45mm x 45mm SPP Radiata Pine, H3.2 70mm x 45mm SPP Radiata Pine, H3.2 To form a 45mm cavity</p> <p>(CC) CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm Min drip edge to cladding</p> <p>(CF) CORNER FLASHING: 316 Stainless Steel corner flashing. Refer NZBC E2/AS1 4.3. 75x75 Hem or Hook to Flashing Edges. EXTRA HIGH WIND ZONE 100x100 Hem or Hook to Flashing Edges</p> | <p>(IL) INTERNAL LINING: Selected Internal Lining</p> <p>(IN) INSULATION: Selected Insulation</p> <p>(TF) TIMBER FRAME: H1.2 min treated timber framing</p> <p>(WB) WEATHER BOARD: Southern Pine Bevel Back Weatherboard. Profile to NZS 3617</p> <p>(FF) FLAT FLASHING: 316 Stainless Steel 100mm Hem or Hook to Flashing Edges. EXTRA HIGH WIND ZONE 150mm Hem or Hook to Flashing Edges</p> <p>(CS) CANT STRIP: Southern Pine H3.1 Cant Strip 25mm x 9 mm</p> |
|---|---|--|

NOTE : Where 75x3.15 jolt head nails are referenced, these may be substituted for 75mm jolt head weatherboard screws

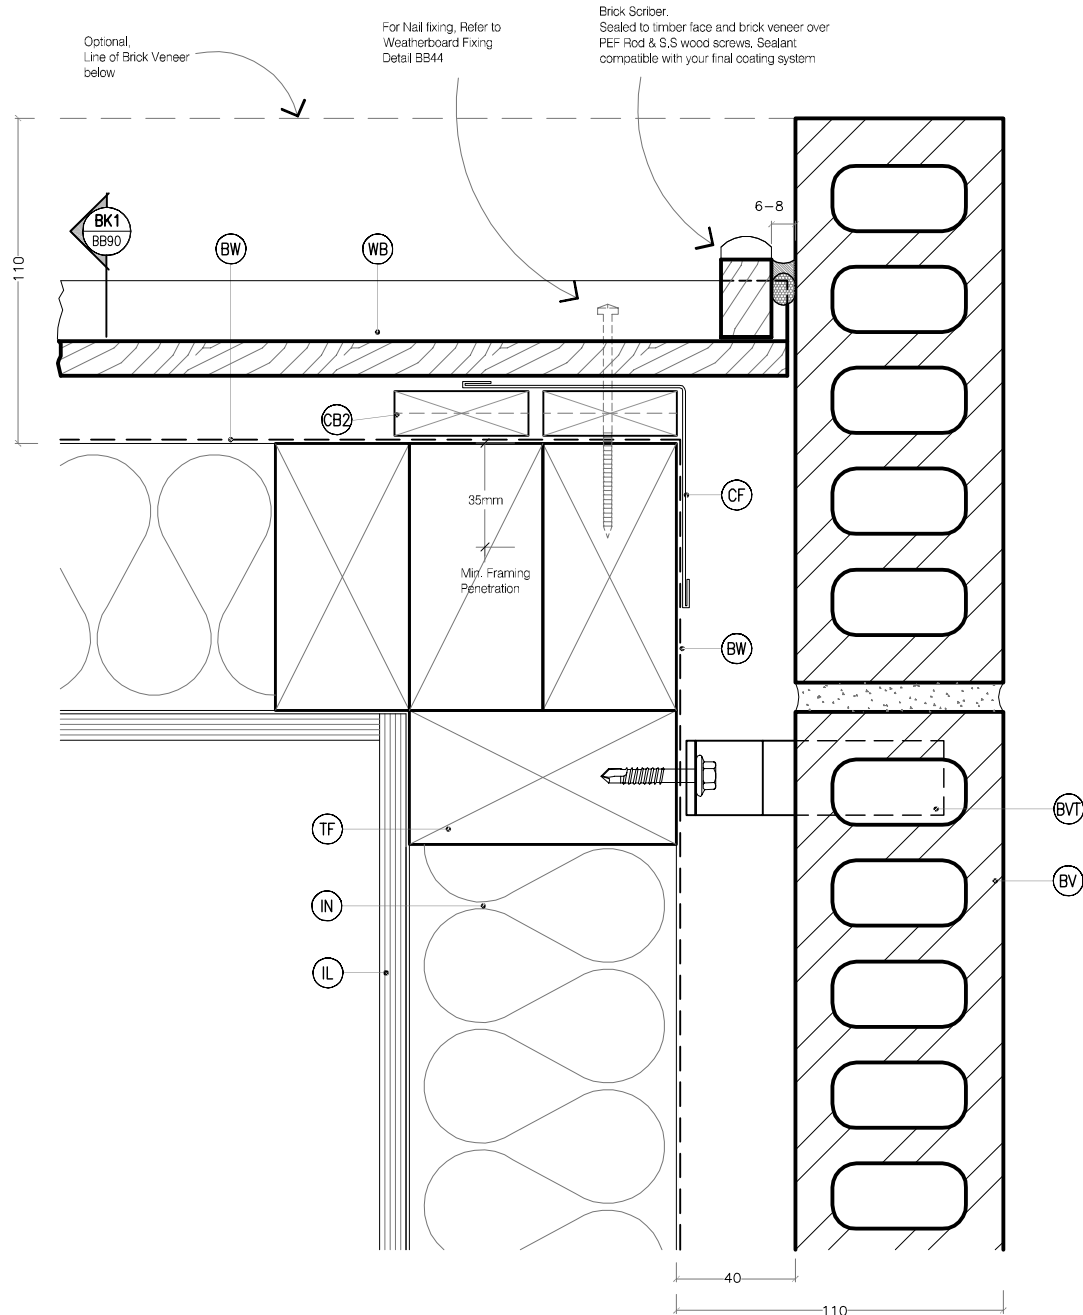

LEGEND:



SF SILL FLASHING: Continuous flashing on 15° min slope with turn back ends at end of walls. Materials as per E2/AS1 4.0 Typically 0.45mm Min 316 Stainless Steel.



BW BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)



BV BRICK VENEER: Selected brick veneer. Typically 70 series clay brick veneer on 40mm cavity



FT FLASHING TAPE: As per E2/AS1 4.3.11



BVT BRICK VENEER TIES: Stainless Steel brick Veneer ties screw fixed to framing - spacing NZS4210, ties to be within 300mm of internal or external corner



CB2 CAVITY BATTEN, VERTICAL: 20mm x 45mm H3.1. To form a 20mm cavity.



CB3 CAVITY BATTEN, VERTICAL - STRUCTURALLY FIXED: 45mm x 45mm SPP Radiata Pine, H3.2 70mm x 45mm SPP Radiata Pine, H3.2 To form a 45mm cavity



CC CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm Min drip edge to cladding



CF CORNER FLASHING: 316 Stainless Steel corner flashing. Refer NZBC E2/AS1 4.3. 75x75 Hem or Hook to Flashing Edges. EXTRA HIGH WIND ZONE 100x100 Hem or Hook to Flashing Edges



IL INTERNAL LINING: Selected Internal Lining



IN INSULATION: Selected Insulation



TF TIMBER FRAME: H1.2 min treated timber framing



WB WEATHER BOARD: Southern Pine Bevel Back Weatherboard. Profile to NZS 3617




FF FLAT FLASHING: 316 Stainless Steel 100mm Hem or Hook to Flashing Edges. EXTRA HIGH WIND ZONE 150mm Hem or Hook to Flashing Edges




CS CANT STRIP: Southern Pine H3.1 Cant Strip 25mm x 9 mm

NOTE : Where 75x3.15 jolt head nails are referenced, these may be substituted for 75mm jolt head weatherboard screws


3D SILL FLASHING

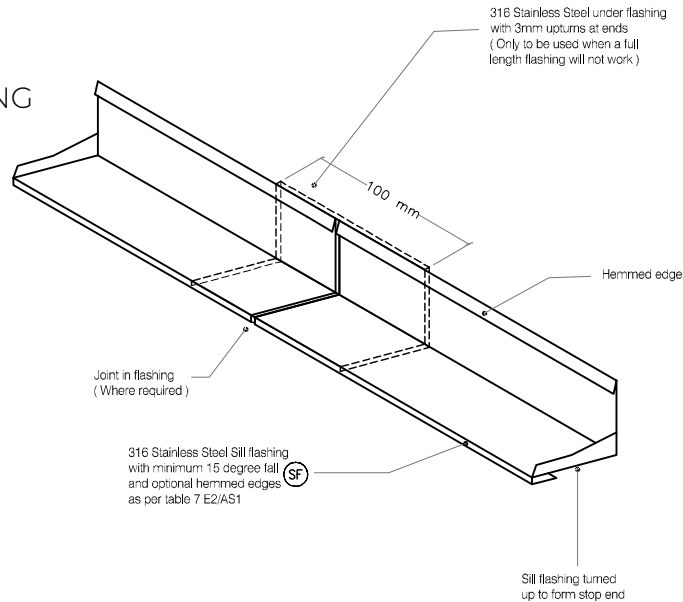


SILL FLASHING DIMENSIONS

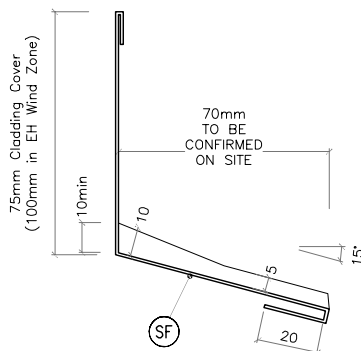

INLINE & INTERNAL FLASHING DIMENSIONS

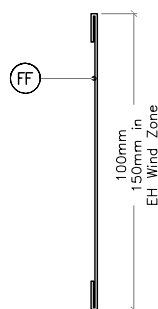

EXTERNAL FLASHING DIMENSIONS

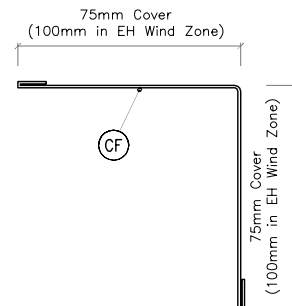

LEGEND:



SILL FLASHING: Continuous flashing on 15° min slope with turn back ends at end of walls. Materials as per E2/AS1 4.0 Typically 0.45mm Min 316 Stainless Steel.



BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)



BRICK VENEER: Selected brick veneer. Typically 70 series clay brick veneer on 40mm cavity



FLASHING TAPE: As per E2/AS1 4.3.11



BRICK VENEER TIES: Stainless Steel brick Veneer ties screw fixed to framing - spacing NZS4210, ties to be within 300mm of internal or external corner



CAVITY BATTEN, VERTICAL: 20mm x 45mm H3.1. To form a 20mm cavity.



CAVITY BATTEN, VERTICAL - STRUCTURALLY FIXED : 45mm x 45mm SPP Radiata Pine, H3.2 70mm x 45mm SPP Radiata Pine, H3.2 To form a 45mm cavity



CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm Min drip edge to cladding



CORNER FLASHING: 316 Stainless Steel corner flashing. Refer NZBC E2/AS1 4.3. 75x75 Hem or Hook to Flashing Edges. EXTRA HIGH WIND ZONE 100x100 Hem or Hook to Flashing Edges



INTERNAL LINING: Selected Internal Lining



INSULATION: Selected Insulation



TIMBER FRAME: H1.2 min treated timber framing



WEATHER BOARD: Southern Pine Bevel Back Weatherboard. Profile to NZS 3617




FLAT FLASHING: 316 Stainless Steel 100mm Hem or Hook to Flashing Edges. EXTRA HIGH WIND ZONE 150mm Hem or Hook to Flashing Edges



CANT STRIP: Southern Pine H3.1 Cant Strip 25mm x 9 mm

NOTE : Where 75x3.15 jolt head nails are referenced, these may be substituted for 75mm jolt head weatherboard screws

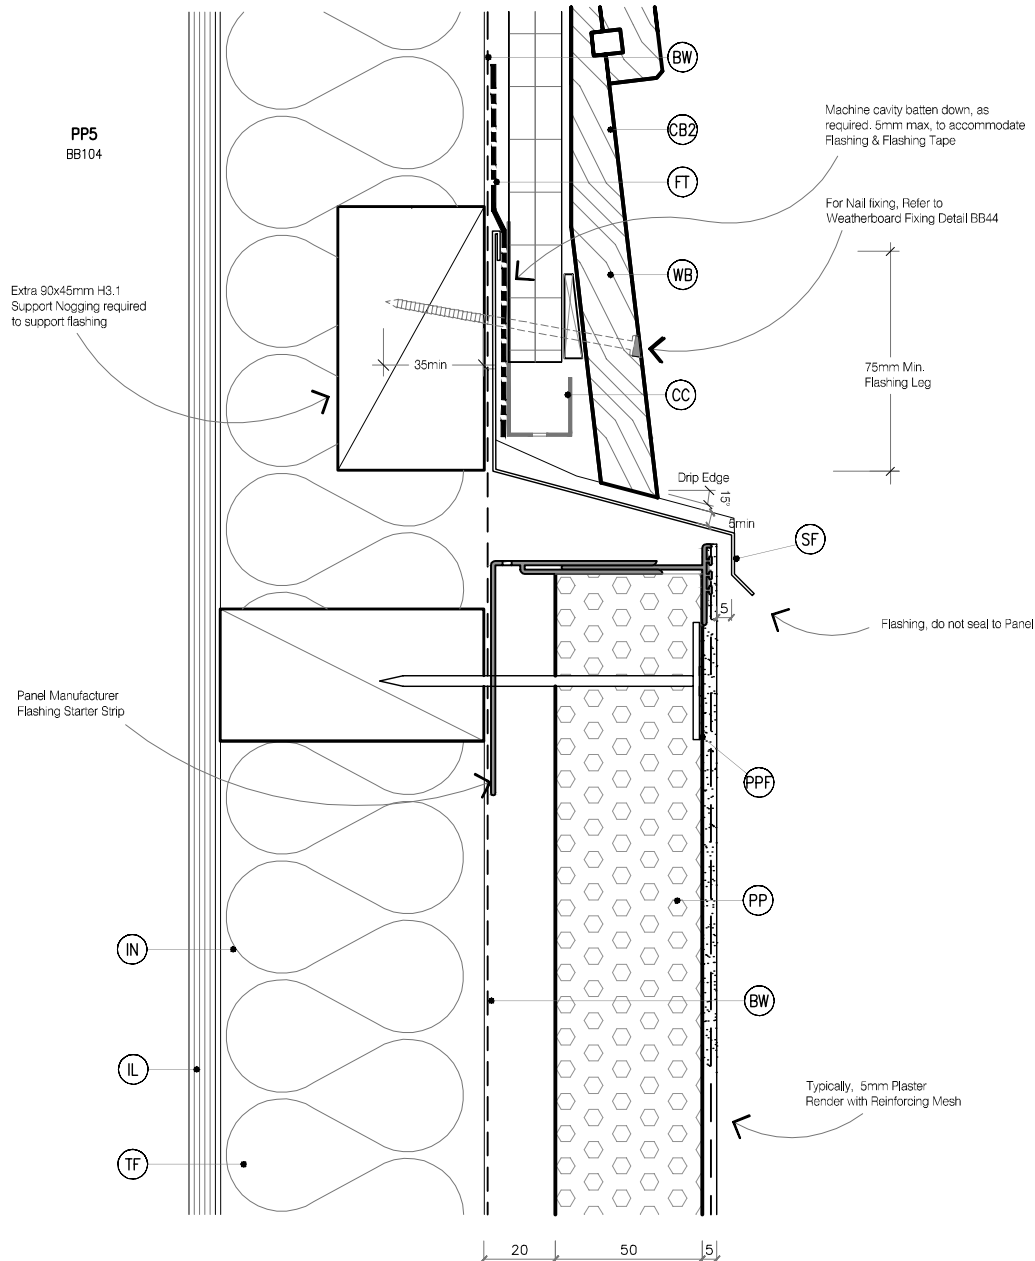

LEGEND:

- | | | | | | |
|-------|--|-------|--|-------|--|
| (SF) | SILL FLASHING: Continuous flashing on 15° min slope with turn back ends at end of walls. Materials as per E2/AS1 4.0 Typically 0.45mm Min 316 Stainless Steel. | (CB2) | CAVITY BATTEN, VERTICAL: 20mm x 45mm H3.1. To form a 20mm cavity. | (ECF) | EXTERNAL CORNER FLASHING: 316 S.S Corner flashing. Refer NZBC E2/AS1 4.3. 125x75 Hem or Hook to Flashing Edges. EXTRA HIGH WIND ZONE 150x100 Hem or Hook to Flashing Edges |
| (BW) | BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1) | (CB3) | CAVITY BATTEN, VERTICAL - STRUCTURALLY FIXED : 45mm x 45mm SPP Radiata Pine, H3.2 70mm x 45mm SPP Radiata Pine, H3.2 To form a 45mm cavity | (ICF) | INTERNAL CORNER FLASHING: As per External Corner Flashing Hem & Hook flipped. |
| (PP) | PLASTER PANEL: Selected Insulated Facade Panel System. Typically 50mm Thick, fixed to 20mm vertical cavity batten | (HS) | HEAD SOFFIT SCRIBER: Southern Pine Eaves Mould EM 40 x 27. Fix with 75 x 3.15 316 SS nail in 2.5mm predrilled hole | (IL) | INTERNAL LINING: Selected Internal Lining |
| (FT) | FLASHING TAPE: As per E2/AS1 4.3.11 | (CC) | CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm Min drip edge to cladding | (IN) | INSULATION: Selected Insulation |
| (PPF) | PLASTER PANEL FIXING: Specific designed panel fixing system. Install to manufactures instructions | (WB) | WEATHER BOARD: Southern Pine Bevel Back Weatherboard. Profile to NZS 3617 | (FF) | FLAT FLASHING: 316 Stainless Steel 100mm Hem or Hook to Flashing Edges. EXTRA HIGH WIND ZONE 150mm Hem or Hook to Flashing Edges |
| | | | | (TF) | TIMBER FRAME: H1.2 min treated timber framing |

NOTE : Where 75x3.15 jolt head nails are referenced, these may be substituted for 75mm jolt head weatherboard screws

SF

BW

PP

FT



CB2

CB3

HS

WB

(ECF)

ICF

IL


IN

FF

TF

crews


NOTE : Where 75x3.15 jolt head nails are referenced, these may be substituted for 75mm jolt head weatherboard screws

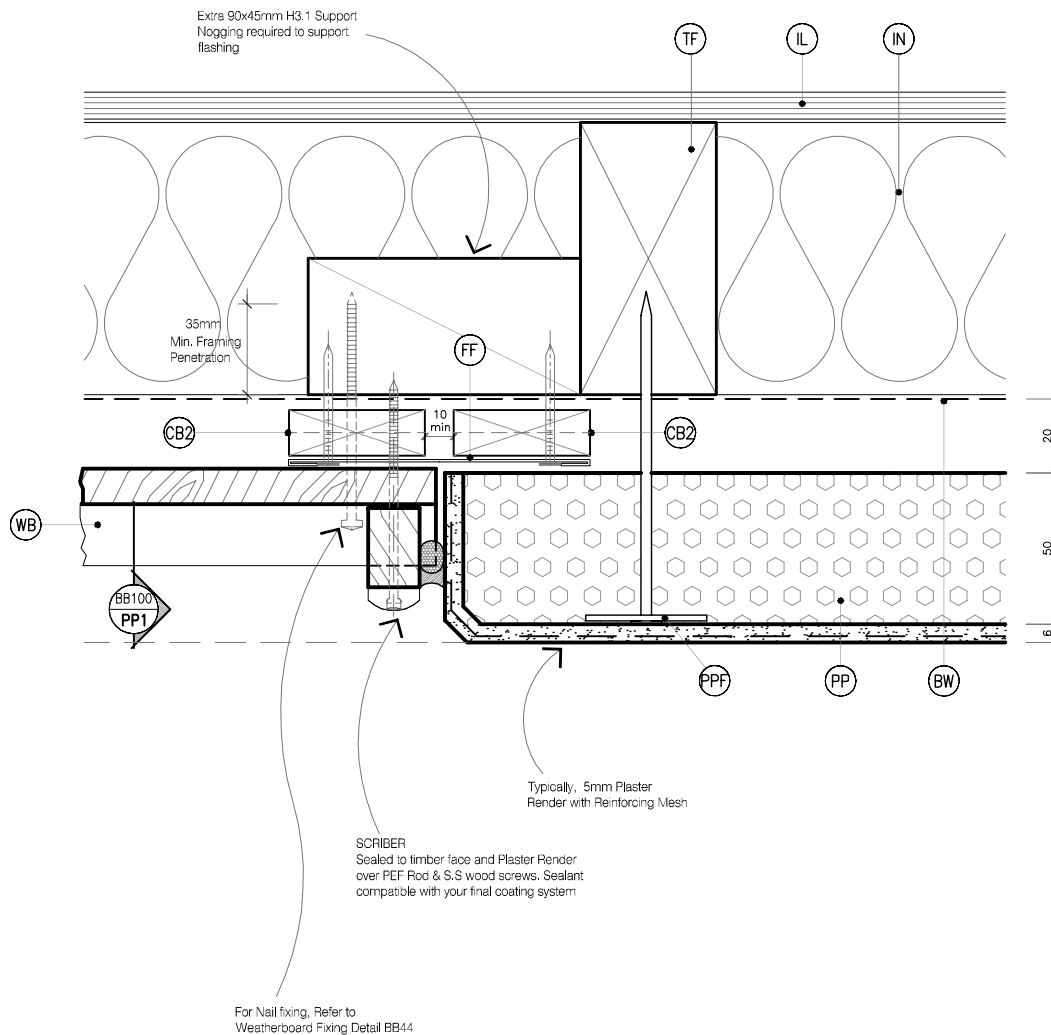

LEGEND:

(SF)	SILL FLASHING: Continuous flashing on 15° min slope with turn back ends at end of walls. Materials as per E2/AS1 4.0 Typically 0.45mm Min 316 Stainless Steel.	(CB2)	CAVITY BATTEN, VERTICAL: 20mm x 45mm H3.1. To form a 20mm cavity.	(ECF)	EXTERNAL CORNER FLASHING: 316 S.S Corner flashing. Refer NZBC E2/AS1 4.3. 125x75 Hem or Hook to Flashing Edges. EXTRA HIGH WIND ZONE 150x100 Hem or Hook to Flashing Edges
(BW)	BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Ridgid Underlay required (9.1.7.2 E2/AS1)	(CB3)	CAVITY BATTEN, VERTICAL - STRUCTURALLY FIXED : 45mm x 45mm SPP Radiata Pine, H3.2 70mm x 45mm SPP Radiata Pine, H3.2 To form a 45mm cavity	(ICF)	INTERNAL CORNER FLASHING: As per External Corner Flashing Hem & Hook flipped.
(PP)	PLASTER PANEL: Selected Insulated Facade Panel System. Typically 50mm Thick, fixed to 20mm vertical cavity batten	(HS)	HEAD SOFFIT SCRIBER: Southern Pine Eaves Mould EM 40 x 27. Fix with 75 x 3.15 316 SS nail in 2.5mm predrilled hole	(IL)	INTERNAL LINING: Selected Internal Lining
(FT)	FLASHING TAPE: As per E2/AS1 4.3.11	(CC)	CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm Min drip edge to cladding	(IN)	INSULATION: Selected Insulation
(PPF)	PLASTER PANEL FIXING: Specific designed panel fixing system. Install to manufactures instructions	(WB)	WEATHER BOARD: Southern Pine Bevel Back Weatherboard. Profile to NZS 3617	(FF)	FLAT FLASHING: 316 Stainless Steel 100mm Hem or Hook to Flashing Edges. EXTRA HIGH WIND ZONE 150mm Hem or Hook to Flashing Edges
				(TF)	TIMBER FRAME: H1.2 min treated timber framing


NOTE : Where 75x3.15 jolt head nails are referenced, these may be substituted for 75mm jolt head weatherboard screws

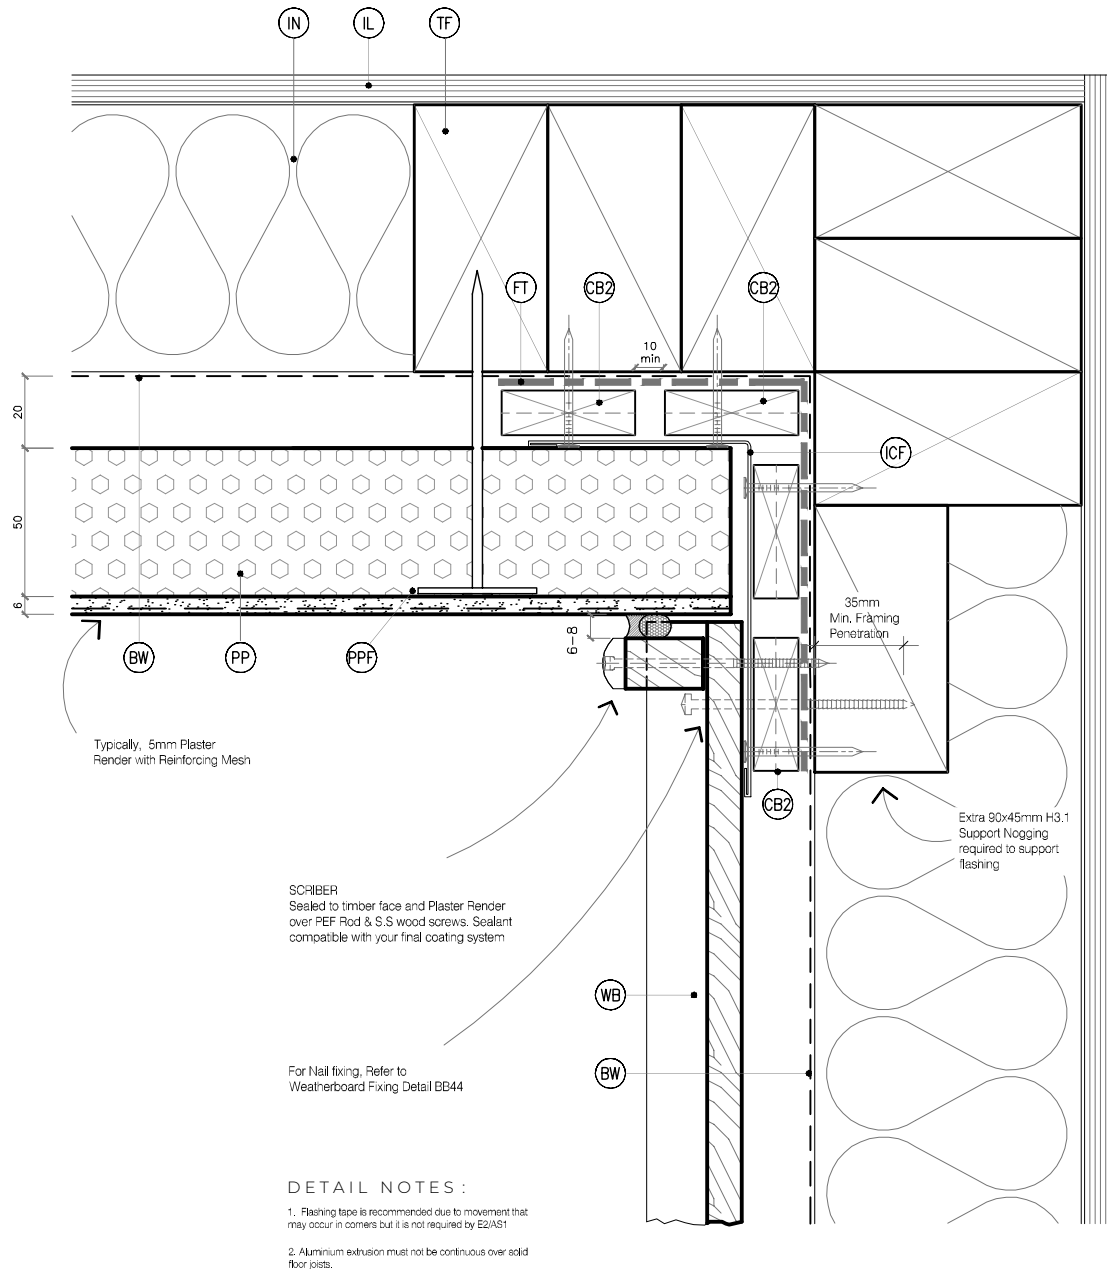

LEGEND:

- | | | | | | |
|--------------|---|--------------|---|--------------|--|
| (SF) | SILL FLASHING: Continuous flashing on 15° min slope with turn back ends at end of walls. Materials as per E2/AS1 4.0 Typically 0.45mm Min 316 Stainless Steel. | (CB2) | CAVITY BATTEN, VERTICAL: 20mm x 45mm H3.1. To form a 20mm cavity. | (ECF) | EXTERNAL CORNER FLASHING: 316 S.S Corner flashing. Refer NZBC E2/AS1 4.3. 125x75 Hem or Hook to Flashing Edges. EXTRA HIGH WIND ZONE 150x100 Hem or Hook to Flashing Edges |
| (BW) | BUILDING WRAP: Flexible Wall Underlay. As per NZBC E2/AS1 - Table 23. In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1) | (CB3) | CAVITY BATTEN, VERTICAL - STRUCTURALLY FIXED : 45mm x 45mm SPP Radiata Pine, H3.2 70mm x 45mm SPP Radiata Pine, H3.2 To form a 45mm cavity | (ICF) | INTERNAL CORNER FLASHING: As per External Corner Flashing Hem & Hook flipped. |
| (PP) | PLASTER PANEL: Selected Insulated Facade Panel System. Typically 50mm Thick, fixed to 20mm vertical cavity batten | (HS) | HEAD SOFFIT SCRIBER: Southern Pine Eaves Mould EM 40 x 27. Fix with 75 x 3.15 316 SS nail in 2.5mm predrilled hole | (IL) | INTERNAL LINING: Selected Internal Lining |
| (FT) | FLASHING TAPE: As per E2/AS1 4.3.11 | (CC) | CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm Min drip edge to cladding | (IN) | INSULATION: Selected Insulation |
| (PPF) | PLASTER PANEL FIXING: Specific designed panel fixing system. Install to manufactures instructions | (WB) | WEATHER BOARD: Southern Pine Bevel Back Weatherboard. Profile to NZS 3617 | (FF) | FLAT FLASHING: 316 Stainless Steel 100mm Hem or Hook to Flashing Edges. EXTRA HIGH WIND ZONE 150mm Hem or Hook to Flashing Edges |
| | | | | (TF) | TIMBER FRAME: H1.2 min treated timber framing |

NOTE : Where 75x3.15 jolt head nails are referenced, these may be substituted for 75mm jolt head weatherboard screws

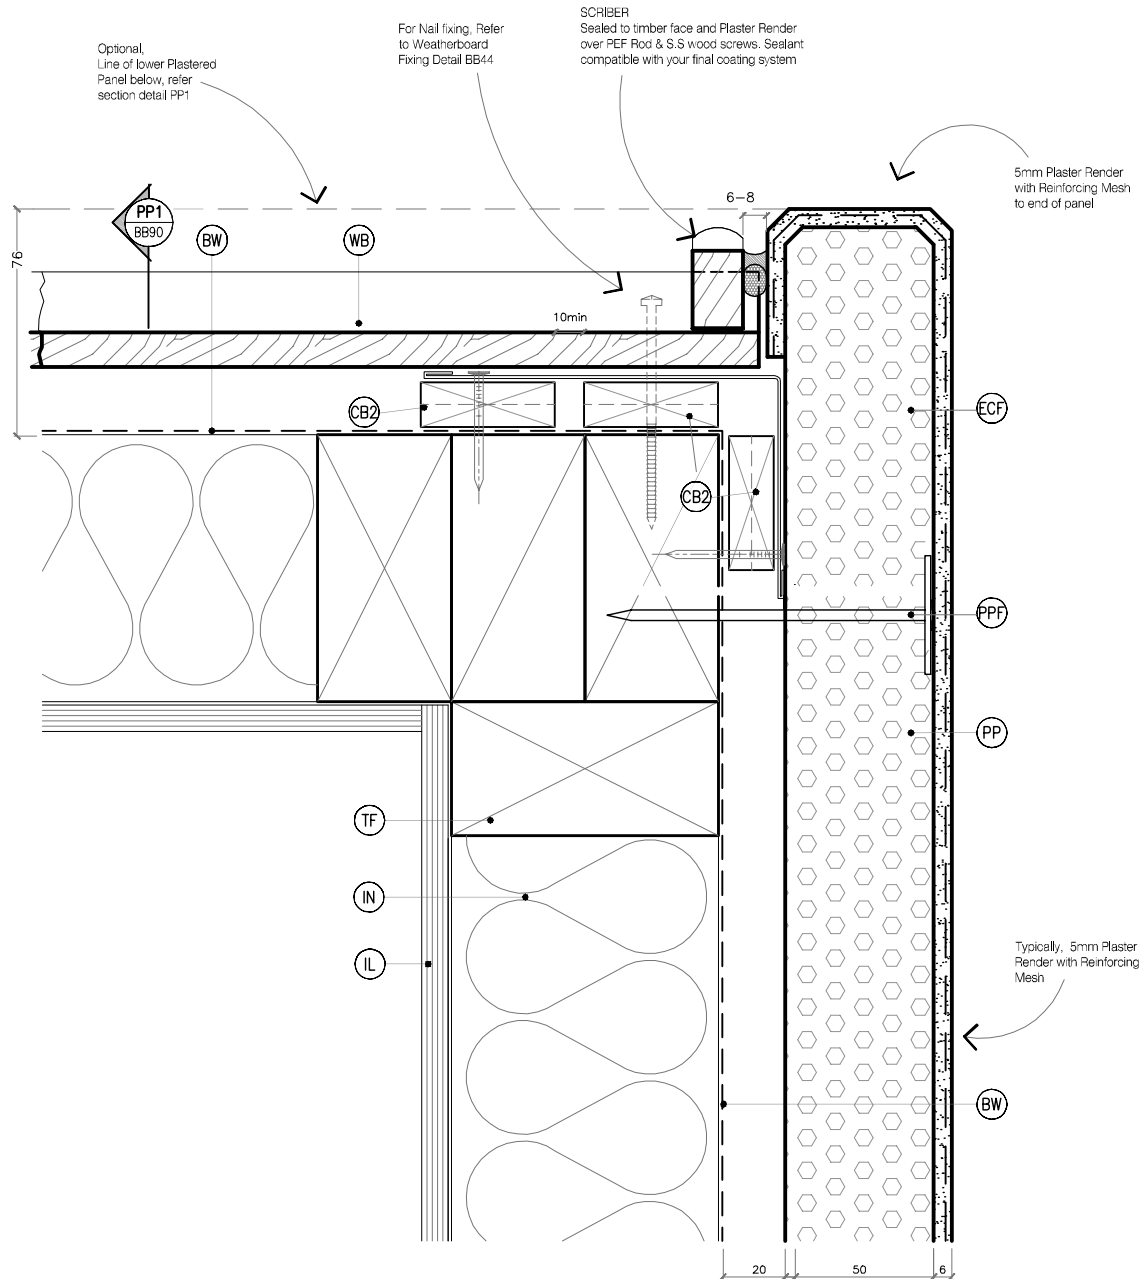

LEGEND:



SF SILL FLASHING: Continuous flashing on 15° min slope with turn back ends at end of walls. Materials as per E2/AS1 4.0 Typically 0.45mm Min 316 Stainless Steel.



BW BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Ridgid Underlay required (9.1.7.2 E2/AS1)



PP PLASTER PANEL: Selected Insulated Facade Panel System. Typically 50mm Thick, fixed to 20mm vertical cavity batten



FT FLASHING TAPE: As per E2/AS1 4.3.11



PPF PLASTER PANEL FIXING: Specific designed panel fixing system. Install to manufactures instructions



CB2 CAVITY BATTEN, VERTICAL: 20mm x 45mm H3.1. To form a 20mm cavity.



CB3 CAVITY BATTEN, VERTICAL - STRUCTURALLY FIXED : 45mm x 45mm SPP Radiata Pine, H3.2 70mm x 45mm SPP Radiata Pine, H3.2 To form a 45mm cavity



HS HEAD SOFFIT SCRIBER: Southern Pine Eaves Mould EM 40 x 27. Fix with 75 x 3.15 316 SS nail in 2.5mm predrilled hole



CC CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm Min drip edge to cladding



WB WEATHER BOARD: Southern Pine Bevel Back Weatherboard. Profile to NZS 3617



ECF EXTERNAL CORNER FLASHING: 316 S.S Corner flashing. Refer NZBC E2/AS1 4.3. 125x75 Hem or Hook to Flashing Edges. EXTRA HIGH WIND ZONE 150x100 Hem or Hook to Flashing Edges



ICF INTERNAL CORNER FLASHING: As per External Corner Flashing Hem & Hook flipped.



IL INTERNAL LINING: Selected Internal Lining



IN INSULATION: Selected Insulation




FF FLAT FLASHING: 316 Stainless Steel 100mm Hem or Hook to Flashing Edges. EXTRA HIGH WIND ZONE 150mm Hem or Hook to Flashing Edges



TF TIMBER FRAME: H1.2 min treated timber framing

NOTE : Where 75x3.15 jolt head nails are referenced, these may be substituted for 75mm jolt head weatherboard screws

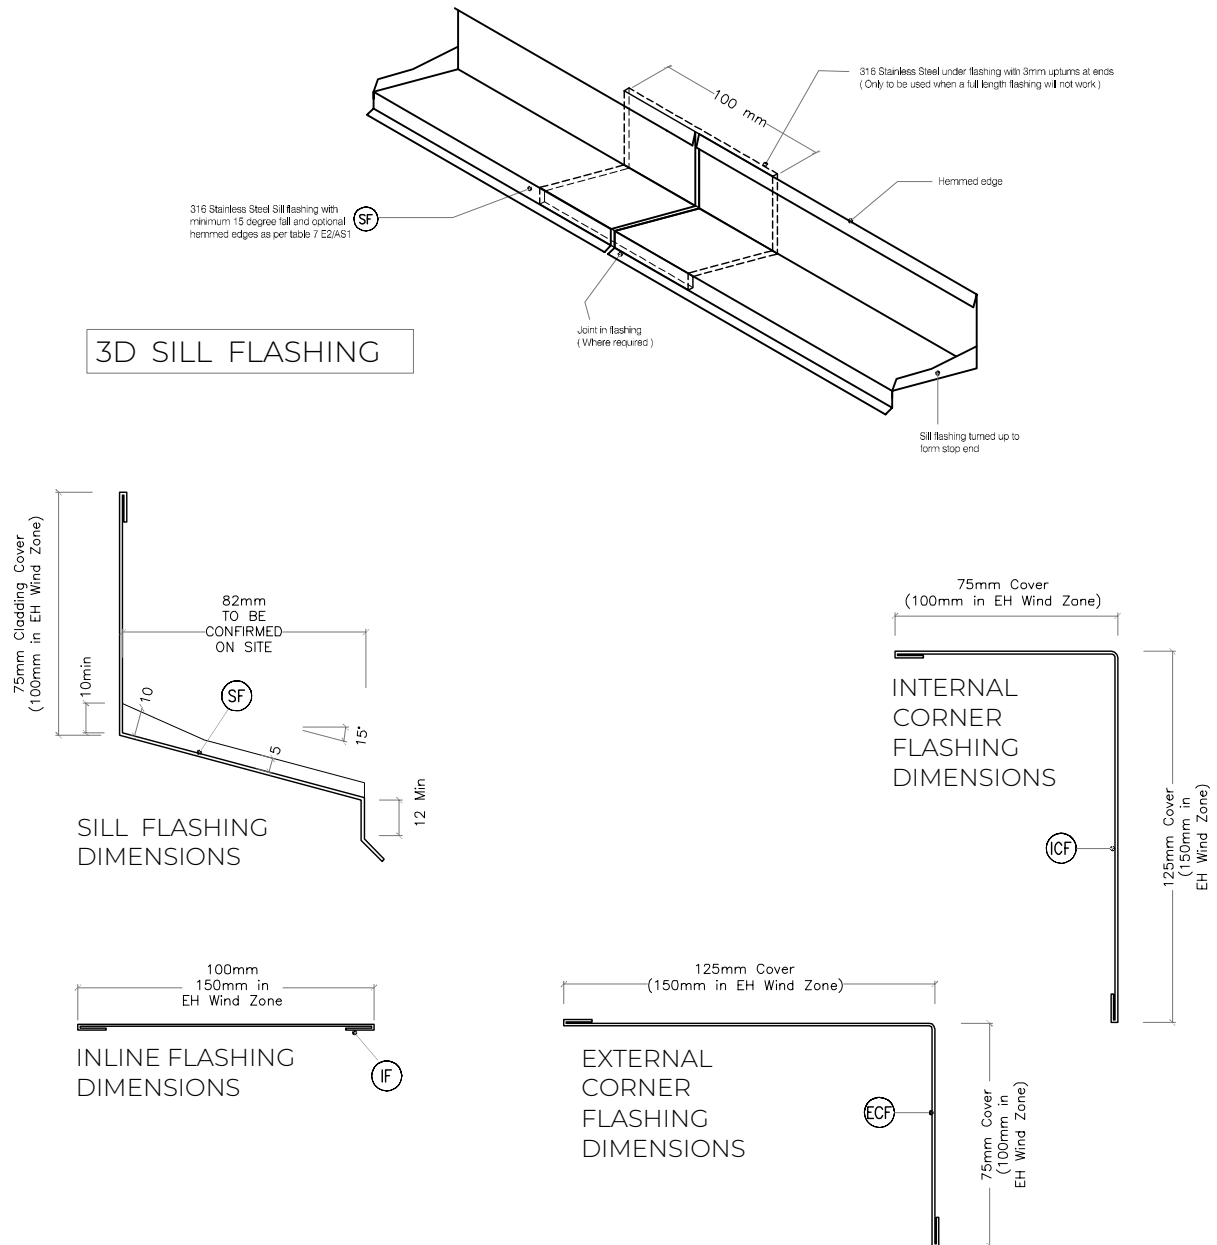

LEGEND:

- | | | |
|--|--|---|
| <p>(SF) SILL FLASHING: Continuous flashing on 15° min slope with turn back ends at end of walls. Materials as per NZBC E2/AS1 4.0 Typically 0.45mm Min 316 Stainless Steel.</p> <p>(BW) BUILDING WRAP: Flexible Wall Underlay, As per NZBC E2/AS1 - Table 23, In extra high wind zones, Rigid Underlay required (9.1.7.2 E2/AS1)</p> <p>(PP) PLASTER PANEL: Selected Insulated Facade Panel System. Typically 50mm Thick, fixed to 20mm vertical cavity batten</p> <p>(FT) FLASHING TAPE: As per E2/AS1 4.3.11</p> <p>(PPF) PLASTER PANEL FIXING: Specific designed panel fixing system. Install to manufactures instructions</p> | <p>(CB2) CAVITY BATTEN, VERTICAL: 20mm x 45mm H3.1. To form a 20mm cavity.</p> <p>(CB3) CAVITY BATTEN, VERTICAL - STRUCTURALLY FIXED : 45mm x 45mm SPP Radiata Pine, H3.2 70mm x 45mm SPP Radiata Pine, H3.2 To form a 45mm cavity</p> <p>(HS) HEAD SOFFIT SCRIBER: Southern Pine Eaves Mould EM 40 x 27. Fix with 75 x 3.15 316 SS nail in 2.5mm predrilled hole</p> <p>(CC) CAVITY CLOSURE: Cavity closure strip, positioned to give a 15mm Min drip edge to cladding</p> <p>(WB) WEATHER BOARD: Southern Pine Bevel Back Weatherboard. Profile to NZS 3617</p> | <p>(ECF) EXTERNAL CORNER FLASHING: 316 S.S Corner flashing. Refer NZBC E2/AS1 4.3. 125x75 Hem or Hook to Flashing Edges. EXTRA HIGH WIND ZONE 150x100 Hem or Hook to Flashing Edges</p> <p>(ICF) INTERNAL CORNER FLASHING: As per External Corner Flashing Hem & Hook flipped.</p> <p>(IL) INTERNAL LINING: Selected Internal Lining</p> <p>(IN) INSULATION: Selected Insulation</p> <p>(FF) FLAT FLASHING: 316 Stainless Steel 100mm Hem or Hook to Flashing Edges. EXTRA HIGH WIND ZONE 150mm Hem or Hook to Flashing Edges</p> <p>(TF) TIMBER FRAME: H1.2 min treated timber framing</p> |
|--|--|---|

NOTE : Where 75x3.15 jolt head nails are referenced, these may be substituted for 75mm jolt head weatherboard screws



info@sppnz.co.nz | 0800 999 321 | sppnz.co.nz